

IOWA DEPARTMENT OF NATURAL RESOURCES  
ENGINEERING BUREAU  
WALLACE STATE OFFICE BUILDING

ADDENDUM No. 1

LAKE AHQUABI STATE PARK  
CAMPGROUND UPGRADE PROJECT  
WARREN COUNTY, IOWA  
PROJECT NUMBER: 22-05-91-01

January 12, 2022

*This Addendum is issued to modify, explain or correct the original Drawings and Specifications, and is hereby made a part of the Contract Documents. Please attach this Addendum to the Project Manual in your possession. Insert the number and issue date of this Addendum in the blank space provided on the Proposal Form.*

**SPECIFICATIONS:**

- A. Revised Section #300-1, Proposal had the incorrect completion date, actual completion date is December 31, 2022.

**PLANS:**

- A. Sheet #26, SANITARY SEWER PUMP STATION, The bottom elevation for the pump station should be 883.00'.
- B. Sheet #26, SANITARY SEWER PUMP STATION, Approved equal product for the submersible grinder pumps shall be the 'Pentair Myers Model VSX30-21-50 Explosion-Proof Submersible Grinder Pump'.

Time and Date of Letting **11:00 AM, January 20, 2022**

**PROPOSAL**

Project Description and Location

Project No. **22-05-91-01**

**CAMPGROUND UPGRADE PROJECT  
LAKE AHQUABI  
WARREN COUNTY, Iowa**

Proposal of: \_\_\_\_\_  
(Name of Bidder)

Located at: \_\_\_\_\_  
(Address) (Telephone include area code)

Amount of Proposal Guarantee	Specified completion date or Number of Working Days	Approx. or Specified Starting Date or Number of Working Days	Liquidated Damages Per Day
\$200,000.00	December 31, 2022	N/A	\$1,000.00

The undersigned hereby agrees, if awarded the contract, to execute the proposed contract and to furnish an approved performance bond in a amount not less than 100 percent of the contract award within 30 days after the date of approval of award of the contract, and to provide all labor, materials, and equipment required to complete the project designated above, for the price hereinafter set forth, in strict compliance with the contract documents prepared by the Iowa Department of Natural Resources.

The undersigned agrees, if awarded the contract, to commence the work within a reasonable time after the preconstruction conference or by the specific starting date, if so specified, and to complete the work within the contract period, or to pay liquidated damages in the amount stipulated herein for each calendar day the work remains uncompleted after the expiration of the contract period or any authorized reduction thereof.

A proposal guarantee in the amount stipulated herein is included with this proposal, to be forfeited to the Iowa Department of Natural Resources if the undersigned fails to execute the contract and furnish an approved performance bond, if awarded the contract.

By virtue of statutory authority, preference will be given to products and provisions grown and coal produced within the state of Iowa, and also, a resident bidder shall be allowed a preference against a nonresident bidder from a state or foreign country which gives or requires a preference to bidders from that state or foreign country on projects in which there are no federal funds involved.

BY


\_\_\_\_\_  
(Iowa Contractor Registration No.) (Signed) (Date)

\_\_\_\_\_  
(FID/EIN/SSN) (Phone Number) (Fax Number)

\_\_\_\_\_  
(Email Address)

By signing and submitting the proposal, the bidder:

1. Gives an unsworn declaration on behalf of each person, firm, association, partnership, or corporation has not, either directly or indirectly, entered into any agreement, participated in any collusion, or otherwise taken any action in restraint of free competitive bidding in connection with such contract, and is not under debarment currently by the Federal government for a criminal violation which is reasonably related to bidding and contracting procedures; and

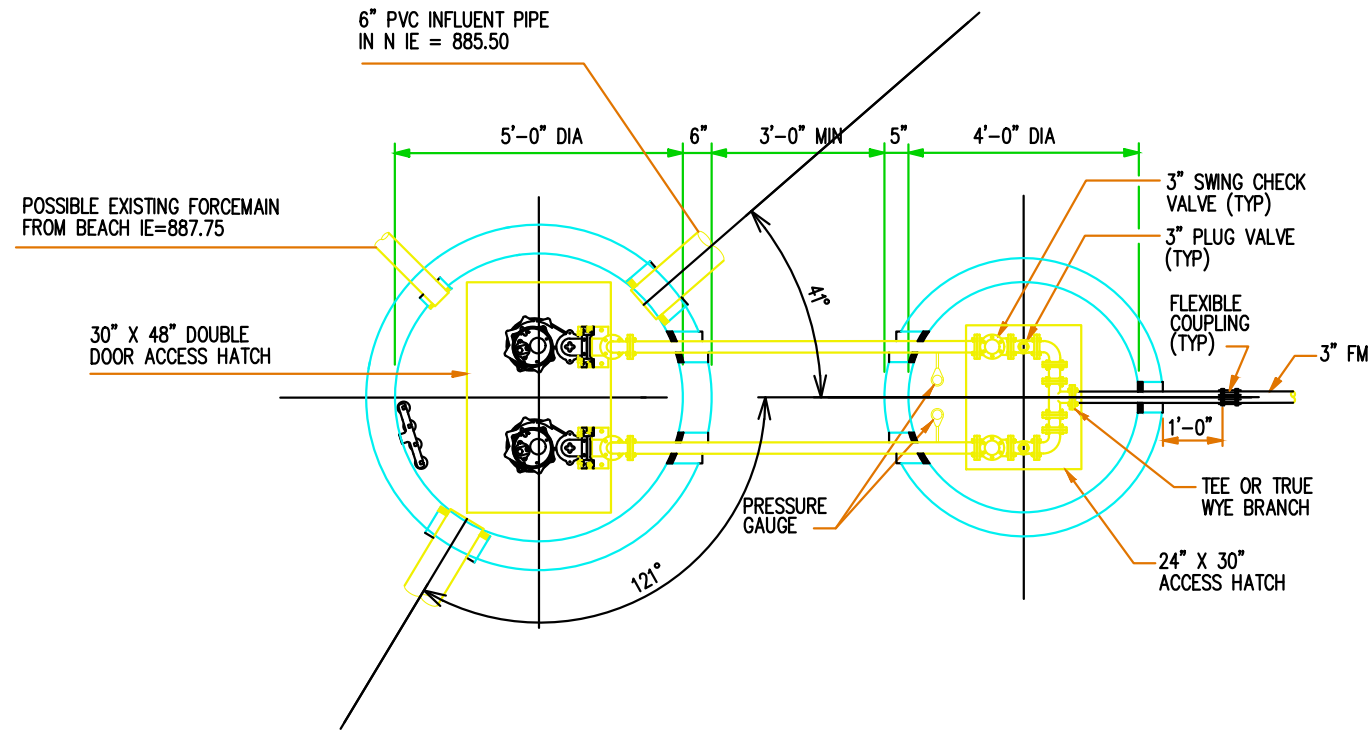

## DUPLEX STATION

FURNISHED BY CONTRACTOR:

- 2 - "HYDROMATIC HPGFX-300 SUBMERSIBLE GRINDER PUMPS  
60 GPM @43' TDH (OR APPROVED EQUAL)  
COMPLETE WITH
  - 50' OF POWER CORD
  - 2- 3 HP, 230/1 SUBMERSIBLE MOTOR
  - 2-STAINLESS STEEL LIFTING CHAIN
  - 2-SEAL KIT (SPARE)
  - 2- 3" MTM RAIL SYSTEM -BASE ELBOW, SEALING FLANGE
  - 1-SS CORD AND FLOAT HANGER
  - 4-FLOATS-NON MERCURY

- 1 - COMPATIBLE CONTROL PANEL COMPLETE AS FOLLOWS:
  - NEMA 4X ENCLOSURE
  - FLASHING HIGHWATER ALARM LIGHT AND HORN
  - PADLOCK PROVISION
  - CIRCUIT BREAKERS
  - HP RATED CONTACTOR
  - DUPLEX PUMP CONTROLLER WITH TERMINALS
  - ALTERNATING RELAY
  - H-O-A SWITCHES
  - RUN LIGHTS
  - LIGHTNING ARRESTOR
  - SWING DEAD INNER DOOR
  - LEVEL CONTROL SYSTEM (MECHANICALLY ACTIVATED/FLOATS 4)
  - MOTOR OVER-TEMP RELAYS W/INDICATOR LIGHTS
  - ELAPSED TIME METERS
  - SEAL FAILURE CIRCUIT AND INDICATION
  - ANTI-CONDENSATION HEATER WITH THERMOSTAT
  - UL LABEL


- 1 - START-UP AND TRAINING

- 1 - U.S. FOUNDRY ALUMINUM ACCESS HATCH FOR LIFT STATION, 30" X 48" DUPLEX, 300 PSF, BITUMINOUS PAINT AND HOLD OPEN HANDLE

- 1 - U.S. FOUNDRY ALUMINUM ACCESS HATCH FOR VALVE BOX, 24" X 30" SIMPLEX, 300 PSF, BITUMINOUS PAINT AND HOLD OPEN HANDLE

FURNISHED BY CONTRACTOR:


- 1 - PRECAST CONCRETE WET WELL AND TOP WITH CAST-IN-PLACE (OR PRECAST) BASE
- 1 - PRECAST CONCRETE VALVE VAULT AND TOP WITH CAST-IN-PLACE (OR PRECAST) BASE
- 2 - PLUG VALVES, 3", CAST OR DUCTILE IRON
- 2 - CHECK VALVES, 3", CAST OR DUCTILE IRON
- 1 - ALL PIPING, COUPLINGS, ELBOWS, ETC. ABOVE BASE ELBOW - SCH 40 GALVANIZED STEEL PIPE OR SCH 80 PVC
- 1 - PIPE AND FITTINGS FOR VALVE VAULT DRAIN TO WET WELL
- 1 - PIPE AND FITTINGS FOR WET WELL VENT
- 2 - PRESSURE GAUGES AND FITTINGS

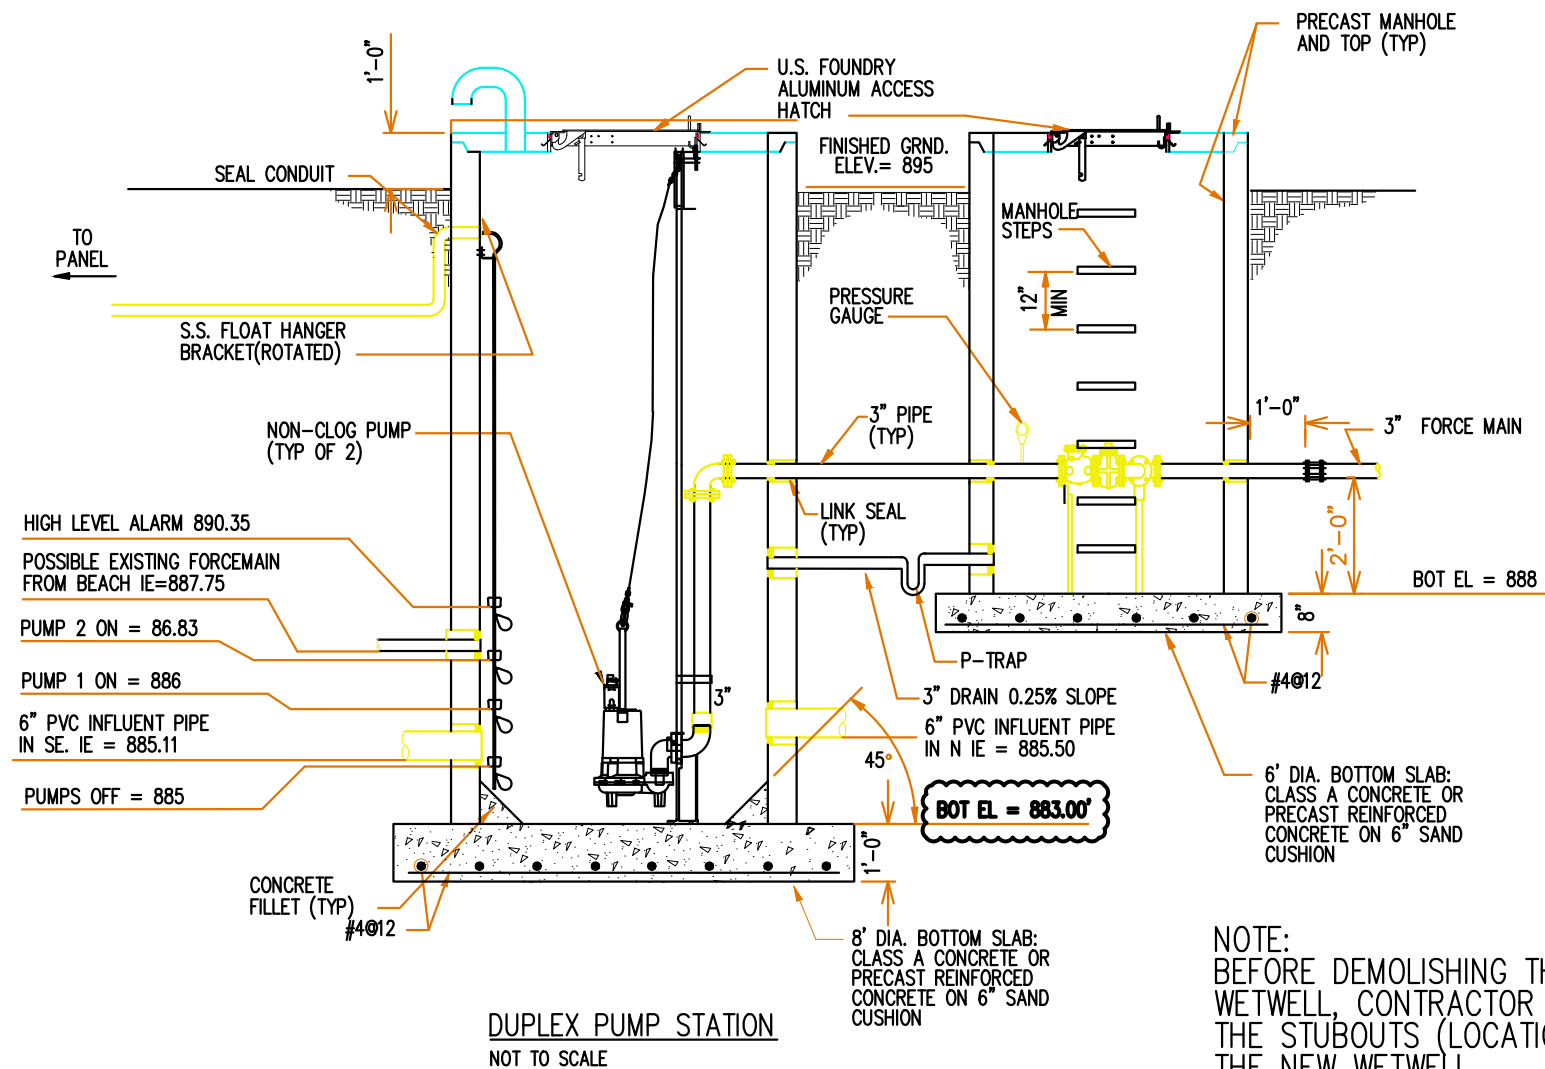

DUPLEX PUMP STATION  
NOT TO SCALE

NOTE:  
BEFORE DEMOLISHING THE EXISTING LIFT STATION WETWELL, CONTRACTOR WILL VERIFY AND RECORD ALL THE STUBOUTS (LOCATION AND ELEVATION) TO ORDER THE NEW WETWELL.

CONSULTANT:



IOWA DEPARTMENT OF  
NATURAL RESOURCES

ENGINEERING SERVICES - WALLACE BUILDING  
502 E. 9TH ST., DES MOINES, IA 50319-0034



SANITARY SEWER PUMP STATION

CONSTRUCTION PROJECT FOR:  
LAKE AHQUABI CAMPGROUND  
UPGRADE PROJECT

WARREN COUNTY, IOWA

NO.	DATE	REVISION
1	1/12/2022	

DRAWN BY: PROJECT NUMBER:  
22-05-91-01

CHKD BY: DATE:  
12/29/2021