



# **2024 Annual Water Quality Report and Engineering Inspection**

**Permit #70-SDP-09-91P**

Central Iowa Power Cooperative

December 16, 2024





# Executive Summary

## Period of Report Coverage

This Annual Water Quality Report (AWQR) presents the data collected in October 2024 for the Central Iowa Power Cooperative (CIPCO) Coal Combustion Residue (CCR) Monofill. For most analytes, the report includes data from October 2016 onward when analysis was shifted to total metals instead of dissolved metals. Greater historical data for chloride and sulfate is included because these analytes were not previously filtered.

## Report Priority

The data presented in the 2024 CIPCO AWQR is consistent with past data. Decreasing trends are observed more frequently than increasing trends. Elevated concentrations remain primarily in one area identified by MW-15 and MW-17. The recommendations are to continue groundwater monitoring.

## Site Status and Applicable Rules

The CIPCO CCR Monofill ceased receiving CCR in 2014 and closure cap construction was completed in 2015. Closure Permit #70-SDP-09-91C (Closure Permit) was issued February 1, 2016. The CCR Monofill is permitted and closed under 567 Iowa Administrative Code, Chapter 103. Figure 2 – Site Plan and Monitoring Network shows the status of the site monitoring network and topographic conditions.

# Contents

<b>1.</b>	<b>Introduction</b>	<b>1</b>
1.1	Background	1
1.2	Monitoring System	2
1.3	Sample Collection	2
1.4	Analytical Parameters	2
<b>2.</b>	<b>Groundwater Flow Conditions</b>	<b>2</b>
2.1	Horizontal Groundwater Flow	2
2.2	Vertical Hydraulic Gradients	3
<b>3.</b>	<b>Analytical Results</b>	<b>3</b>
3.1	Data Analysis	3
3.1.1	Published Standards	3
3.1.2	Baseline Concentrations	4
3.1.3	UCLs	4
3.1.4	Two-Year Average Concentration	4
3.2	Reporting Limits	4
3.3	Evaluation of Analytical and Field Data	4
3.3.1	Published Standards	4
3.3.2	Baseline Concentrations	5
3.3.3	Trend Review	5
<b>4.</b>	<b>Summary and Recommendations</b>	<b>6</b>
<b>5.</b>	<b>Inspections</b>	<b>6</b>

## Table index

Table 1	Monitoring Program Summary
Table 2	Monitoring Program Implementation Schedule
Table 3	Monitoring Well Maintenance and Performance Reevaluation Schedule (Not Applicable)
Table 4	Monitoring Well Maintenance and Performance Summary
Table 5	Background Summary
Table 6	Summary of Well/Detected Constituent Pairs with No Immediately Preceding Control Limit Exceedances
Table 7	Summary of Ongoing and Newly Identified Control Limit Exceedances
Table 8	Analytical Data Summary
Table 9	Historical Control Limit and Action Level Exceedances
Table 10	Groundwater Quality Assessment Plan Trend Analysis
Table 11	Leachate Management Summary (Not Applicable)
Table 12	Gas Monitoring Summary (Not Applicable)
Table 13	Groundwater Elevations October 22, 2024
Table 14	Vertical Hydraulic Gradients (ft/ft) October 22, 2024

## Figure index

Figure 1	Site Location Map
Figure 2	Site Map and Monitoring Network
Figure 3	Water Table Potentiometric Surface October 22, 2024
Figure 4	Uppermost Aquifer Potentiometric Surface October 22, 2024
Figure 5	Summary of Exceedances of Published Standards October 2024
Figure 6	Arsenic Sample Results October 2024
Figure 7	Boron Sample Results October 2024
Figure 8	Chloride Sample Results October 2024
Figure 9	Cobalt Sample Results October 2024
Figure 10	Iron Sample Results October 2024
Figure 11	Lithium Sample Results October 2024
Figure 12	Magnesium Sample Results October 2024
Figure 13	Manganese Sample Results October 2024
Figure 14	Molybdenum Sample Results October 2024
Figure 15	Sodium Sample Results October 2024
Figure 16	Strontium Sample Results October 2024
Figure 17	Sulfate Sample Results October 2024
Figure 18	Temperature Values October 2024
Figure 19	pH Values October 2024
Figure 20	Specific Conductance Values October 2024

# Appendices

Appendix A	Monitoring Forms
Appendix B	Laboratory Analytical Reports
Appendix C	Graphs of Analytical and Monitoring Results
Appendix D	Inspection Summary

# Acronyms/Abbreviations:

AWQR	Annual Water Quality Report
CIPCO	Central Iowa Power Cooperative (CIPCO)
CCR	Coal Combustion Residue
HA	Lifetime Health Advisory
HIR	Hydrogeological Investigation Report
HMSP	Hydrologic Monitoring System Plan
GWQA	Groundwater Quality Assessment
IAC	Iowa Administrative Code
IDNR	Iowa Department of Natural Resources
MCL	EPA Maximum Contaminant Level
ORP	Oxidation Reduction Potential
SDWR	Secondary Drinking Water Regulations
SWS	Statewide Standard
U	Used in Table 8 to denote concentrations that are reported as non-detect. The associated value represents half the reporting limit.
UCL	Upgradient Control Limit
USEPA	United States Environmental Protection Agency

# 1. Introduction

This Annual Water Quality Report (AWQR) and Engineering Inspection was prepared by GHD on behalf of Central Iowa Power Cooperative (CIPCO) for the closed Fair Station Coal Combustion Residue (CCR) Monofill (Monofill) in Muscatine County, Iowa. The Monofill ceased receiving CCR in 2014 and closure cap construction was completed in 2015. Closure Permit #70-SDP-09-91C (Closure Permit) was issued February 1, 2016.

## 1.1 Background

The Monofill received CCR from the Fair Station power plant in Muscatine, Iowa from 1974 through November 7, 2014. No material other than CCR and other approved materials from demolition of Fair Station have been disposed in the Monofill. Prior to 1974, the Monofill property was used for agricultural activities. Cap construction was completed in 2014 and 2015. Final seeding of the cover was completed in September 2015. The Construction Summary Report was submitted to the Iowa Department of Natural Resources (IDNR) on December 22, 2015, and the Closure Permit was issued on February 1, 2016. The closure activities did not require modification of the groundwater monitoring network.

The local geology consists of sands, silts, and clays similar to what would be expected from alluvial deposition. The 1994 Hydrogeological Investigation Report (HIR) and Hydrologic Monitoring System Plan (HMSP) concluded these deposits did not appear to be great enough in thickness or extent to form an alluvial aquifer. Over the majority of the Monofill, Pennsylvanian shale is found at depths of 15 feet below ground surface or less, underlain by Devonian limestone. On the eastern, higher elevation portion of the Monofill, depth to bedrock is greater than 15 feet.

The Monofill is located adjacent to the Pine Creek flood plain. Pine Creek enters the Mississippi River approximately ½ mile southwest of the Monofill. Water table groundwater flow is generally toward Pine Creek. The Devonian aquifer flow is generally directed west/southwest, toward Pine Creek and the Mississippi River. The location of the Monofill is shown in Figure 1.

A groundwater quality assessment (GWQA) was initiated at the Monofill site in 2012 and completed in 2013. As an outgrowth of those activities, new monitoring wells MW-17, MW-19, and MW-20 were integrated into the HMSP and the analyte list was expanded at the direction of the IDNR, as reflected in this AWQR. Monitoring well MW-19 has since been abandoned.

The December 9, 2016 AWQR for 2016 data was the last report to include dissolved (filtered) metals analysis for groundwater samples. Following an IDNR comment letter dated May 17, 2017, CIPCO applied for a variance to switch to unfiltered samples. The December 9, 2016 AWQR included a side-by-side comparison of filtered and unfiltered samples collected generally through low-flow techniques. The variance request also sought to reduce the analyte list. The variance was approved in a letter dated July 24, 2017, with the exception that arsenic and cobalt analyses remain required. The approval eliminates barium, beryllium, copper, lead, selenium, and zinc. The variance was incorporated into Revision 1 of the closure permit also issued July 24, 2017.

Due to the change to sampling total metals (unfiltered metals), it was necessary to establish new baseline concentrations for metals. Four sampling events: October 2016, August 2017, October 2017, and April 2018 formed the new baseline concentrations. Historical data reflecting total metals are no longer reported; however, the data are available in the December 9, 2016 AWQR.

It is anticipated a 10-year post-closure monitoring period, completed with an annual sampling event in 2026, will be required; however, the potential to cease monitoring earlier exists.

## 1.2 Monitoring System

Groundwater samples are collected from three water table monitoring wells (upgradient well MW-11, and downgradient wells MW-2 and MW-6), and water table monitoring wells MW-4, MW-7, and MW-10 are used for elevation monitoring only. Groundwater samples are collected from seven uppermost aquifer wells (upgradient location MW-9 and downgradient locations MW-1, MW-3, MW-5, MW-15, MW-17, and MW-20). Surface water sampling was discontinued with issuance of the Closure Permit. Figure 2 shows the locations of monitoring wells and identifies upgradient locations. Table 1 and Table 2 present the monitoring program summary and implementation schedule, respectively. Table 4 presents the monitoring well maintenance and performance summary.

Based on past groundwater analytical data, MW-1, although hydraulically upgradient, is evaluated as a downgradient well due to apparent impacts observed. All other wells are characterized as upgradient or downgradient consistent with site data.

## 1.3 Sample Collection

Sampling for the 2024 AWQR was completed in October 2024. Groundwater samples were collected with low-flow pneumatic bladder pumps with dedicated tubing and dedicated (disposable) bladders except for MW-9.

A flow-through monitoring cell was used prior to sample collection to measure pH, conductivity, temperature, dissolved oxygen, turbidity, and oxidation reduction potential (ORP). The sampling method for MW-9 remained a disposable polyethylene bailer without a flow-cell.

## 1.4 Analytical Parameters

Groundwater samples collected during the sampling event were analyzed for arsenic, cobalt, iron, magnesium, manganese, chloride, and sulfate as required in Paragraph 567—103.1(4)d of the [Iowa Administrative Code \(IAC\)](#). A variance granted in July 2017 eliminated the requirement for barium, beryllium, copper, lead, selenium, and zinc analyses based on historical data. Boron, lithium, molybdenum, sodium, and strontium are also analyzed per the amended HMSP. Laboratory analysis was conducted by Eurofins Environmental Testing North Central, LLC. (Eurofins) of Cedar Falls, Iowa. Eurofins provided prepared sample containers for the monitoring event.

# 2. Groundwater Flow Conditions

## 2.1 Horizontal Groundwater Flow

Static water levels were measured at each of the monitoring wells included in the monitoring system in October 2024. Table 13 presents groundwater elevations measured in wells during the October 2024 monitoring event. A water table contour map (Figure 3) was prepared using water level measurements from the October 2024 monitoring event. During this monitoring event, the inferred groundwater flow direction at the water table was toward the southwest. Figure 4 shows the potentiometric surface of the uppermost aquifer based on measurements from the October 2024 monitoring event. The apparent direction of flow in the uppermost aquifer is generally to the southwest. The flow of groundwater in both the water table and uppermost aquifer at the Monofill is toward Pine Creek located west of the Monofill.

## 2.2 Vertical Hydraulic Gradients

Water levels measured in monitoring well clusters MW-2/MW-3, MW-6/MW-5, MW-10/MW-9, and MW-7/MW-20 during the 2024 monitoring event were used to calculate vertical hydraulic gradients for the Monofill. The vertical hydraulic gradients were calculated by the following equation:

$$\frac{\text{Water Elevation in Deep Well} - \text{Water Elevation in Shallow Well}}{\text{Elevation of Middle of Saturated Zone of Shallow Well Screen} - \text{Elevation of Middle of Saturated Zone of Deep Well Screen}}$$

The calculated vertical hydraulic gradients are presented in Table 14. The results are similar to historical results for each well pair. The downward-directed flow reported at MW-10/MW-9 remains the largest gradient on site; MW-9 is the deepest well on site.

## 3. Analytical Results

Groundwater sample collection records for October 2024 are provided in Appendix A and the associated laboratory analytical reports are provided in Appendix B. Table 8 present current and historical analytical data (with total metals) collected at the Monofill for sampling locations and analytes in the current monitoring plan. Historical data with total metals was last presented in the December 9, 2016 AWQR. Appendix C includes graphs of concentration versus time for all analytes and in each monitored unit (water table and uppermost aquifer). Table 10 summarizes the annual laboratory results and basic trend analysis.

### 3.1 Data Analysis

Sample results are compared to multiple reference concentrations: 1) published concentration standards, 2) baseline concentrations, 3) upgradient control limits (UCLs) and, 4) where applicable, a two-year average concentration. All comparisons are shown in the Analytical Data Summary in Appendix C. Comparison to published standards and UCLs are included graphically in Appendix C.

#### 3.1.1 Published Standards

To evaluate the status of water quality at the Monofill, a comparison was made between the sample result and federal drinking water quality standards, as required by Paragraph 567—103.1(4)d of the IAC. Sample results were compared to the United States Environmental Protection Agency (USEPA) Maximum Contaminant Level (MCL), Lifetime Health Advisory (HA) Level, or Secondary Drinking Water Regulations (SDWR) guidelines as presented in the 2018 Edition of the Drinking Water Standards and Health Advisories, dated March 2018 (2018 Standards) (USEPA, 2018). The following definitions of the various standards are adapted from the 2018 Standards document:

- MCL – The highest level for a contaminant that is allowed in drinking water. MCLs are enforceable standards. There is an MCL for arsenic.
- HA – An estimate of acceptable drinking water levels for a chemical substance based on health effects information. The lifetime HA is the concentration of a chemical in drinking water that is not expected to cause any adverse noncarcinogenic effects for a lifetime of exposure. The lifetime HA is based on exposure of a 70-kilogram (kg) adult consuming 2 liters of water per day. An HA is not a legally enforceable federal standard, but serves as technical guidance to assist federal, state, and local officials. There is an HA for boron, manganese, molybdenum, and strontium.
- SDWR – Non-enforceable federal guidelines regarding cosmetic effects (such as tooth or skin discoloration) or aesthetic effects (such as taste, odor, or color) of drinking water. An SDWR guideline exists for chloride, iron, manganese, and sulfate.



Iowa Statewide Standards (SWSs) are used for comparison of cobalt and lithium results since no MCL, HA, or SDWR guideline has been established for cobalt and lithium. Under 40 CFR Part 257.95(h)(2), federal standards for lithium (0.04 mg/L) and cobalt (0.006 mg/L) were established in 2018 for monitoring CCR sites where the federal coal ash rule is applicable. These federal standards are higher than the SWS of 0.014 mg/L and 0.003 mg/L for lithium and cobalt, respectively, in protected groundwater sources.

### 3.1.2 Baseline Concentrations

Baseline concentrations for total metals were established at all wells based on sample events in October 2016, August 2017, October 2017, and April 2018. Baseline concentrations are included in Table 10. For sulfate and chloride, historical values are used for baseline concentrations since these samples are not filtered and there was no difference with historical samples. Table 5 presents background summary data.

### 3.1.3 UCLs

A UCL was calculated for each upgradient sampling location as the average of all previous sampling results for each analyte in each well plus two standard deviations. The calculated UCLs are presented in Tables 5 and 8. Non-detect results were conservatively represented by one-half the reporting limit for calculation of the UCL. Table 6 presents exceedances of a control limit not immediately preceded by an exceedance, where control limits are identified as published standards. Table 8 provides all associated data and Table 9 presents a graphical summary of UCL and/or published standard exceedances in the last 5 years.

### 3.1.4 Two-Year Average Concentration

For magnesium and sodium, no MCL, HA, SDWR guideline, or SWS is established. In order to evaluate the status of water quality at the Monofill for these compounds (magnesium and sodium), a comparison was made between the sample result and the two-year average concentration for that parameter in each well, in accordance with Paragraph 567—103.1(4)d of the IAC. Non-detect results were represented by the reporting limit for calculating the two-year average concentration.

## 3.2 Reporting Limits

In the previous year's results, there were several constituents that had elevated reporting limits at certain wells, such as arsenic (MW-15), lithium (MW-6), and molybdenum (MW-2). In these cases, the results are graphed in the usual manner at one-half the reporting limit; however, they can appear on the graphs as spikes in concentration. The 2024 data have reporting limits consistent with historical data.

## 3.3 Evaluation of Analytical and Field Data

### 3.3.1 Published Standards

No reported concentrations exceed an MCL.

HAs were exceeded for boron (five locations), manganese (two locations), and molybdenum (three locations).

SDWR guidelines were exceeded for iron (five locations), manganese (eight locations), and sulfate (two locations).

SWSs were exceeded for cobalt (two locations) and lithium (eight locations).

Figure 5 identifies the monitoring points where published standards were exceeded. Table 7 presents a summary of ongoing and newly identified exceedances of published standards

### 3.3.2 Baseline Concentrations

October 2024 sample results exceeded baseline concentrations for the following wells and analytes:

- Boron at seven locations
- Chloride at seven locations
- Cobalt at three location
- Iron at one location
- Lithium at one locations
- Magnesium at two locations
- Manganese at three locations
- Molybdenum at one location
- Sodium at five locations
- Strontium at seven locations
- Sulfate at three locations

### 3.3.3 Trend Review

Trends can be observed in the charts in Appendix C and are summarized in Table 10. Most analytes and wells saw no trend. Decreasing trends outnumber increasing trends for laboratory analytes. Sulfate and chloride are often used as indicators for CCR impact on groundwater. The long-term overall trends for sulfate and chloride at the CIPCO CCR Monofill show the positive effects of closure. Select other parameters showing trends are discussed in this section.

Sulfate concentrations at uppermost aquifer monitoring wells MW-15 and MW-17 remain approximately an order of magnitude higher than the other monitoring locations. The 2024 data show MW-17 sulfate concentration is higher than the past few years. The 2024 sulfate result for MW-15 is a decrease from the previous year, but still higher than other recent data. There is no trend in MW-15 sulfate results and an increasing trend in MW-17. The last time the sulfate SDWR limit was exceeded at MW-5 was 2013; the last time at MW-6 was 2015. Sulfate last exceeded the SDWR limit at wells MW-1 and MW-2 in 2021. For the 2024 results, the only downgradient monitoring wells exceeding their sulfate baseline concentrations were MW-15 and MW-17.

Chloride concentrations exhibit a long-term trend of decreasing concentrations. The 2024 data showed slight increases in chloride across the monitoring network except for MW-3 where there was a slight decrease in chloride concentration, due to a lower reporting limit; however, all results are similar to previous years. The maximum chloride concentration reported, 20.4 mg/L at MW-15, is less than 10 percent of the SDWR value of 250 mg/L.

Cobalt results are variable. At uppermost aquifer monitoring well MW-6, all results are above the SWS of 0.0028 mg/L, but multi-year trends of decreasing and increasing results have been observed since 2016. The October 2024 cobalt concentration in uppermost aquifer well MW-3 exceeded the SWS for the first time since 2017. At MW-3, cobalt concentrations were trending slightly upward prior to 2024 but saw a large increase in the recent sample event.

Manganese at MW-6 continues a long-term downward trend but remains significantly elevated relative all other results at the site. This was previously identified as a local geologic impact and unlikely related to the presence of the Monofill. Manganese results at uppermost aquifer well MW-3 tend to match the pattern observed in cobalt results at this well. With the October 2024 cobalt result being the highest recorded since 2017. Similar patterns are evident in cobalt and manganese results at MW-1 and MW-5.

A historically increasing trend in molybdenum was evident at monitoring well MW-17 through 2021 but the last 3 years of data have been decreasing. MW-15 molybdenum concentration exhibits an increasing trend.

Sodium results show a long-term increasing trend at MW-17 and the 2024 result is higher than the 2023 result, continuing the tendency. In MW-15, there have been increases over the last few years, but the 2024 result is the

lowest since 2021. Generally, a flat or decreasing trend in sodium concentrations are observed in other areas of the Site.

## 4. Summary and Recommendations

No MCLs were exceeded in the October 2024 groundwater monitoring event. HAs (boron, manganese, and molybdenum), SDWR guidelines (iron, manganese, and sulfate), and the SWSs (cobalt and lithium) were exceeded at locations consistent with historical results.

Overall, groundwater monitoring results are in-line with expectations and decreasing trends are seen in sulfate data, while chloride data are consistent with historical trends. Overall, decreasing concentration trends are observed more than increasing trends but for most locations and analytes, no clear trend was noted.

The groundwater monitoring network remains appropriate for assessing the Monofill's impact on groundwater. Overall, the Monofill does not appear to be impacting groundwater at concentrations of concern relative to drinking water exposure. The standards used to evaluate the Monofill's impact on groundwater are drinking water standards. Although HAs and SDWR guidelines are exceeded, the Monofill does not pose a significant risk because no drinking water receptors are located immediately downgradient of the Monofill, local users of groundwater have deep wells, and the extent of impacts appears to be limited.

Routine annual monitoring at the Monofill should continue in October 2025. No change to the analyte list is proposed at this time. Although surface water monitoring may be warranted in the future, at this time, it is not recommended to resume. Years of past surface water monitoring did not show an impact, and sulfate concentrations (the largest mass in terms of milligrams per liter and thus most likely to be observed at levels of impact) at MW-17 remain within the range of historical results.

## 5. Inspections

CIPCO continued routine inspections of the Monofill since closure. Appendix D includes a summary of the 2024 inspection activities and corrective actions. Sam Honold of CIPCO routinely inspects the Monofill property.

Overall, the cap is well vegetated. Multiple mowing events were conducted during the year. Maintenance work on drainage channels was performed.

In 2022, a significant effort was completed by CIPCO to protect the landfill berm along Pine Creek. Two areas of historical erosion were cleared, covered with flex-a-mat, and re-seeded. This area generally appeared to be protected with the flex-a-mat performing as expected.

Seed added in 2023 and early 2024 showed good growth through the fall and will be checked again in the spring. Some maintenance items conducted were fence repair, tree removal, and rip-rap channel cleaning.

CIPCO will continue multiple site visits and inspections to support landfill maintenance.

# Tables

Table 1

**Monitoring Program Summary  
2024 Annual Water Quality Report  
CIPCO Fair Station CCR Monofill  
Permit No. 70-SDP-09-91C**

Monitoring Well	Formation	Current Monitoring Program	Change for next sampling event	Control Limit Exceedances	Total # of Samples in each monitoring program since January 1, 2018		
					Routine (Annual)	Supplemental	Remedial Action
MW-1	Uppermost Aquifer	Annual	No Change	Chloride, Iron, Lithium, Magnesium, Sulfate	7	0	0
MW-2	Water Table	Annual	No Change	Boron, Lithium, Sodium, Strontium, Sulfate	7	0	0
MW-3	Uppermost Aquifer	Annual	No Change	Boron, Sodium, Strontium	7	0	0
MW-5	Uppermost Aquifer	Annual	No Change	Boron, Chloride, Cobalt, Iron, Magnesium, Sodium, Sulfate	7	0	0
MW-6	Water Table	Annual	No Change	Arsenic, Boron, Chloride, Cobalt, Manganese, Molybdenum, Sodium, Strontium	7	0	0
MW-9	Uppermost Aquifer	Annual	No Change		7	0	0
MW-11	Water Table	Annual	No Change		7	0	0
MW-15	Uppermost Aquifer	Annual	No Change	Boron, Chloride, Lithium, Magnesium, Molybdenum, Sodium, Sulfate	7	0	0
MW-17	Uppermost Aquifer	Annual	No Change	Boron, Chloride, Iron, Lithium, Magnesium, Molybdenum, Sodium, Sulfate	7	0	0
MW-20	Uppermost Aquifer	Annual	No Change	Boron, Sodium	7	0	0
<b>Other monitoring points</b>							
MW-4	Water Table	Water Level	No Change	NA	0	0	0
MW-7	Water Table	Water Level	No Change	NA	0	0	0
MW-10	Water Table	Water Level	No Change	NA	0	0	0

**Table 2**

**Monitoring Program Implementation Schedule  
2024 Annual Water Quality Report  
CIPCO Fair Station CCR Monofill  
Permit No. 70-SDP-09-91C**

Monitoring Well	Recent Sampling Dates and Constituents				Upcoming Sampling Dates and Constituents
					Annually
MW-1	<p align="center">Arsenic, cobalt, iron, magnesium, manganese, chloride, and sulfate as required in Paragraph 567—103.1(4)d of the Iowa Administrative Code (IAC). A variance granted in July 2017 eliminated the requirement to analyze for barium, beryllium, copper, lead, selenium, and zinc based on historic data. Boron, lithium, molybdenum, sodium, and strontium are also analyzed per the amended HMSP.</p>				
MW-2					
MW-3					
MW-5					
MW-6					
MW-9					
MW-11					
MW-15					
MW-17					
MW-20					

**Table 3**

**Monitoring Well Maintenance and Performance Reevaluation Schedule  
2024 Annual Water Quality Report  
CIPCO Fair Station CCR Monofill  
Permit No. 70-SDP-09-91C**

This table is not applicable to the CIPCO Fair Station CCR Monofill

Table 4

**Monitoring Well Maintenance and Performance Summary**  
**2024 Annual Water Quality Report**  
**CIPCO Fair Station CCR Monofill**  
**Permit No. 70-SDP-09-91C**

Well	Top of Casing	Top of Screen	Total Depth		Date of Measurements		
					10/11/2022	10/10/2023	10/22/2024
MW-1	588.13	571.51	36	Groundwater Level (ft)	24.71	25.41	24.66
				Groundwater Elevation (Ft MSL)	563.42	562.72	563.47
				Measured Well Depth (ft)			
				Submerged screen	N	N	Y
MW-2	559.42	546.7	12.69	Groundwater Level (ft)	7.17	7.51	7.08
				Groundwater Elevation (Ft MSL)	552.25	551.91	552.34
				Measured Well Depth (ft)			
				Submerged screen	Y	Y	Y
MW-3	559.17	512.69	46.41	Groundwater Level (ft)	9.18	9.44	9.30
				Groundwater Elevation (Ft MSL)	549.99	549.73	549.87
				Measured Well Depth (ft)			
				Submerged screen	Y	Y	Y
MW-4	556.93	557.78	10.3	Groundwater Level (ft)	9.70	9.60	9.42
				Groundwater Elevation (Ft MSL)	547.23	547.33	547.51
				Measured Well Depth (ft)			
				Submerged screen	N	N	Y
MW-5	555.54	527.24	28.3	Groundwater Level (ft)	5.88	6.80	6.52
				Groundwater Elevation (Ft MSL)	549.66	548.74	549.02
				Measured Well Depth (ft)			
				Submerged screen	Y	Y	Y
MW-6	555.89	541.11	14.82	Groundwater Level (ft)	7.20	7.99	7.68
				Groundwater Elevation (Ft MSL)	548.69	547.9	548.21
				Measured Well Depth (ft)			
				Submerged screen	Y	Y	Y
MW-7	555.55	548.78	17.99	Groundwater Level (ft)	3.45	3.03	3.37
				Groundwater Elevation (Ft MSL)	552.10	552.52	552.18
				Measured Well Depth (ft)			
				Submerged screen	Y	Y	Y
MW-9	629.13	513.59	118.67	Groundwater Level (ft)	33.21	32.83	32.20
				Groundwater Elevation (Ft MSL)	595.92	596.30	596.93
				Measured Well Depth (ft)			
				Submerged screen	Y	Y	Y
MW-10	629.39	597.45	32.25	Groundwater Level (ft)	23.58	23.21	22.21
				Groundwater Elevation (Ft MSL)	605.81	606.18	607.18
				Measured Well Depth (ft)			
				Submerged screen	Y	Y	Y
MW-11	587.99	586.22	20.44	Groundwater Level (ft)	6.81	7.36	6.71
				Groundwater Elevation (Ft MSL)	581.18	580.63	581.28
				Measured Well Depth (ft)			
				Submerged screen	N	N	N
MW-15	558.66	539.50	29.16	Groundwater Level (ft)	12.46	12.55	12.40
				Groundwater Elevation (Ft MSL)	546.20	546.11	546.26
				Measured Well Depth (ft)			
				Submerged screen	Y	Y	Y
MW-17	557.32	541.97	20.35	Groundwater Level (ft)	11.98	12.22	12.24
				Groundwater Elevation (Ft MSL)	545.34	545.1	545.08
				Measured Well Depth (ft)			
				Submerged screen	Y	Y	Y
MW-20	558.92	524.52	44.4	Groundwater Level (ft)	5.70	5.92	5.50
				Groundwater Elevation (Ft MSL)	553.22	553.00	553.42
				Measured Well Depth (ft)			
				Submerged screen	Y	Y	Y



**Table 5**  
**Background Summary**  
**2024 Annual Water Quality Report**  
**CIPCO Fair Station CCR Monofill**  
**Permit No. 70-SDP-09-91C**

**Interwell Background/Control Limit (MW-11 Water Table)**

Constituent	Units	Samples	Detections	Background level	Statistical Test	Action Level	Source
<b>Inorganics</b>							
Arsenic (As)	mg/L	11	0	0.0016	M+/-2SD	0.01	MCL
Boron (Bo)	mg/L	11	0	0.132	M+/-2SD	6	HA
Chloride (Cl)	mg/L	43	39	12.6	M+/-2SD	250	SDWR
Cobalt (Co)	mg/L	11	5	0.001295	M+/-2SD	0.0028	SWS
Iron (Fe)	mg/L	11	10	0.95	M+/-2SD	0.3	SDWR
Lithium (Li)	mg/L	11	1	0.0076	M+/-2SD	0.014	SWS
Magnesium (Mg)	mg/L	11	11	54.3	M+/-2SD	NA	
Manganese (Mn)	mg/L	11	11	0.463	M+/-2SD	0.3, 0.05	HA, SDWR
Molybdenum (Mo)	mg/L	11	0	0.001	M+/-2SD	0.04	HA
Sodium (Na)	mg/L	11	11	14.7	M+/-2SD	NA	
Strontium (St)	mg/L	11	11	0.153	M+/-2SD	4	HA
Sulfate (SO4)	mg/L	30	29	136	M+/-2SD	250	SDWR

**Interwell Background/Control Limit (MW-9 Uppermost Aquifer)**

Constituent	Units	Samples	Detections	Background level	Statistical Test	Action Level	Source
<b>Inorganics</b>							
Arsenic (As)	mg/L	11	0	0.0016	M+/-2SD	0.01	MCL
Boron (Bo)	mg/L	11	8	0.372	M+/-2SD	6	HA
Chloride (Cl)	mg/L	41	8	5.9	M+/-2SD	250	SDWR
Cobalt (Co)	mg/L	11	3	0.001768	M+/-2SD	0.0028	SWS
Iron (Fe)	mg/L	11	2	0.65	M+/-2SD	0.3	SDWR
Lithium (Li)	mg/L	11	11	0.0494	M+/-2SD	0.014	SWS
Magnesium (Mg)	mg/L	11	11	35.5	M+/-2SD	NA	
Manganese (Mn)	mg/L	11	7	0.751	M+/-2SD	0.3, 0.05	HA, SDWR
Molybdenum (Mo)	mg/L	11	0	0.001	M+/-2SD	0.04	HA
Sodium (Na)	mg/L	11	11	13.3	M+/-2SD	NA	
Strontium (St)	mg/L	11	11	0.733	M+/-2SD	4	HA
Sulfate (SO4)	mg/L	30	28	36.2	M+/-2SD	250	SDWR

Table 6

**Summary of Well/Detected Constituent Pairs With No Immediately Preceding Control  
Limit Exceedances  
2024 Annual Water Quality Report  
CIPCO Fair Station CCR Monofill  
Permit No. 70-SDP-09-91C**

<b>Well</b>	<b>Constituent</b>	<b>Units</b>	<b>Most recent result</b>	<b>Control Limit</b>
MW-3	Cobalt	mg/L	0.00483	0.0028 (SWS)

## Notes:

For this table, control limit identified as published standards.

Table 7

**Summary of Ongoing and Newly Identified Control Limit Exceedances  
2024 Annual Water Quality Report  
CIPCO Fair Station CCR Monofill  
Permit No. 70-SDP-09-91C**

Well	Constituent	Units	Most recent result	Background/Baseline Standard	Action Level/ Statewide Standard
MW-1	Boron	mg/L	0.291	0.284	6
	Chloride	mg/L	7.30	6.6	250
	Cobalt	mg/L	0.00121	0.000946	0.0028
	Iron	mg/L	1.92	1.69	0.3
	Lithium	mg/L	0.0643	0.0667	0.014
	Manganese	mg/L	0.299	0.296	0.3/0.05
	Strontium	mg/L	0.790	0.748	4
	Sulfate	mg/L	244	370	250
MW-2	Boron	mg/L	6.11	7.36	6
	Cobalt	mg/L	0.0005U	0.000315	0.0028
	Lithium	mg/L	0.0333	0.0516	0.014
	Magnesium	mg/L	27.5	30.1	NA
	Manganese	mg/L	0.0923	0.05661	0.3/0.05
	Strontium	mg/L	0.313	0.323	4
	Sulfate	mg/L	177	703	250
	MW-3	Iron	mg/L	1.673	1.05
Lithium		mg/L	0.0348	0.0391	0.014
Manganese		mg/L	1.71	1.599	0.3/0.05
Sodium		mg/L	21.2	33.4	NA
Strontium		mg/L	0.880	0.772	4
MW-5	Boron	mg/L	6.56	5.63	6
	Chloride	mg/L	18.8	13.7	250
	Cobalt	mg/L	0.00192	0.003063	0.0028
	Iron	mg/L	0.738	1.09	0.3
	Lithium	mg/L	0.0195	0.0264	0.014
	Manganese	mg/L	0.247	0.592	0.3/0.05
	Strontium	mg/L	0.368	0.318	4
	MW-6	Boron	mg/L	7.67	6.31
Chloride		mg/L	18.6	13.2	250
Cobalt		mg/L	0.00344	0.00481	0.0028
Iron		mg/L	0.977	0.981	0.3
Lithium		mg/L	0.01U	0.0055	0.014
Manganese		mg/L	5.16	8.29	0.3/0.05
Molybdenum		mg/L	0.0448	0.0679	0.04
MW-9		Boron	mg/L	0.291	0.159
	Lithium	mg/L	0.0643	0.045	0.014
	Magnesium	mg/L	72.5	30.9	NA
	Sodium	mg/L	12.5	9.2	NA
	MW-11	Chloride	mg/L	12.4	8.6
Magnesium		mg/L	45.7	48	NA
Manganese		mg/L	0.244	0.302	0.3/0.05
Sodium		mg/L	12.8	12.0	NA
Strontium		mg/L	0.132	0.134	4

Table 7

**Summary of Ongoing and Newly Identified Control Limit Exceedances  
2024 Annual Water Quality Report  
CIPCO Fair Station CCR Monofill  
Permit No. 70-SDP-09-91C**

Well	Constituent	Units	Most recent result	Background/Baseline Standard	Action Level/ Statewide Standard
MW-15	Boron	mg/L	39.3	28.9	6
	Chloride	mg/L	20.4	16.9	250
	Lithium	mg/L	0.154	0.156	0.014
	Magnesium	mg/L	126	105	NA
	Manganese	mg/L	0.0741	0.510	0.3/0.05
	Molybdenum	mg/L	0.259	0.0746	0.04
	Sodium	mg/L	87.2	85.7	NA
	Strontium	mg/L	0.717	0.629	4
	Sulfate	mg/L	1260	783	250
MW-17	Boron	mg/L	33.2	16	6
	Chloride	mg/L	19.0	17.4	250
	Iron	mg/L	1.43	2.58	0.3
	Lithium	mg/L	0.293	0.278	0.014
	Magnesium	mg/L	214	180	NA
	Manganese	mg/L	0.257	0.265	0.3/0.05
	Molybdenum	mg/L	0.0770	0.1489	0.04
	Sodium	mg/L	82.4	58.2	NA
	Strontium	mg/L	0.580	0.400	4
Sulfate	mg/L	1190	869	250	
MW-20	Boron	mg/L	1.47	1.3	6
	Lithium	mg/L	0.0219	0.0241	0.014
	Sodium	mg/L	84.0	77.5	NA
	Strontium	mg/L	0.616	0.578	4

Note: Non detect results are denoted by U and shown as the reporting limit. Table 8 shows 1/2 the Reporting Limit.

Table 8

Analytical Data Summary  
 2024 Annual Water Quality Report  
 CIPCO Fair Station CCR Monofill  
 Permit No. 70-SDP-09-91C

TOTAL ARSENIC (unfiltered) (mg/L) MCL = 0.01

Date	Reporting Limit	Water Table			Uppermost Aquifer						
		Upgradient	Downgradient		Upgradient	Downgradient					
		MW-11	MW-2	MW-6	MW-9	MW-1	MW-3	MW-5	MW-15	MW-17	MW-20
Oct-16	0.00200	0.00100U	0.00100U	0.00460	0.00100U	0.00305	0.00100U	0.00100U	0.00684	0.00335	0.00100U
Aug-17	0.00200	0.00100U	0.00100U	0.00246	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U
Oct-17	0.00200	0.00100U	0.00100U	0.00100U	0.00100U	0.00057	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U
Apr-18	0.00200	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U
Oct-18	0.00200	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U
Oct-19	0.00200	0.00100U	0.00100U	0.00278	0.00100U	0.00100U	0.00100U	0.00100U	0.00219	0.00100U	0.00100U
Oct-20	0.00200	0.00100U	0.00100U	0.00239	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U
Oct-21	0.00200	0.00100U	0.00100U	0.00272	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U
Oct-22	0.00200	0.00100U	0.00400U	0.00400U	0.00100U	0.00100U	0.00100U	0.00100U	0.00400U	0.00400U	0.00100U
Oct-23	0.00200	0.00100U	0.00100U	0.00222	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U
Oct-24	0.00200	0.00100U	0.00100U	0.00207	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U	0.00100U
<b>HISTORIC AVERAGE</b>		0.0010	0.0013	0.0024	0.0010	0.0011	0.0010	0.0010	0.0019	0.0015	0.0010
<b>BASELINE AVERAGE</b>		0.0010	0.0010	0.0023	0.0010	0.0014	0.0010	0.0010	0.0025	0.0016	0.0010
<b>UCL</b>		0.0016			0.0016						

Table 8

Analytical Data Summary  
 2024 Annual Water Quality Report  
 CIPCO Fair Station CCR Monofill  
 Permit No. 70-SDP-09-91C

TOTAL BORON (unfiltered) (mg/L) HA=6

Date	Reporting Limit	Water Table			Uppermost Aquifer						
		Upgradient	Downgradient		Upgradient	Downgradient					
		MW-11	MW-2	MW-6	MW-9	MW-1	MW-3	MW-5	MW-15	MW-17	MW-20
Oct-16	0.200	0.100U	7.94	6.94	0.100U	0.263	3.39	5.76	31.2	15.2	1.29
Aug-17	0.200	0.100U	6.48	6.75	0.217	0.260	2.52	5.28	24.9	15.6	1.27
Oct-17	0.200	0.100U	7.71	7.07	0.219	0.321	2.40	6.31	28.4	17.9	1.39
Apr-18	0.200	0.100U	7.31	4.48	0.100U	0.291	2.76	5.16	31.0	15.3	1.23
Oct-18	0.200	0.100U	8.53	6.89	0.364	0.452	3.10	6.23	35.9	16.4	1.61
Oct-19	0.200	0.100U	9.35	7.60	0.100U	0.345	2.82	6.06	44.5	17.4	1.37
Oct-20	0.200	0.100U	7.21	6.76	0.282	0.332	3.80	6.77	44.0	25.4	1.51
Oct-21	0.200	0.100U	7.91	6.15	0.208	0.299	2.21	5.60	29.6	26.7	1.71
Oct-22	0.200	0.050U	8.47	7.51	0.219	0.281	2.34	6.32	36.8	25.9	1.37
Oct-23	0.200	0.050U	7.56	8.06	0.216	0.300	1.43	6.23	37.5	19.7	1.45
Oct-24	0.100	0.050U	6.11	7.67	0.336	0.291	1.52	6.56	39.3	33.2	1.47
<b>HISTORIC AVERAGE</b>		0.086	7.7	6.9	0.215	0.312	2.57	6.03	34.8	20.8	1.42
<b>BASELINE AVERAGE</b>		0.100	7.36	6.31	0.159	0.284	2.77	5.63	28.9	16.0	1.30
<b>UCL</b>		0.133			0.395						

Table 8

Analytical Data Summary  
 2024 Annual Water Quality Report  
 CIPCO Fair Station CCR Monofill  
 Permit No. 70-SDP-09-91C

CHLORIDE (mg/L) SDWR = 250

Date	Reporting Limit	Water Table			Uppermost Aquifer						
		Upgradient	Downgradient		Upgradient	Downgradient					
		MW-11	MW-2	MW-6	MW-9	MW-1	MW-3	MW-5	MW-15	MW-17	MW-20
Aug-95	5	6	17		2.5U	2.5U	2.5U				18
Nov-95	5	6.7	24		2.5U	2.5U	2.5U				17
Feb-96	5	8.3	26			2.5U	2.5U				18
Jun-96	5	6.1	24		2.5U	2.5U	2.5U				15
Sep-96	5	9.2	19			2.5U	6.3				20
Apr-97	5	7.6	20		2.5U	2.5U	5.7				17
Oct-97	5	7.8	19		5.6	2.5U	2.5U				18
Apr-98	5	11	31		2.5U	6.4	9.8				18
Oct-98	5	7.2	24		2.5U	2.5U	5.6				
Apr-99	10	5U	18		5U	5U	5U				16
Oct-99	10	5U	18		5U	5U	5U				17
Apr-00	10	5U	15		5U	5U	5U				11
Dec-00	5	7.4	19.4		2.5U	2.5U	5				16.9
May-01	5.0	8.9	20.4		2.5U	5.5	10.2				15.5
Jul-01	5.0	9.9	14.7		2.5U	8.6	7.1				16.9
Oct-01	5.0	7.6	16.2		2.5U	6.3	6.9				17.9
Jan-02	5.0	8.0	18.3		2.5U	6.0	5.2				17.3
Oct-02	5.0	10.3	16.2		2.5U	7.2	2.5U				19.0
Oct-03	5	12.6	18.1		5.6	6.7	2.5U				19.5
Oct-04	5.0	6.8	14.3		2.5U	9.0	2.5U				20.2
Oct-05	5.0	7	2.5U	14.2	2.5U	12.7	16.5	13.0			21.1
Jan-06	5.0			15.4				15			
Apr-06	5.0			11.3				13.2			
Jul-06	5.0			11.9				13.5			
Oct-06	5.0	7.43	18.3	14.0	5.2	12.4	2.5U	13.4			23.1
Oct-07	5.0	6.65	17.5	9.91	2.5U	13.9	2.5U	11.9			21.6
Oct-08	5.0	6.36	15	10.5	2.5U	33.8	2.5U	11.3			21.5

Table 8

Analytical Data Summary  
 2024 Annual Water Quality Report  
 CIPCO Fair Station CCR Monofill  
 Permit No. 70-SDP-09-91C

CHLORIDE (mg/L) SDWR = 250

Date	Reporting Limit	Water Table			Uppermost Aquifer						
		Upgradient	Downgradient		Upgradient	Downgradient					
		MW-11	MW-2	MW-6	MW-9	MW-1	MW-3	MW-5	MW-15	MW-17	MW-20
Oct-09	5.0	6.49	14.2	13.0	7.0	28.1	2.5U	12.2	21.9		
Oct-10	5.0	5.63	12.6	13.0	2.5U	17.3	2.5U	11.8	19.6		
Oct-11	5.0	7.56	21.3	20.6	2.5U	16.7	2.5U	15.4	21.7		
Oct-12	5.0	6.32	19.9	21.9	2.5U	14.4	2.5U	15.1	19.9		
Dec-12	5.0	9.3	25.2	22.6	2.5U	16.4	2.5U	19.2	23.8	16.1	
Oct-13	5.0	7.06	15.3	19.2	2.5U	13.6	2.5U	18.1	20.4	18.3	9.14
Jan-14	5.0									17.9	
Apr-14	5.0									16.9	5.41
Jul-14	5.0									16.6	
Oct-14	5.0										5.96
Oct-14	5.0	13.7	16.5	20.5	5.00	13.7	2.5U	20.4	23.4	19.1	7.29
Oct-15	5.0	11.2	13.4	26.8	6.00	12.7	8.96	22.8	21.6	20.2	11.5
Oct-16	5.0	9.23	36.6	15.9	5.59	12.6	2.5U	18.4	21.1	18.2	5.65
Aug-17	5.0	10.4	15.3	15.8	2.5U	10.5	2.5U	19.3	20.2	19.3	6.11
Oct-17	5.0	10.4	13.7	16.7	2.5U	13.1	2.5U	18.6	20.3	19.4	5.06
Apr-18	5.0	10.4	14.4	18.3	2.5U	11.1	5.26	18.2	19.2	19.3	6.21
Oct-18	5.0	10.2	12.3	15.9	2.5U	9.2	2.5U	17.3	19.4	18.0	2.5U
Oct-19	5.0	7.5	10.7	13.2	2.5U	7.8	2.5U	15.9	16.7	17.1	2.5U
Oct-20	5.0	2.5U	9.3	2.5U	2.5U	5.8	2.5U	2.5U	15.2	15.6	2.5U
Oct-21	5.0	9.61	9.6	15.8	2.5U	6.91	2.5U	15.5	16.6	18.2	5.36
Oct-22	5.0	9.71	8.92	13.2	2.5U	7.21	2.5U	13.8	15.2	21.0	2.5U
Oct-23	5.00	10.3	9.67	15.7	2.5U	6.30	2.5U	15.9	18.3	16.9	2.5U
Oct-24	2.00	12.4	9.96	18.6	3.45	7.30	2.36	18.8	20.4	19.0	3.71
<b>HISTORIC AVERAGE</b>		8.2	17.1	15.6	3.3	9.2	4.1	15.4	18.8	18.2	5.24
<b>BASELINE AVERAGE</b>		8.6	17.4	13.2	2.5	6.6	7.4	13.7	16.9	17.4	5.8
<b>UCL</b>		12.9			5.9						



Table 8

Analytical Data Summary  
 2024 Annual Water Quality Report  
 CIPCO Fair Station CCR Monofill  
 Permit No. 70-SDP-09-91C

TOTAL COBALT (unfiltered) (mg/L) Statwide Standard = 0.0028 mg/L

Date	Reporting Limit	Water Table			Uppermost Aquifer						
		Upgradient	Downgradient		Upgradient	Downgradient					
		MW-11	MW-2	MW-6	MW-9	MW-1	MW-3	MW-5	MW-15	MW-17	MW-20
Oct-16	0.000500	0.00135	0.000508	0.00523	0.000250U	0.000871	0.00464	0.00259	0.00277	0.000250U	0.000516
Aug-17	0.000500	0.000558	0.000250U	0.00500	0.000250U	0.00104	0.00772	0.00269	0.00135	0.000250U	0.00112
Oct-17	0.000500	0.00031	0.000250U	0.00522	0.00056	0.00100	0.00262	0.00423	0.00061	0.000250U	0.000490
Apr-18	0.000500	0.00106	0.000250U	0.00379	0.00229	0.000874	0.00200	0.00274	0.00182	0.000250U	0.000250U
Oct-18	0.000500	0.000250U	0.000250U	0.00324	0.000250U	0.001020	0.00089	0.00158	0.00169	0.000250U	0.000250U
Oct-19	0.000500	0.000250U	0.000250U	0.00405	0.000250U	0.001280	0.00132	0.00081	0.00218	0.000250U	0.00054
Oct-20	0.000500	0.000560	0.000250U	0.00500	0.000250U	0.001200	0.000659	0.00203	0.000810	0.000250U	0.000250U
Oct-21	0.000500	0.000250U	0.000638	0.00559	0.000250U	0.00233	0.000648	0.000840	0.000250U	0.000250U	0.000250U
Oct-22	0.000500	0.000250U	0.00100U	0.00363	0.000250U	0.000723	0.00129	0.00354	0.00100U	0.00100U	0.000250U
Oct-23	0.000500	0.000250U	0.000250U	0.00302	0.000250U	0.00149	0.00162	0.00282	0.000780	0.000250U	0.000250U
Oct-24	0.000500	0.000250U	0.000250U	0.00344	0.00108	0.00121	0.00483	0.00192	0.000250U	0.000250U	0.000250U
<b>HISTORIC AVERAGE</b>		0.000486	0.000377	0.004292	0.000539	0.001185	0.002567	0.002345	0.001228	0.000318	0.000401
<b>BASELINE AVERAGE</b>		0.000820	0.000315	0.004810	0.000838	0.000946	0.004245	0.003063	0.001638	0.000250	0.000594
<b>UCL</b>		0.001247			0.001808						

Table 8

Analytical Data Summary  
 2024 Annual Water Quality Report  
 CIPCO Fair Station CCR Monofill  
 Permit No. 70-SDP-09-91C

TOTAL IRON (unfiltered) (mg/L) SDWR = 0.3

Date	Reporting Limit	Water Table			Uppermost Aquifer						
		Upgradient	Downgradient		Upgradient	Downgradient					
		MW-11	MW-2	MW-6	MW-9	MW-1	MW-3	MW-5	MW-15	MW-17	MW-20
Oct-16	0.100	1.03	0.223	1.16	0.050U	1.82	1.10	1.02	0.507	2.93	0.050U
Aug-17	0.100	0.476	0.207	1.09	0.050U	1.39	1.78	1.52	0.322	3.16	1.13
Oct-17	0.100	0.247	0.5U	0.872	0.798	1.74	0.398	1.16	0.5U	2.68	0.213
Apr-18	0.100	0.471	0.184	0.802	0.354	1.79	0.938	0.668	0.399	1.53	0.050U
Oct-18	0.100	0.374	0.050U	0.396	0.050U	1.41	0.249	0.210	0.129	2.50	0.117
Oct-19	0.100	0.181	0.200U	0.893	0.050U	1.80	0.125	0.200U	0.050U	3.34	0.050U
Oct-20	0.100	0.595	0.050U	0.900	0.050U	1.58	0.050U	0.176	0.050U	2.46	0.137
Oct-21	0.100	0.111	0.050U	1.80	0.050U	2.13	0.050U	0.400	0.050U	2.66	0.050U
Oct-22	0.100	0.050U	0.200U	0.739	0.050U	1.50	0.258	0.611	0.200U	2.00	0.133
Oct-23	0.100	0.255	0.050U	0.794	0.050U	3.64	0.309	0.770	0.050U	1.34	0.128
Oct-24	0.100	0.260	0.0500U	0.977	0.050U	1.92	1.673	0.738	0.123	1.43	0.162
<b>HISTORIC AVERAGE</b>		0.368	0.160	0.948	0.146	1.88	0.630	0.679	0.216	2.37	0.202
<b>BASELINE AVERAGE</b>		0.556	0.279	0.981	0.313	1.69	1.05	1.09	0.432	2.58	0.361
<b>UCL</b>		0.92			0.62						

Table 8

Analytical Data Summary  
 2024 Annual Water Quality Report  
 CIPCO Fair Station CCR Monofill  
 Permit No. 70-SDP-09-91C

TOTAL LITHIUM (unfiltered) (mg/L) Statewide Standard = 0.014 mg/L

Date	Reporting Limit	Water Table			Uppermost Aquifer						
		Upgradient	Downgradient		Upgradient	Downgradient					
		MW-11	MW-2	MW-6	MW-9	MW-1	MW-3	MW-5	MW-15	MW-17	MW-20
Oct-16	0.0140	0.0070U	0.0571	0.0070U	0.0435	0.0663	0.0434	0.0257	0.163	0.270	0.0214
Aug-17	0.0100	0.0050U	0.0515	0.0050U	0.0433	0.0643	0.0361	0.0242	0.157	0.275	0.0186
Oct-17	0.0100	0.0080	0.0627	0.0050U	0.0500	0.0684	0.0416	0.0318	0.165	0.314	0.0289
Apr-18	0.0100	0.0050U	0.0351	0.0050U	0.0433	0.0677	0.0354	0.0237	0.138	0.254	0.0274
Oct-18	0.0100	0.0050U	0.0411	0.0050U	0.0448	0.0591	0.0309	0.0205	0.149	0.265	0.0207
Oct-19	0.0100	0.0050U	0.0444	0.0050U	0.0417	0.0708	0.0339	0.0258	0.204	0.302	0.0216
Oct-20	0.0100	0.0050U	0.0383	0.0050U	0.0457	0.0667	0.0361	0.0245	0.162	0.317	0.0241
Oct-21	0.0100	0.0050U	0.0406	0.0140	0.0404	0.0656	0.0410	0.0237	0.135	0.318	0.0210
Oct-22	0.0100	0.0050U	0.0200U	0.0200U	0.0405	0.0573	0.0392	0.0182	0.156	0.295	0.0190
Oct-23	0.0100	0.0050U	0.0373	0.0050U	0.0448	0.0630	0.0393	0.0197	0.166	0.289	0.0222
Oct-24	0.0100	0.0050U	0.0333	0.0050U	0.0445	0.0643	0.0348	0.0195	0.154	0.293	0.0219
<b>HISTORIC AVERAGE</b>		0.0055	0.0419	0.0074	0.0439	0.0649	0.0374	0.023	0.159	0.290	0.0224
<b>BASELINE AVERAGE</b>		0.0062	0.0516	0.0055	0.0450	0.0667	0.0391	0.0264	0.156	0.278	0.0241
<b>UCL</b>		0.0075			0.0492						

Table 8

Analytical Data Summary  
 2024 Annual Water Quality Report  
 CIPCO Fair Station CCR Monofill  
 Permit No. 70-SDP-09-91C

TOTAL MAGNESIUM (unfiltered) (mg/L) No Standard Established, Use 2-Year Average

Date	Reporting Limit	Water Table			Uppermost Aquifer						
		Upgradient	Downgradient		Upgradient	Downgradient					
		MW-11	MW-2	MW-6	MW-9	MW-1	MW-3	MW-5	MW-15	MW-17	MW-20
Oct-16	0.500	48.2	30.6	44.1	31.1	84.8	23.4	38.6	103	177	18.3
Aug-17	0.050	48.1	29.2	45.4	30.8	77.9	21.4	39.2	105	171	18.0
Oct-17	0.050	53.3	35.3	45.0	32.5	78.5	23.0	44.2	113	207	19.6
Apr-18	0.0500	42.3	25.2	31.5	29.3	83.6	23.8	43.2	98.2	166	18.1
Oct-18	0.0500	50.0	27.3	38.2	30.4	73.2	25.1	35.0	121	169	16.7
Oct-19	0.0500	45.9	33.8	37.4	34.0	75.5	22.5	36.5	103	192	17.4
Oct-20	0.0500	48.9	37.0	39.6	35.1	77.0	27.3	42.0	117	230	19.5
Oct-21	0.0500	49.1	36.6	33.6	30.4	74.1	20.3	35.9	108	182	17.0
Oct-22	0.0500	47.1	30.5	33.2	28.9	69.7	19.6	33.8	117	179	15.7
Oct-23	0.0500	50.8	32.2	35.3	32.4	72.7	19.4	38.3	116	157	16.6
Oct-24	0.500	45.7	27.5	30.8	30.5	72.5	18.5	34.1	126	214	15.3
<b>2-YEAR AVERAGE</b>		49.0	31.4	34.3	30.7	71.2	19.5	36.1	116.5	168.0	16.2
<b>HISTORIC AVERAGE</b>		48.1	31.4	37.6	31.4	76.3	22.2	38.3	112	186	17.5
<b>BASELINE AVERAGE</b>		48.0	30.1	41.5	30.9	81.2	22.9	41.3	105	180	18.5
<b>UCL</b>		54.0			35.2						

Table 8

Analytical Data Summary  
 2024 Annual Water Quality Report  
 CIPCO Fair Station CCR Monofill  
 Permit No. 70-SDP-09-91C

TOTAL MANGANESE (unfiltered) (mg/L) HA=0.3, SDWR=0.05

Date	Reporting Limit	Water Table			Uppermost Aquifer						
		Upgradient	Downgradient		Upgradient	Downgradient					
		MW-11	MW-2	MW-6	MW-9	MW-1	MW-3	MW-5	MW-15	MW-17	MW-20
Oct-16	0.0200	0.380	0.102	8.92	0.0419	0.276	2.64	0.502	0.783	0.266	0.132
Aug-17	0.0100	0.214	0.0496	8.48	0.0477	0.271	2.74	0.521	0.476	0.244	0.123
Oct-17	0.0100	0.170	0.0397	8.71	0.505	0.306	0.463	0.776	0.205	0.293	0.102
Apr-18	0.0100	0.442	0.0330	7.05	0.882	0.331	0.553	0.568	0.575	0.255	0.0298
Oct-18	0.0100	0.102	0.0271	6.20	0.0274	0.325	0.165	0.334	0.609	0.212	0.0815
Oct-19	0.0100	0.238	0.0563	8.55	0.044	0.313	0.194	0.167	0.779	0.284	0.0759
Oct-20	0.0100	0.292	0.0525	7.73	0.0050U	0.363	0.474	0.410	0.364	0.336	0.0669
Oct-21	0.0100	0.160	0.0552	3.63	0.0477	0.466	0.339	0.147	0.0292	0.248	0.0360
Oct-22	0.0100	0.0615	0.0440	6.61	0.0050U	0.251	0.159	1.54	0.167	0.262	0.0279
Oct-23	0.0100	0.126	0.0670	5.17	0.0050U	0.399	0.708	0.598	0.253	0.354	0.0427
Oct-24	0.0100	0.244	0.0923	5.16	0.0050U	0.299	1.71	0.247	0.0741	0.257	0.0267
<b>HISTORIC AVERAGE</b>		0.221	0.056	6.93	0.147	0.327	0.922	0.528	0.392	0.274	0.068
<b>BASELINE AVERAGE</b>		0.302	0.0561	8.29	0.369	0.296	1.599	0.592	0.510	0.265	0.097
<b>UCL</b>		0.453			0.714						

Table 8

Analytical Data Summary  
 2024 Annual Water Quality Report  
 CIPCO Fair Station CCR Monofill  
 Permit No. 70-SDP-09-91C

TOTAL MOLYBDENUM (unfiltered) (mg/L) HA=0.04

Date	Reporting Limit	Water Table			Uppermost Aquifer						
		Upgradient	Downgradient		Upgradient	Downgradient					
		MW-11	MW-2	MW-6	MW-9	MW-1	MW-3	MW-5	MW-15	MW-17	MW-20
Oct-16	0.00200	0.00100U	0.00100U	0.0509	0.00100U	0.00100U	0.00100U	0.00100U	0.0907	0.198	0.00100U
Aug-17	0.00200	0.00100U	0.00100U	0.0750	0.00100U	0.00100U	0.00100U	0.00100U	0.0511	0.119	0.00100U
Oct-17	0.00200	0.00100U	0.00100U	0.0783	0.00100U	0.00100U	0.00100U	0.00100U	0.0806	0.0995	0.00100U
Apr-18	0.00200	0.00100U	0.00100U	0.0674	0.00100U	0.00100U	0.00100U	0.00100U	0.0758	0.1790	0.00100U
Oct-18	0.00200	0.00100U	0.00100U	0.0524	0.00100U	0.00100U	0.00100U	0.00100U	0.0639	0.166	0.00100U
Oct-19	0.00200	0.00100U	0.00100U	0.0933	0.00100U	0.00100U	0.00100U	0.00100U	0.4830	0.178	0.00242
Oct-20	0.00200	0.00100U	0.00100U	0.0626	0.00100U	0.00100U	0.00100U	0.00100U	0.0924	0.254	0.00240
Oct-21	0.00200	0.00100U	0.00100U	0.0220	0.00100U	0.00100U	0.00100U	0.00100U	0.104	0.301	0.00100U
Oct-22	0.00200	0.00100U	0.00400U	0.0667	0.00100U	0.00100U	0.00100U	0.00100U	0.179	0.127	0.00100U
Oct-23	0.00200	0.00100U	0.00100U	0.0477	0.00100U	0.00100U	0.00100U	0.00100U	0.215	0.0972	0.00100U
Oct-24	0.00200	0.00100U	0.00100U	0.0448	0.00100U	0.00100U	0.00100U	0.00100U	0.259	0.0770	0.00100U
<b>HISTORIC AVERAGE</b>		0.0010	0.0013	0.0601	0.0010	0.0010	0.0010	0.0010	0.1540	0.1632	0.0013
<b>BASELINE AVERAGE</b>		0.001	0.001	0.0679	0.0010	0.0010	0.0010	0.0010	0.0746	0.1489	0.0010
<b>UCL</b>		0.001			0.001						

Table 8

Analytical Data Summary  
 2024 Annual Water Quality Report  
 CIPCO Fair Station CCR Monofill  
 Permit No. 70-SDP-09-91C

TOTAL SODIUM (unfiltered) (mg/L) No Standard Established, Use 2-Year Average

Date	Reporting Limit	Water Table			Uppermost Aquifer						
		Upgradient	Downgradient		Upgradient	Downgradient					
		MW-11	MW-2	MW-6	MW-9	MW-1	MW-3	MW-5	MW-15	MW-17	MW-20
Oct-16	0.500	12.4	26.9	21.8	12.0	12.3	32.4	21.1	101	56.8	80.3
Aug-17	1.000	12.0	23.3	20.8	9.7	13.3	25.1	19.4	84.2	60.1	79.1
Oct-17	1.000	11.1	22.6	19.7	8.18	13.2	38.7	19.6	77.4	62.5	77.7
Apr-18	1.00	12.5	24.9	14.7	6.96	11.2	37.4	19.7	80	53.4	72.9
Oct-18	1.00	14.3	22.7	18.0	7.90	12.2	40.7	20.1	100	61.0	89.3
Oct-19	1.00	12.5	19.3	17.7	9.87	10.1	32.9	18.9	99.1	68.5	78.2
Oct-20	1.00	12.9	20.0	18.7	9.84	10.8	25.9	20.8	95.1	76.5	92.0
Oct-21	1.00	13.0	18.8	18.0	9.85	10.3	26.4	18.6	76.1	81.5	82.7
Oct-22	1.00	13.0	18.2	17.0	11.0	10.4	45.9	18.3	91.7	81.3	82.9
Oct-23	1.00	14.2	17.9	18.3	12.5	11.8	24.7	19.7	98.9	75.2	91.0
Oct-24	1.00	12.8	15.4	16.9	12.5	11.4	21.2	18.3	87.2	82.4	84.0
<b>2-YEAR AVERAGE</b>		13.6	18.1	17.7	11.8	11.1	35.3	19.0	95.3	78.3	87.0
<b>HISTORIC AVERAGE</b>		12.8	20.9	18.3	10.0	11.5	31.9	19.5	90.1	69.0	82.7
<b>BASELINE AVERAGE</b>		12.0	24.4	19.3	9.2	12.5	33.4	20.0	85.7	58.2	77.5
<b>UCL</b>		14.6			13.7						

Table 8

Analytical Data Summary  
 2024 Annual Water Quality Report  
 CIPCO Fair Station CCR Monofill  
 Permit No. 70-SDP-09-91C

TOTAL STRONTIUM (unfiltered) (mg/L) HA=4

Date	Reporting Limit	Water Table			Uppermost Aquifer						
		Upgradient	Downgradient		Upgradient	Downgradient					
		MW-11	MW-2	MW-6	MW-9	MW-1	MW-3	MW-5	MW-15	MW-17	MW-20
Oct-16	0.00100	0.127	0.327	0.413	0.574	0.719	0.781	0.287	0.620	0.379	0.534
Aug-17	0.00100	0.138	0.338	0.424	0.653	0.711	0.743	0.310	0.645	0.405	0.592
Oct-17	0.00100	0.142	0.363	0.365	0.649	0.691	0.734	0.318	0.583	0.397	0.557
Apr-18	0.00100	0.128	0.263	0.288	0.741	0.871	0.828	0.357	0.668	0.420	0.628
Oct-18	0.00100	0.134	0.290	0.330	0.648	0.656	0.585	0.273	0.543	0.342	0.517
Oct-19	0.00100	0.138	0.357	0.358	0.668	0.757	0.676	0.320	0.766	0.430	0.565
Oct-20	0.00100	0.137	0.358	0.328	0.612	0.761	0.730	0.320	0.778	0.494	0.591
Oct-21	0.00100	0.151	0.397	0.263	0.586	0.780	0.899	0.373	0.651	0.506	0.584
Oct-22	0.00100	0.138	0.319	0.278	0.626	0.711	0.741	0.335	0.652	0.441	0.567
Oct-23	0.00100	0.146	0.330	0.273	0.594	0.646	0.840	0.315	0.645	0.424	0.544
Oct-24	0.00100	0.132	0.313	0.249	0.706	0.790	0.880	0.368	0.717	0.580	0.616
<b>HISTORIC AVERAGE</b>		0.137	0.332	0.324	0.642	0.736	0.767	0.325	0.661	0.438	0.572
<b>BASELINE AVERAGE</b>		0.134	0.323	0.373	0.654	0.748	0.772	0.318	0.629	0.400	0.578
<b>UCL</b>		0.152			0.744						



Table 8

Analytical Data Summary  
 2024 Annual Water Quality Report  
 CIPCO Fair Station CCR Monofill  
 Permit No. 70-SDP-09-91C

SULFATE (mg/L) SDWR=250

Date	Reporting Limit	Water Table			Uppermost Aquifer						
		Upgradient	Downgradient		Upgradient	Downgradient					
		MW-11	MW-2	MW-6	MW-9	MW-1	MW-3	MW-5	MW-15	MW-17	MW-20
Aug-95											
Nov-95											
Feb-96											
Jun-96											
Sep-96											
Apr-97											
Oct-97											
Apr-98											
Oct-98											
Apr-99											
Oct-99											
Apr-00											
Dec-00											
May-01	10	88	800		50	320	180		81		
Jul-01	10	120	170		32	150	27		250		
Oct-01	10	96	860		16	540	150		1,700		
Jan-02	10	88	980		14	470	120		1,100		
Oct-02	10	110	850		35	500	78		1,100		
Oct-03	10	89	1,100		17	420	66		1,400		
Oct-04	10.0	92.5	790		15.8	538	72.5		1,420		
Oct-05	10.0	130	990	380	22.0	750	94.0	370	1,900		
Jan-06	10.0			394				304			
Apr-06	10.0			361				355			
Jul-06	10.0			380				232			
Oct-06	10.0	121	798	338	16.8	456	49.5	259	1,610		
Oct-07	10.0	125	1,020	315	23.5	665	74.9	398	1,760		
Oct-08	10.0	91.8	664	184	18.4	840	116	265	1,380		

Table 8

Analytical Data Summary  
 2024 Annual Water Quality Report  
 CIPCO Fair Station CCR Monofill  
 Permit No. 70-SDP-09-91C

SULFATE (mg/L) SDWR=250

Date	Reporting Limit	Water Table			Uppermost Aquifer							
		Upgradient	Downgradient		Upgradient	Downgradient						
		MW-11	MW-2	MW-6	MW-9	MW-1	MW-3	MW-5	MW-15	MW-17	MW-20	
Oct-09	200.0	79.0	600	200	21.0	730	110	92.0	1,400			
Oct-10	100/200	102	479	193	19.3	522	137	211	1,300			
Oct-11	Varies	111	788	245	19.8	471	90	211	1,480			
Oct-12	Varies	113	801	307	16.1	457	55.7	248	1,400			
Dec-12	Varies	109	992	295	14.7	452	68.6	226	1,520	804		
Oct-13	Varies	105	551	332	17.4	452	65.3	257	1,440	957		31.3
Jan-14	100									860		
Apr-14	100									828		20.4
Jul-14	100									830		
Oct-14												19.6
Oct-14	Varies	97.6	520	309	23.0	408	96.5	211	1,330	947		25.7
Oct-15	20.00	78.0	310	265	20.8	364	62.8	202	1,350	901		24.8
Oct-16	5.00	77.9	313	177	22.4	340	87.1	185	1,370	984		28.1
Aug-17	5.00	85.2	272	175	19.8	325	85.0	161	1,200	973		29.2
Oct-17	5.00	84.7	307	153	18.5	311	114	150	1,260	1,050		26.9
Apr-18	5.00	82.4	288	125	15.2	319	176	142	1,330	1,070		25.4
Oct-18	5.00	84.6	283	135	14.7	306	179	136	1,330	1,010		24.5
Oct-19	5.00	87.3	301	105	19.6	303	140	128	1,250	948		24.9
Oct-20	5.00	19.9	265	25.8	2.50U	270	21.8	22.3	1,320	949		25.8
Oct-21	5.00	89.2	318	108	21.2	275	50.2	90.8	1,140	1,140		27.0
Oct-22	5.00	75.6	216	78.1	16.6	247	54.1	59.9	929	1,060		22.6
Oct-23	5.00	74.3	206	75.6	18.8	250	24.4	62.2	1,380	1,090		26.7
Oct-24	Varies	89.0	177	89.9	31.1	244	37.1	81.5	1,260	1,190		36.5
<b>HISTORIC AVERAGE</b>		93	567	221	20	423	89	195	1,290	977		26
<b>BASELINE AVERAGE</b>		98	703	379	28	370	119	315	783	869		110
<b>UCL</b>		135			36.8							

Table 8

Analytical Data Summary  
 2024 Annual Water Quality Report  
 CIPCO Fair Station CCR Monofill  
 Permit No. 70-SDP-09-91C

Temperature (degrees Celsius)

Date	Water Table			Uppermost Aquifer						
	Upgradient	Downgradient		Upgradient	Downgradient					
	MW-11	MW-2	MW-6	MW-9	MW-1	MW-3	MW-5	MW-15	MW-17	MW-20
Aug-95										
Nov-95										
Feb-96										
Jun-96										
Sep-96	17.0	20.0			18.0	18.0		14.0		
Apr-97										
Oct-97	13.6	13.1		13.1	11.8	11.2		13.4		
Apr-98										
Oct-98		14.5				11.9				
Apr-99										
Oct-99	11.7	13.3		11.7	10.6	11.1		13.3		
Apr-00	8.5	7.5		11.0	10.0	9.0		12.0		
Dec-00	10	10.0		11	11	12		10		
May-01	10.5	13.1		11.4	13.4	12.9		12.6		
Jul-01	13.9	15.2		12.8	15.3	15.0		13.8		
Oct-01	11	12.6		9	10.5	11.4		12.6		
Jan-02	12	9.3		9	11.7	9.9		10.2		
Oct-02	10.7	12.0		8.1	10.8	10.6		11.0		
Oct-03	14.7	13		13.5	12.5	14.5		14.7		
Oct-04	12.7	14		12.7	11.5	11.9		13.2		
Oct-05	15.7	15.9	15.1	13.5		13.7	12.8	13.9		
Jan-06										
Apr-06										
Jul-06										
Oct-06										
Oct-07	14.4	15.1	17.1	13.2	12.7	12.5	16.2	14.1		
Oct-08	13.5	11.8	15.1		11.6	11.1	13.5	11.1		

Table 8

Analytical Data Summary  
 2024 Annual Water Quality Report  
 CIPCO Fair Station CCR Monofill  
 Permit No. 70-SDP-09-91C

Temperature (degrees Celsius)

Date	Water Table			Uppermost Aquifer						
	Upgradient	Downgradient		Upgradient	Downgradient					
	MW-11	MW-2	MW-6	MW-9	MW-1	MW-3	MW-5	MW-15	MW-17	MW-20
Oct-09	13.9	14.9	16.9	13.0	13.9	12.6	16.0	13.9		
Oct-10	12.6	12.5	16.5	12.3	11.9	11.1	14.3	12.2		
Oct-11	12.4	11.3	14.5	11.5	11.5	9.7	13.9	10.9		
Oct-12	16.5	13.4	16.0	14.8	15.4	11.8	15.6	12.1		
Dec-12	11.9	10.5	12.1	11.6	11.1		13.7	12.3	12.5	
Oct-13	10.3	10.2	11.7	10.3	9.2	9.6	13.0	10.0	11.4	9.4
Jan-14									7.4	
Apr-14									8.7	10.3
Jul-14									14.9	
Oct-14										12.3
Oct-14	11.9	11.9	10.8	11.1	11.0	10.1	12.5	10.9	11.9	11.6
Oct-15	13.5	15.6	16.1	11.0	11.9	14.1	14.8	15.0	14.3	12.5
Oct-16	12.0	14.2	16.4	13.0	10.9	12.0	14.7	14.1	14.3	11.7
Aug-17	11.4	13.9	15.7	13.1	10.7	12.9	13.5	13.1	12.8	12.9
Oct-17	12.7	13.3	15.7	12.8	11.7	11.1	14.0	12.1	12.8	11.0
Apr-18	9.5	7.0	7.2	10.5	10.5	10.4	9.8	10.2	8.7	9.7
Oct-18	12.3	13.9	15.3	11.3	10.7	11.6	14.2	12.8	13.8	12.7
Oct-19	12.6	15.4	16.9	13.1	12.3	12.2	14.4	13.4	14.5	12.8
Oct-20	16.7	14.0	13.2	14.3	13.6	17.1	17.5	13.6	13.5	16.5
Oct-21	14.45	14.51		18.04	13.78	14.61	19.23	19.8	17.06	13.4
Oct-22	13.32	14.65	16.35	12.46	13.34	12.07	14.86	14.86	14.17	16.99
Oct-23	12.92	14.97	16.6	14.29	11.48	14.85	14.86	17.08	14.03	12.68
Oct-24	14.67	16.15	17.15	14.84	13.06	14.72	16.03	20.72	15.44	15.88

Table 8

Analytical Data Summary  
 2024 Annual Water Quality Report  
 CIPCO Fair Station CCR Monofill  
 Permit No. 70-SDP-09-91C

pH

Date	Water Table			Uppermost Aquifer						
	Upgradient	Downgradient		Upgradient	Downgradient					
	MW-11	MW-2	MW-6	MW-9	MW-1	MW-3	MW-5	MW-15	MW-17	MW-20
Aug-95										
Nov-95										
Feb-96										
Jun-96										
Sep-96	6.48	6.95			6.83	7.16		7.27		
Apr-97										
Oct-97	6.70	6.14		7.12	6.60	6.14		6.95		
Apr-98										
Oct-98	8.01	8.30		8.62	8.66	7.12				
Apr-99										
Oct-99	6.92	7.01		7.19	7.01	7.44		6.40		
Apr-00	7.00	6.59		7.46	6.81	7.31		6.96		
Dec-00	6.62			7.25	5.72	6.79		6.61		
May-01	7.00	7.05		7.50	7.32	6.84		7.44		
Jul-01	6.98	6.81			6.75	7.2		7.58		
Oct-01	7.04	6.43		7.32	5.72	7.01		6.97		
Jan-02	7.01	6.47		7.32	6.78	7.20		6.90		
Oct-02	7.01	8.28		9.31	7.30	8.34		7.49		
Oct-03	7.10	6.7		7.52	6.83	7.22		6.98		
Oct-04	6.78	7.15		7.60	5.82	7.33		7.12		
Oct-05	7.84	7.05	6.30	7.90		7.49	5.84	6.81		
Jan-06										
Apr-06										
Jul-06										
Oct-06	6.68	6.26	6.16		6.13	7.24		6.68		
Oct-07	7.92	7.34	7.67	7.84	7.23	7.40	8.30	7.15		
Oct-08	7.10	6.65	6.88		6.76	7.24	7.10	6.99		

Table 8

Analytical Data Summary  
 2024 Annual Water Quality Report  
 CIPCO Fair Station CCR Monofill  
 Permit No. 70-SDP-09-91C

pH

Date	Water Table			Uppermost Aquifer						
	Upgradient	Downgradient		Upgradient	Downgradient					
	MW-11	MW-2	MW-6	MW-9	MW-1	MW-3	MW-5	MW-15	MW-17	MW-20
Oct-09	7.13	6.93	6.96	7.16	6.94	7.23	7.12	6.91		
Oct-10	7.10	6.60	6.83	7.22	6.71	7.19	7.16	7.01		
Oct-11	7.11	6.56	7.00	7.30	7.08	7.24	7.28	7.07		
Oct-12										
Dec-12	6.88	6.43	6.75	7.02	6.67		6.91	6.87	6.97	
Oct-13	6.88	6.44	6.85	7.03	6.74	6.54	6.76	5.64	6.15	7.00
Jan-14									6.42	
Apr-14									6.25	7.35
Jul-14									6.72	
Oct-14										5.44
Oct-14	7.74	7.57	5.56	7.41	7.50	7.93	6.32	7.57	7.23	8.00
Oct-15	7.03	6.63	6.70	7.23	6.77	7.35	6.92	7.08	6.95	7.52
Oct-16	6.85	6.52	6.79	7.35	6.73	7.06	6.88	6.88	6.98	7.38
Aug-17	6.56	6.37	6.65	6.40	6.60	6.88	6.76	6.85	6.82	7.14
Oct-17	6.76	6.43	6.73	7.30	5.94	6.96	6.76	6.71	6.71	7.16
Apr-18	6.78	6.58	6.95	7.00	6.61	7.15	6.94	6.84	6.97	7.52
Oct-18	6.97	6.57	6.92	7.43	6.83	7.06	6.97	6.96	7.06	7.47
Oct-19	7.03	6.54	6.77	6.05	6.90	7.13	6.79	7.03	7.16	7.35
Oct-20	6.94	6.53	6.92	7.36	6.80	7.09	6.98	7.00	7.03	7.48
Oct-21	7.00	7.11		7.44	6.79	7.30	7.05	7.05	6.96	6.83
Oct-22	7.02	6.69	7.23	7.68	6.84	7.13	7.3	7.27	7.33	7.41
Oct-23	6.42	6.44	6.72	8.07	6.48	6.98	6.7	6.83	6.82	7.11
Oct-24	6.55	6.33	6.55	7.27	6.49	6.85	6.63	6.65	6.69	7.10

Table 8

Analytical Data Summary  
 2024 Annual Water Quality Report  
 CIPCO Fair Station CCR Monofill  
 Permit No. 70-SDP-09-91C

Specific Conductance (microSiemens/cm)

Date	Water Table			Uppermost Aquifer						
	Upgradient	Downgradient		Upgradient	Downgradient					
	MW-11	MW-2	MW-6	MW-9	MW-1	MW-3	MW-5	MW-15	MW-17	MW-20
Aug-95										
Nov-95										
Feb-96										
Jun-96										
Sep-96										
Apr-97										
Oct-97	785	1,205		570	1,114	483		1,290		
Apr-98										
Oct-98	880	1,830		664	1,140	620				
Apr-99										
Oct-99	891	1,580		619	1,432	672		2,200		
Apr-00	847	1,461		585	1,192	821		1,917		
Dec-00	839	1,626		592	1,287	761		2.27		
May-01	895	1,903		642	1,415	927		2,080		
Jul-01	783	1,704			1,362	870		1,899		
Oct-01	897	1,710		674	1,287	846		2.35		
Jan-02	887	1,828		674	1,566	802		2,345		
Oct-02	873	1,799		625	1,566	744		2,333		
Oct-03	896	2,090		636	1,473	747.4		2,394		
Oct-04	976	1,822		719.8	1,833	817.2		2,964		
Oct-05	855	1,711	979	612		728	933	2,463		
Jan-06										
Apr-06										
Jul-06										
Oct-06	1,315	2,170	1,107	782	3,760	828		2,680		
Oct-07	861	1,751	797	629	1,811	716	943	246		
Oct-08	908	1,537	764		2,190	818	954	2,583		

Table 8

Analytical Data Summary  
 2024 Annual Water Quality Report  
 CIPCO Fair Station CCR Monofill  
 Permit No. 70-SDP-09-91C

Specific Conductance (microSiemens/cm)

Date	Water Table			Uppermost Aquifer							
	Upgradient	Downgradient		Upgradient	Downgradient						
	MW-11	MW-2	MW-6	MW-9	MW-1	MW-3	MW-5	MW-15	MW-17	MW-20	
Oct-09	866	1,315	880	705.00	1,980	856	911	2,570			
Oct-10	896.6	1,288	879.7	676.2	1,761	899.9	893.5				
Oct-11	921.4	1,740	1,047	693	1,621	820	927	2,601			
Oct-12	1,036	1,691	1,050	633	1,543	835	1,005	2,501			
Dec-12	938.2	1,985	1,082	663.3	1,517		1,022	2,708	1,917		
Oct-13	829.9	1,153	1,021	601.0	1,353	826.2	956.7	254	1,890	651.0	
Jan-14									1,995		
Apr-14									2,081	700.0	
Jul-14									1,979		
Oct-14											754.2
Oct-14	852	1,190	1,183	694.4	1,328	938.1	938.7	2,200	1,899	624.5	
Oct-15	891.2	1,024	1,220	677.1	1,424	709.4	1,029	2,488	2,035	672.5	
Oct-16	867	978	1,080	654	1,400	703	1,020	2,410	2,090	667	
Aug-17	913	962	1,110	723	1,330	678	1,000	2,260	2,160	691	
Oct-17	1,430	1,690	1,760	1,110	2,200	1,260	1,720	4,060	3,830	1,180	
Apr-18	880	1,040	927	667	1,400	781	997	2,530	2,250	695	
Oct-18	906	1,005	979	686	1,310	887	998	1,825	2,114	688	
Oct-19	1,160	1,100	1,040	625	1,370	840	970	2,550	2,170	730	
Oct-20	845	960	1,000	681	1,190	691	857	2,390	2,270	655	
Oct-21	846	1128		771	1144	677	854	2105	2154	626	
Oct-22	926	1001	832	751	1183	790	840	1922	1909	686	
Oct-23	824	805	810	603	1108	499	820	2291	2067	612	
Oct-24	942	872	903	689	1313	622	929	2647	2567	701	



**Analytical Data Summary  
2024 Annual Water Quality Report  
CIPCO Fair Station CCR Monofill  
Permit No. 70-SDP-09-91C**

---

## Notes:

Baseline Data to be completed in 2018 for all calculations except Chloride and Sulfate.

mg/L - Milligrams per liter.


MCL - Maximum Contaminant Level.

UCL - Upgradient Control Limit.

HA - Health Advisory.

SDWR - Safe Drinking Water Regulations Guideline.

U - Value shown is 1/2 the detection limit. This value was used, where applicable, in calculation of UCL, baseline, and 2-year average.

 Shaded values indicate concentration exceeds water quality criteria (e.g, the MCL, HA, SDWR limit, SWS, or 2-year average).

**BOLD** Bold indicates value exceeds the calculated UCL.

*Italics* Italics indicates sample result exceeds baseline concentration.

UCL, calculated as the Historic Average plus two standard deviations; based on upgradient wells only.

2-Year Average is the average concentration over the prior two years of sampling data.

Historic Average is the average based on analytical results for each well as shown. Historic dissolved metals are not included.

Baseline Average is the average concentration based four (4) quarters or four (4) initial sampling events.

Table 9

**Historic Control Limit and Action Level Exceedances  
2024 Annual Water Quality Report  
CIPCO Fair Station CCR Monofill  
Permit No. 70-SDP-09-91C**

Key: gray =CL; black =action level		F a i l 2020	F a i l 2021	F a i l 2022	F a i l 2023	F a i l 2024
Well	Constituent					
MW-1	Chloride					
	Cobalt					
	Iron					
	Lithium					
	Magnesium					
	Manganese					
	Sodium					
	Strontium					
	Sulfate					
MW-2	Boron					
	Lithium					
	Magnesium					
	Manganese					
	Sodium					
	Strontium					
	Sulfate					
MW-3	Boron					
	Cobalt					
	Iron					
	Lithium					
	Magnesium					
	Manganese					
	Sodium					
	Strontium					
	Sulfate					
MW-5	Boron					
	Chloride					
	Cobalt					
	Iron					
	Lithium					
	Magnesium					
	Manganese					
	Sodium					
	Sulfate					

Table 9

**Historic Control Limit and Action Level Exceedances  
2024 Annual Water Quality Report  
CIPCO Fair Station CCR Monofill  
Permit No. 70-SDP-09-91C**

Key: gray =CL; black =action level		F a i l 2020	F a i l 2021	F a i l 2022	F a i l 2023	F a i l 2024
Well	Constituent					
MW-6	Arsenic					
	Boron					
	Chloride					
	Cobalt					
	Iron					
	Magnesium					
	Manganese					
	Molybdenum					
	Sodium					
	Strontium					
MW-9	Lithium					
	Magnesium					
	Sodium					
MW-11	Iron					
	Magnesium					
	Manganese					
	Sodium					
MW-15	Boron					
	Chloride					
	Lithium					
	Magnesium					
	Manganese					
	Molybdenum					
	Sodium					
	Strontium					
Sulfate						

**Table 9**

**Historic Control Limit and Action Level Exceedances  
2024 Annual Water Quality Report  
CIPCO Fair Station CCR Monofill  
Permit No. 70-SDP-09-91C**

Key: gray =CL; black =action level		F a i l 2020	F a i l 2021	F a i l 2022	F a i l 2023	F a i l 2024
Well	Constituent					
MW-17	Boron					
	Chloride					
	Iron					
	Lithium					
	Magnesium					
	Manganese					
	Molybdenum					
	Sodium					
MW-20	Sulfate					
	Boron					
	Lithium					
	Magnesium					
	Manganese					
	Molybdenum					
Sodium						

Data shown for 5 years total.

Table 10

October 2024 Groundwater Quality Assessment Plan Trend Analysis  
 2024 Annual Water Quality Report  
 CIPCO Fair Station CCR Monofill  
 Permit No. 70-SDP-09-91C

Parameter	Units	Water Table			Uppermost Aquifer							
		MW-11 UG	MW-2 DG	MW-6 DG	MW-9 UG	MW-1 DG	MW-3 DG	MW-5 DG	MW-15 DG	MW-17 DG	MW-20 DG	
Arsenic	mg/L	ND	ND	0.00207	ND	ND	ND	ND	ND	ND	ND	ND
	Trend	NA	NA	None	NA	NA	NA	NA	NA	NA	NA	NA
Boron	mg/L	ND	6.11	7.67	0.336	0.291	1.52	6.56	39.3	33.2	1.47	
	Trend	NA	Decreasing	Increasing	None	None	None	None	Increasing	Increasing	None	None
Chloride	mg/L	12.4	9.96	18.6	3.45	7.30	2.36	18.8	20.4	19.0	3.71	
	Trend	Increasing	Decreasing	None	NA	Decreasing	NA	Increasing	Increasing	None	NA	None
Cobalt	mg/L	ND	ND	0.00344	0.00108	0.00121	0.00483	0.00192	ND	ND	ND	
	Trend	NA	NA	None	NA	None	Increasing	None	None	NA	NA	None
Iron	mg/L	0.260	ND	0.977	ND	1.92	1.673	0.738	0.123	1.43	0.162	
	Trend	None	NA	None	NA	Increasing	None	Increasing	NA	Decreasing	None	None
Lithium	mg/L	ND	0.0333	ND	0.0445	0.0643	0.0348	0.0195	0.154	0.293	0.0219	
	Trend	NA	Decreasing	NA	None	None	None	None	None	None	None	None
Magnesium	mg/L	45.7	27.5	30.8	30.5	72.5	18.5	34.1	126	214	15.3	
	Trend	None	Decreasing	Decreasing	None	None	None	None	Increasing	None	None	None
Manganese	mg/L	0.244	0.0923	5.16	ND	0.299	1.71	0.247	0.0741	0.257	0.0267	
	Trend	None	None	Decreasing	None	None	Increasing	None	None	None	Decreasing	None
Molybdenum	mg/L	ND	ND	0.0448	ND	ND	ND	ND	0.259	0.0770	ND	
	Trend	NA	NA	None	NA	NA	NA	NA	Increasing	Decreasing	NA	None
Sodium	mg/L	12.8	15.4	16.9	12.5	11.4	21.2	18.3	87.2	82.4	84.0	
	Trend	None	Decreasing	None	None	None	None	None	None	Increasing	None	None
Strontium	mg/L	0.132	0.313	0.249	0.706	0.790	0.880	0.368	0.717	0.580	0.616	
	Trend	None	None	Decreasing	None	None	Increasing	None	None	None	None	None
Sulfate	mg/L	89.0	177	89.9	31.1	244	37.1	81.5	1,260	1,190	36.5	
	Trend	None	Decreasing	Decreasing	None	Decreasing	Decreasing	Decreasing	None	Increasing	None	None
Temperature	°C	14.67	16.15	17.15	14.84	13.06	14.72	16.03	20.72	15.44	15.88	
	Trend	None	None	None	None	None	None	None	None	None	None	None
pH	pH Units	6.55	6.33	6.55	7.27	6.49	6.85	6.63	6.65	6.69	7.10	
	Trend	None	None	Decreasing	None	None	Decreasing	None	None	None	None	None
Specific Conductance	µS/cm	942	872	903	689	1,313	622	929	2,647	2,567	701	
	Trend	None	Decreasing	None	None	None	Decreasing	None	None	None	None	None

Notes:

UG - Upgradient.  
 mg/L - Milligrams per liter.  
 µS/cm - MicroSiemens per centimeter.

ND - Not detected.  
 NS - Not sampled.  
 °C - Degrees Celsius.

NA - Not applicable; no trend observed due to predominance of non-detect results.

Shaded values indicate concentration exceeds water quality criteria (e.g, the MCL, HA, SDWR limit, SWS, or 2-year average).

**Table 11**

**Leachate Management Summary  
2024 Annual Water Quality Report  
CIPCO Fair Station CCR Monofill  
Permit No. 70-SDP-09-91C**

**This table is not applicable to the CIPCO Fair Station CCR Monofill**

**Table 12**

**Gas Monitoring Summary  
2024 Annual Water Quality Report  
CIPCO Fair Station CCR Monofill  
Permit No. 70-SDP-09-91C**

**This table is not applicable to the CIPCO Fair Station CCR Monofill**

**Table 13**

**Groundwater Elevations <sup>a</sup>**  
**2024 Annual Water Quality Report**  
**CIPCO Fair Station CCR Monofill**  
**Permit No. 70-SDP-09-91C**  
**October 22, 2024**

<b>Monitoring Well</b>	<b>Unit</b>	<b>Elevation (feet)</b>
MW-1	Uppermost Aquifer	563.47
MW-2	Water Table	552.35
MW-3	Uppermost Aquifer	549.87
MW-4	Water Table	547.50
MW-5	Uppermost Aquifer	549.02
MW-6	Water Table	548.20
MW-7	Water Table	553.40
MW-9	Uppermost Aquifer	596.93
MW-10	Water Table	607.18
MW-11	Water Table	581.28
MW-15	Uppermost Aquifer	546.25
MW-17	Uppermost Aquifer	545.08
MW-20	Uppermost Aquifer	553.42

**Notes:**

<sup>a</sup> All groundwater elevations in feet North American Vertical Datum 1988.  
CCR - Coal combustion residue.



**Table 14**

**Vertical Hydraulic Grandients<sup>a</sup> (ft/ft)**  
**2024 Annual Water Quality Report**  
**CIPCO Fair Station CCR Monofill**  
**Permit No. 70-SDP-09-91C**  
**October 22, 2024**

<b>Well Cluster</b>	<b>Gradient</b>
<i>Shallow/Deep</i>	
MW-2/MW-3	-0.068
MW-6/MW-5	0.050
MW-10/MW-9	-0.122
MW-7/MW-20	0.001



**Notes:**

<sup>a</sup> Positive hydraulic gradients indicate upward-directed flow, and negative hydraulic gradients indicate downward-directed flow.


CCR - Coal combustion residue.

ft/ft - Foot per foot.

# Figures

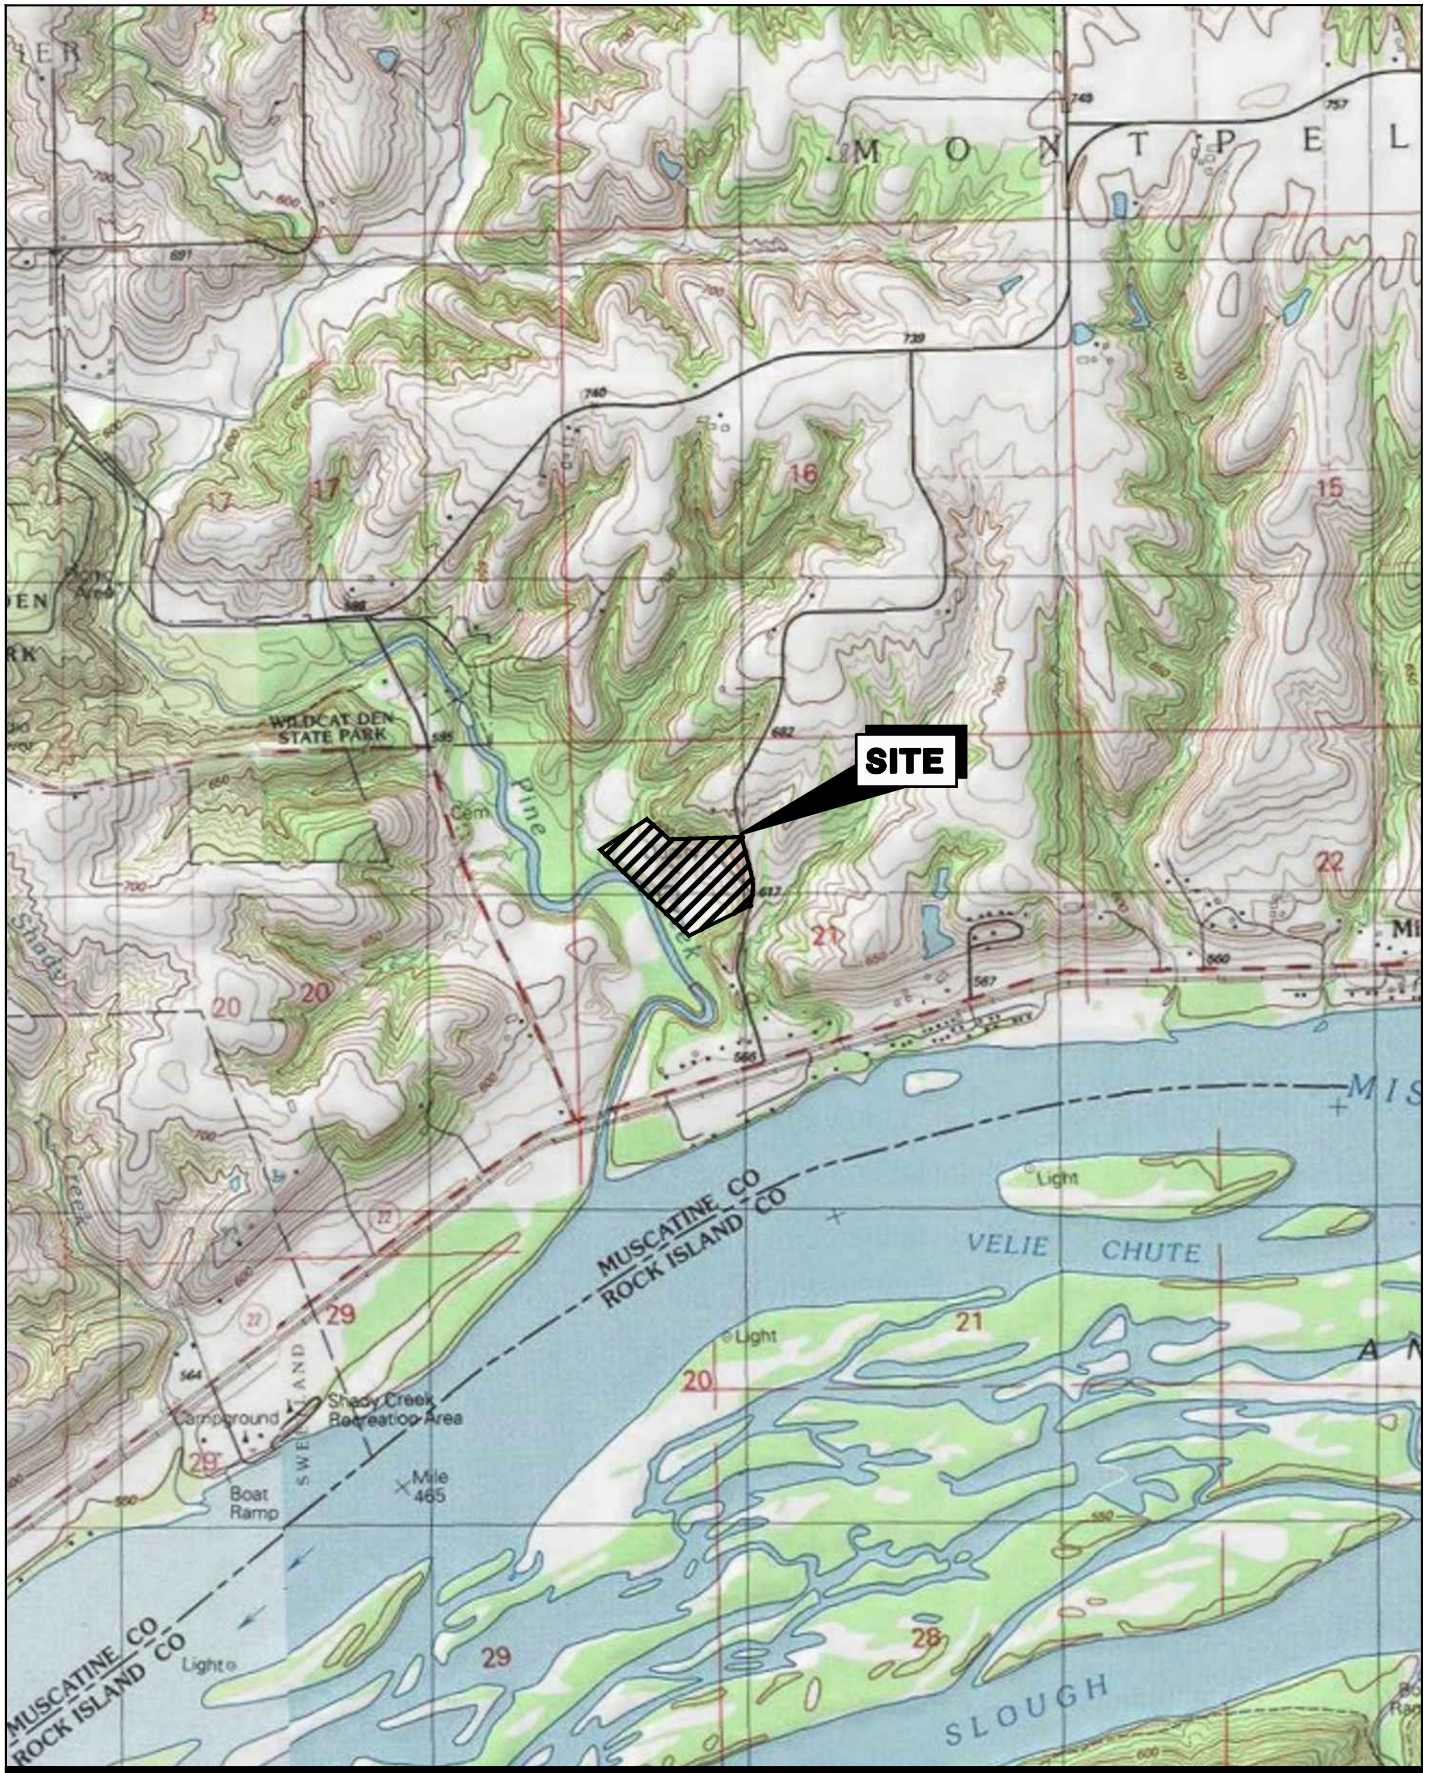

Coordinate System:  
<INSERT HERE>




CENTRAL IOWA POWER COOPERATIVE  
CIPCO FAIR STATION MONOFILL  
ANNUAL WATER QUALITY REPORT

Project No. 12560436  
Date November 2024

SITE LOCATION MAP

FIGURE 1



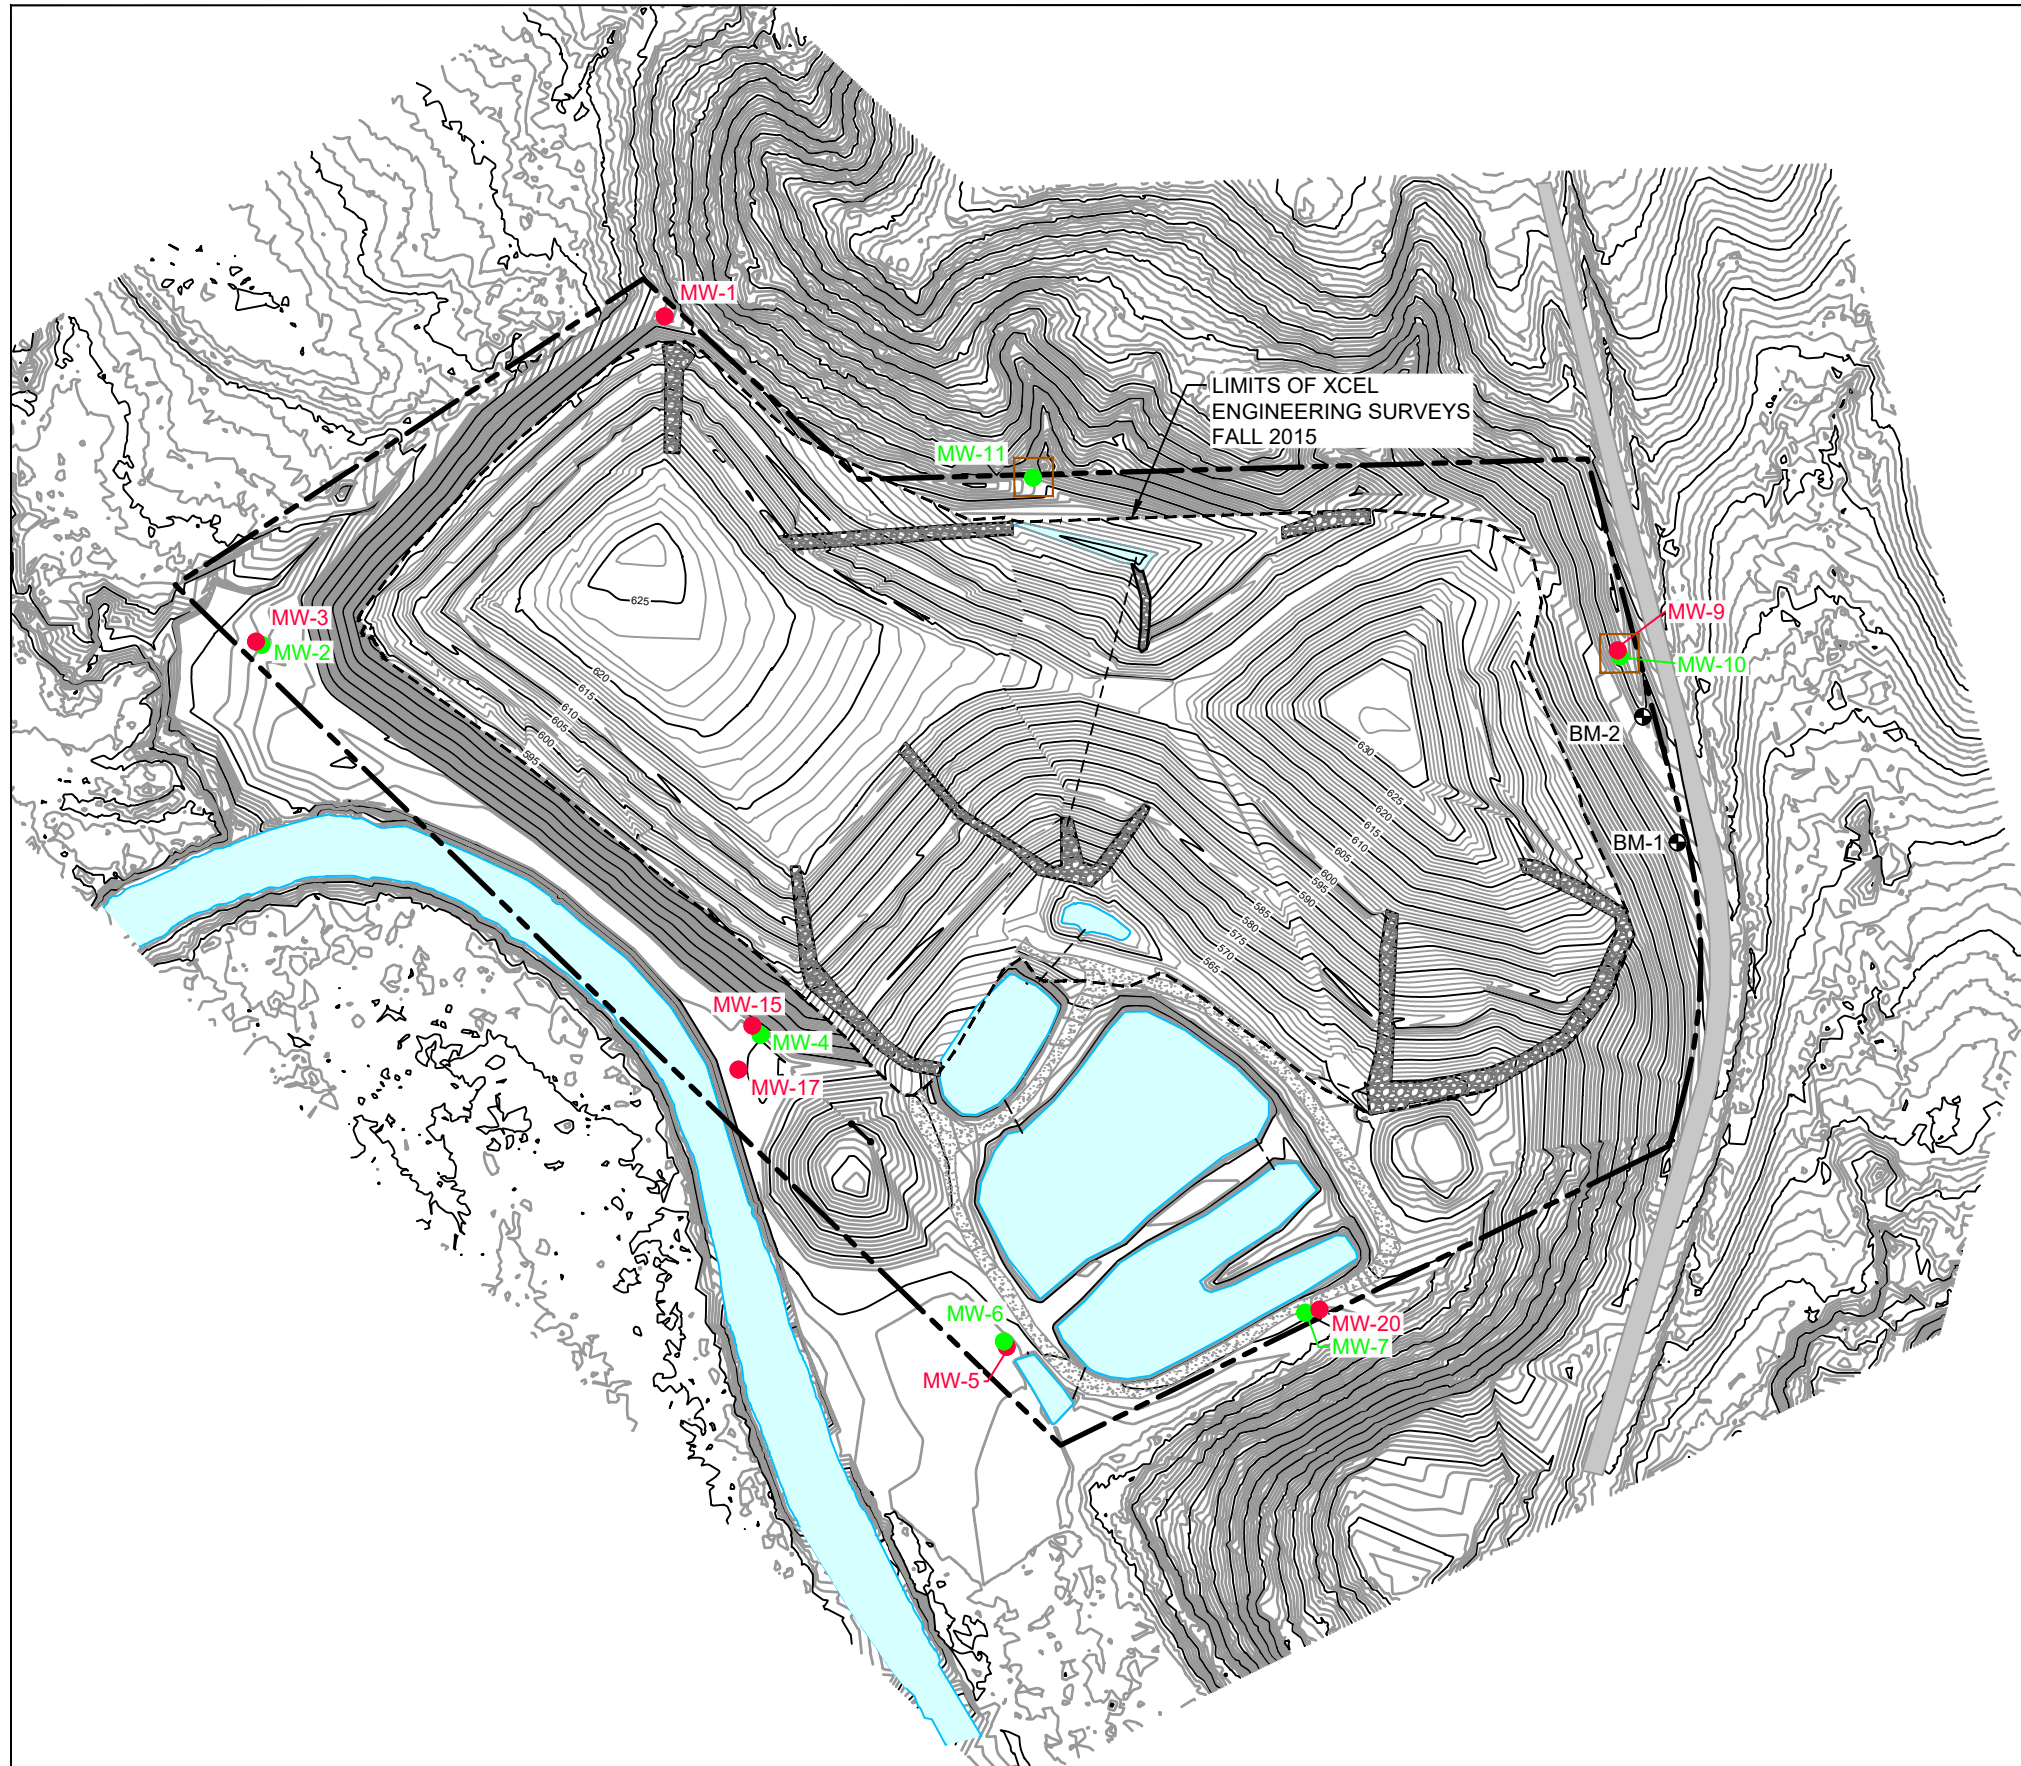

**LEGEND:**

- 650 ——— APPROXIMATE EXISTING GROUND SURFACE CONTOUR AND ELEVATION, FEET
- CULVERT
- PROPERTY LINE
- RIP-RAP
- PUBLIC ROAD
- MW-9 ● UPPERMOST AQUIFER MONITORING WELL LOCATION AND DESIGNATION
- MW-10 ● WATER TABLE MONITORING WELL LOCATION AND DESIGNATION
- BM-2 ⊕ BENCHMARK LOCATION AND DESIGNATION
- DENOTES UPGRADIENT LOCATION

**BENCHMARKS:**

- NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD88)
- BM-1 - SPIKE IN CORNER POSTS SOUTH ENTRANCE AS SHOWN  
ELEV = 620.53'
- BM-2 - MAG NAIL IN TOP OF THE NORTHERLY GATE POST AS SHOWN  
ELEV = 627.73'

**DRAWING REFERENCE(S):**



DATE OF SURVEY: MULTIPLE  
SURVEYS BY: IOWA LIDAR PROJECT, XCEL  
ENGINEERING, AND SNYDER AND ASSOCIATES.

**BASIS OF BEARING:**

IOWA STATE PLANE SOUTH COORDINATE SYSTEM

**NOTES:**

1. LIDAR DATA WERE USED TO CREATE CONTOURS IN A 300' AREA OUTSIDE OF THE PROPERTY LINE. LIDAR DATA WERE OBTAINED FROM THE IOWA DEPARTMENT OF NATURAL RESOURCES. MAPPING WAS PERFORMED FROM 2008-2010 AND IS SHOWN IN THE NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD88). ACCURACY OF LIDAR DATA STATED AS ±8 INCHES BY IOWA DEPARTMENT OF NATURAL RESOURCES.
2. MW-4, MW-7, AND MW-10 USED FOR WATER LEVEL MEASUREMENT ONLY.




CENTRAL IOWA POWER COOPERATIVE  
CIPCO FAIR STATION MONOFILL  
ANNUAL WATER QUALITY REPORT

Project No. 12560436  
Date November 2024

SITE MAP AND MONITORING NETWORK

FIGURE 2



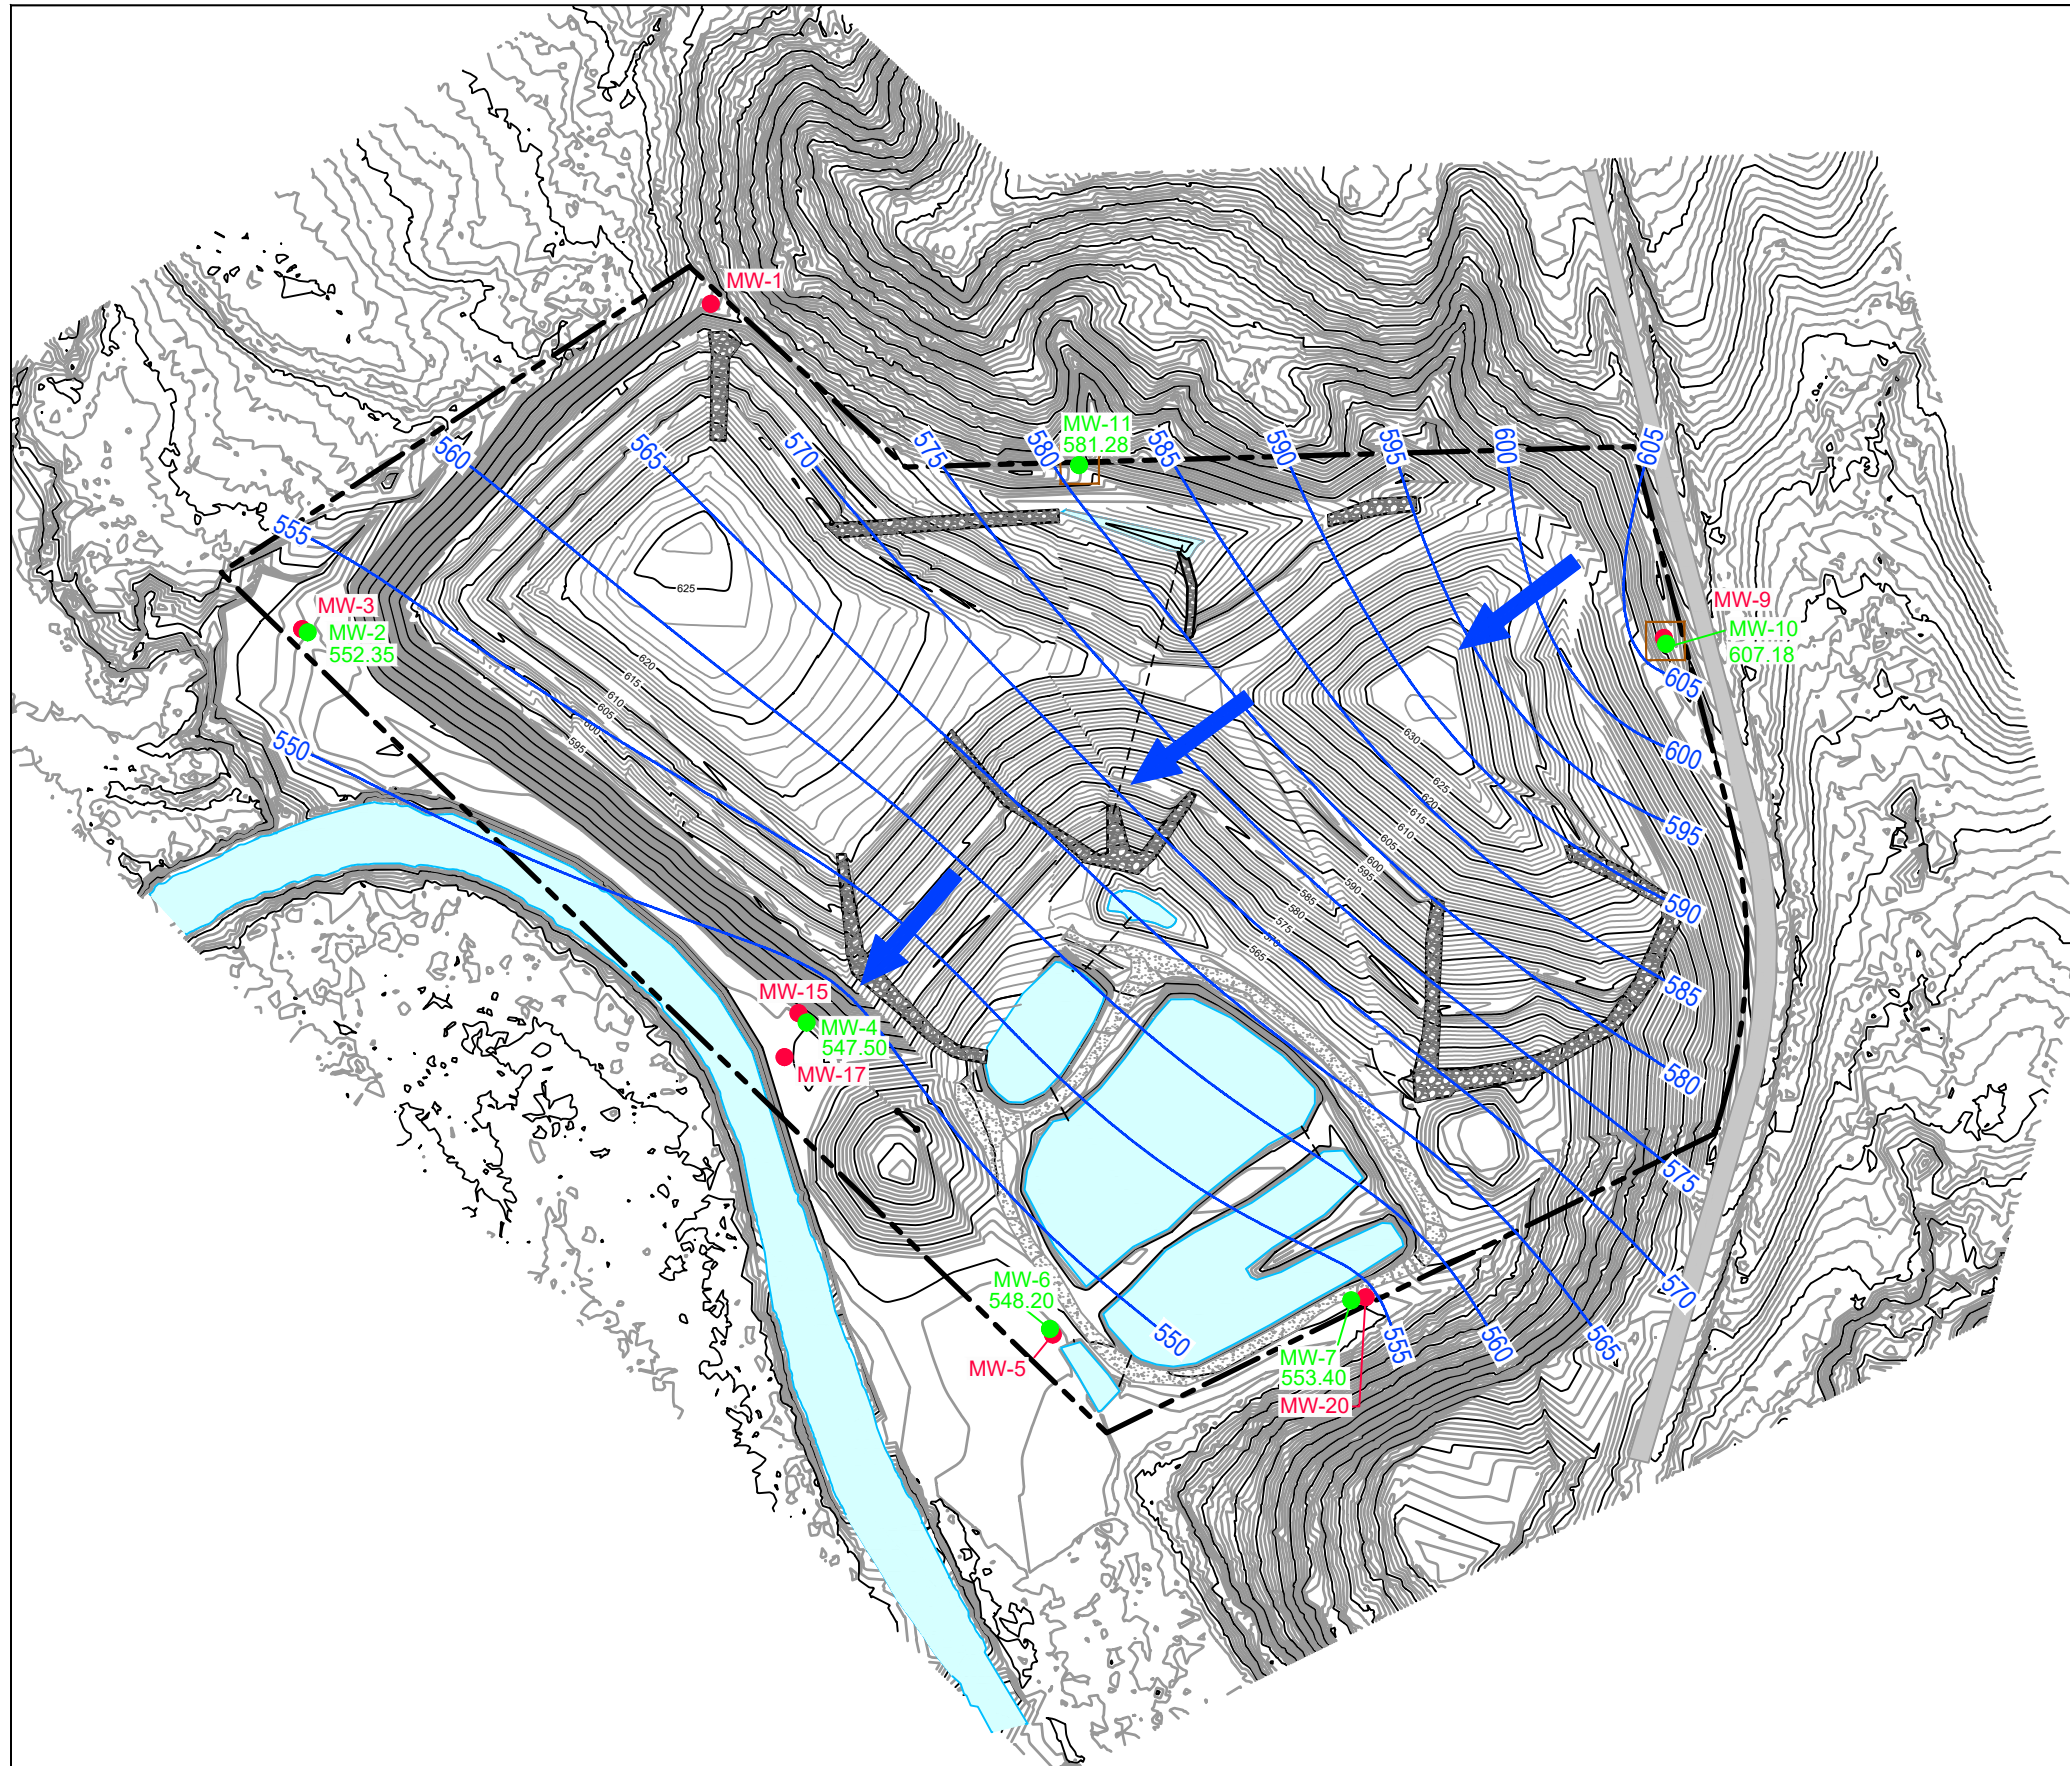

**LEGEND:**

- APPROXIMATE EXISTING GROUND SURFACE CONTOUR AND ELEVATION, FEET
- CULVERT
- PROPERTY LINE
- RIP-RAP
- PUBLIC ROAD
- UPPERMOST AQUIFER MONITORING WELL LOCATION AND DESIGNATION
- WATER TABLE MONITORING WELL LOCATION AND DESIGNATION
- DENOTES UPGRADIENT LOCATION
- GROUNDWATER ELEVATION CONTOUR
- FLOW DIRECTION

**DRAWING REFERENCE(S):**


DATE OF SURVEY: MULTIPLE  
 SURVEYS BY: IOWA LIDAR PROJECT, XCEL  
 ENGINEERING, AND SNYDER AND ASSOCIATES.

**BASIS OF BEARING:**

IOWA STATE PLANE SOUTH COORDINATE SYSTEM

**NOTES:**

1. LIDAR DATA WERE USED TO CREATE CONTOURS IN A 300' AREA OUTSIDE OF THE PROPERTY LINE. LIDAR DATA WERE OBTAINED FROM THE IOWA DEPARTMENT OF NATURAL RESOURCES. MAPPING WAS PERFORMED FROM 2008-2010 AND IS SHOWN IN THE NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD88). ACCURACY OF LIDAR DATA STATED AS ±8 INCHES BY IOWA DEPARTMENT OF NATURAL RESOURCES.




CENTRAL IOWA POWER COOPERATIVE  
 CIPCO FAIR STATION MONOFILL  
 ANNUAL WATER QUALITY REPORT  
  
**WATER TABLE  
 POTENTIOMETRIC SURFACE**  
 OCTOBER 22, 2024











Project No. 12560436  
 Date November 2024

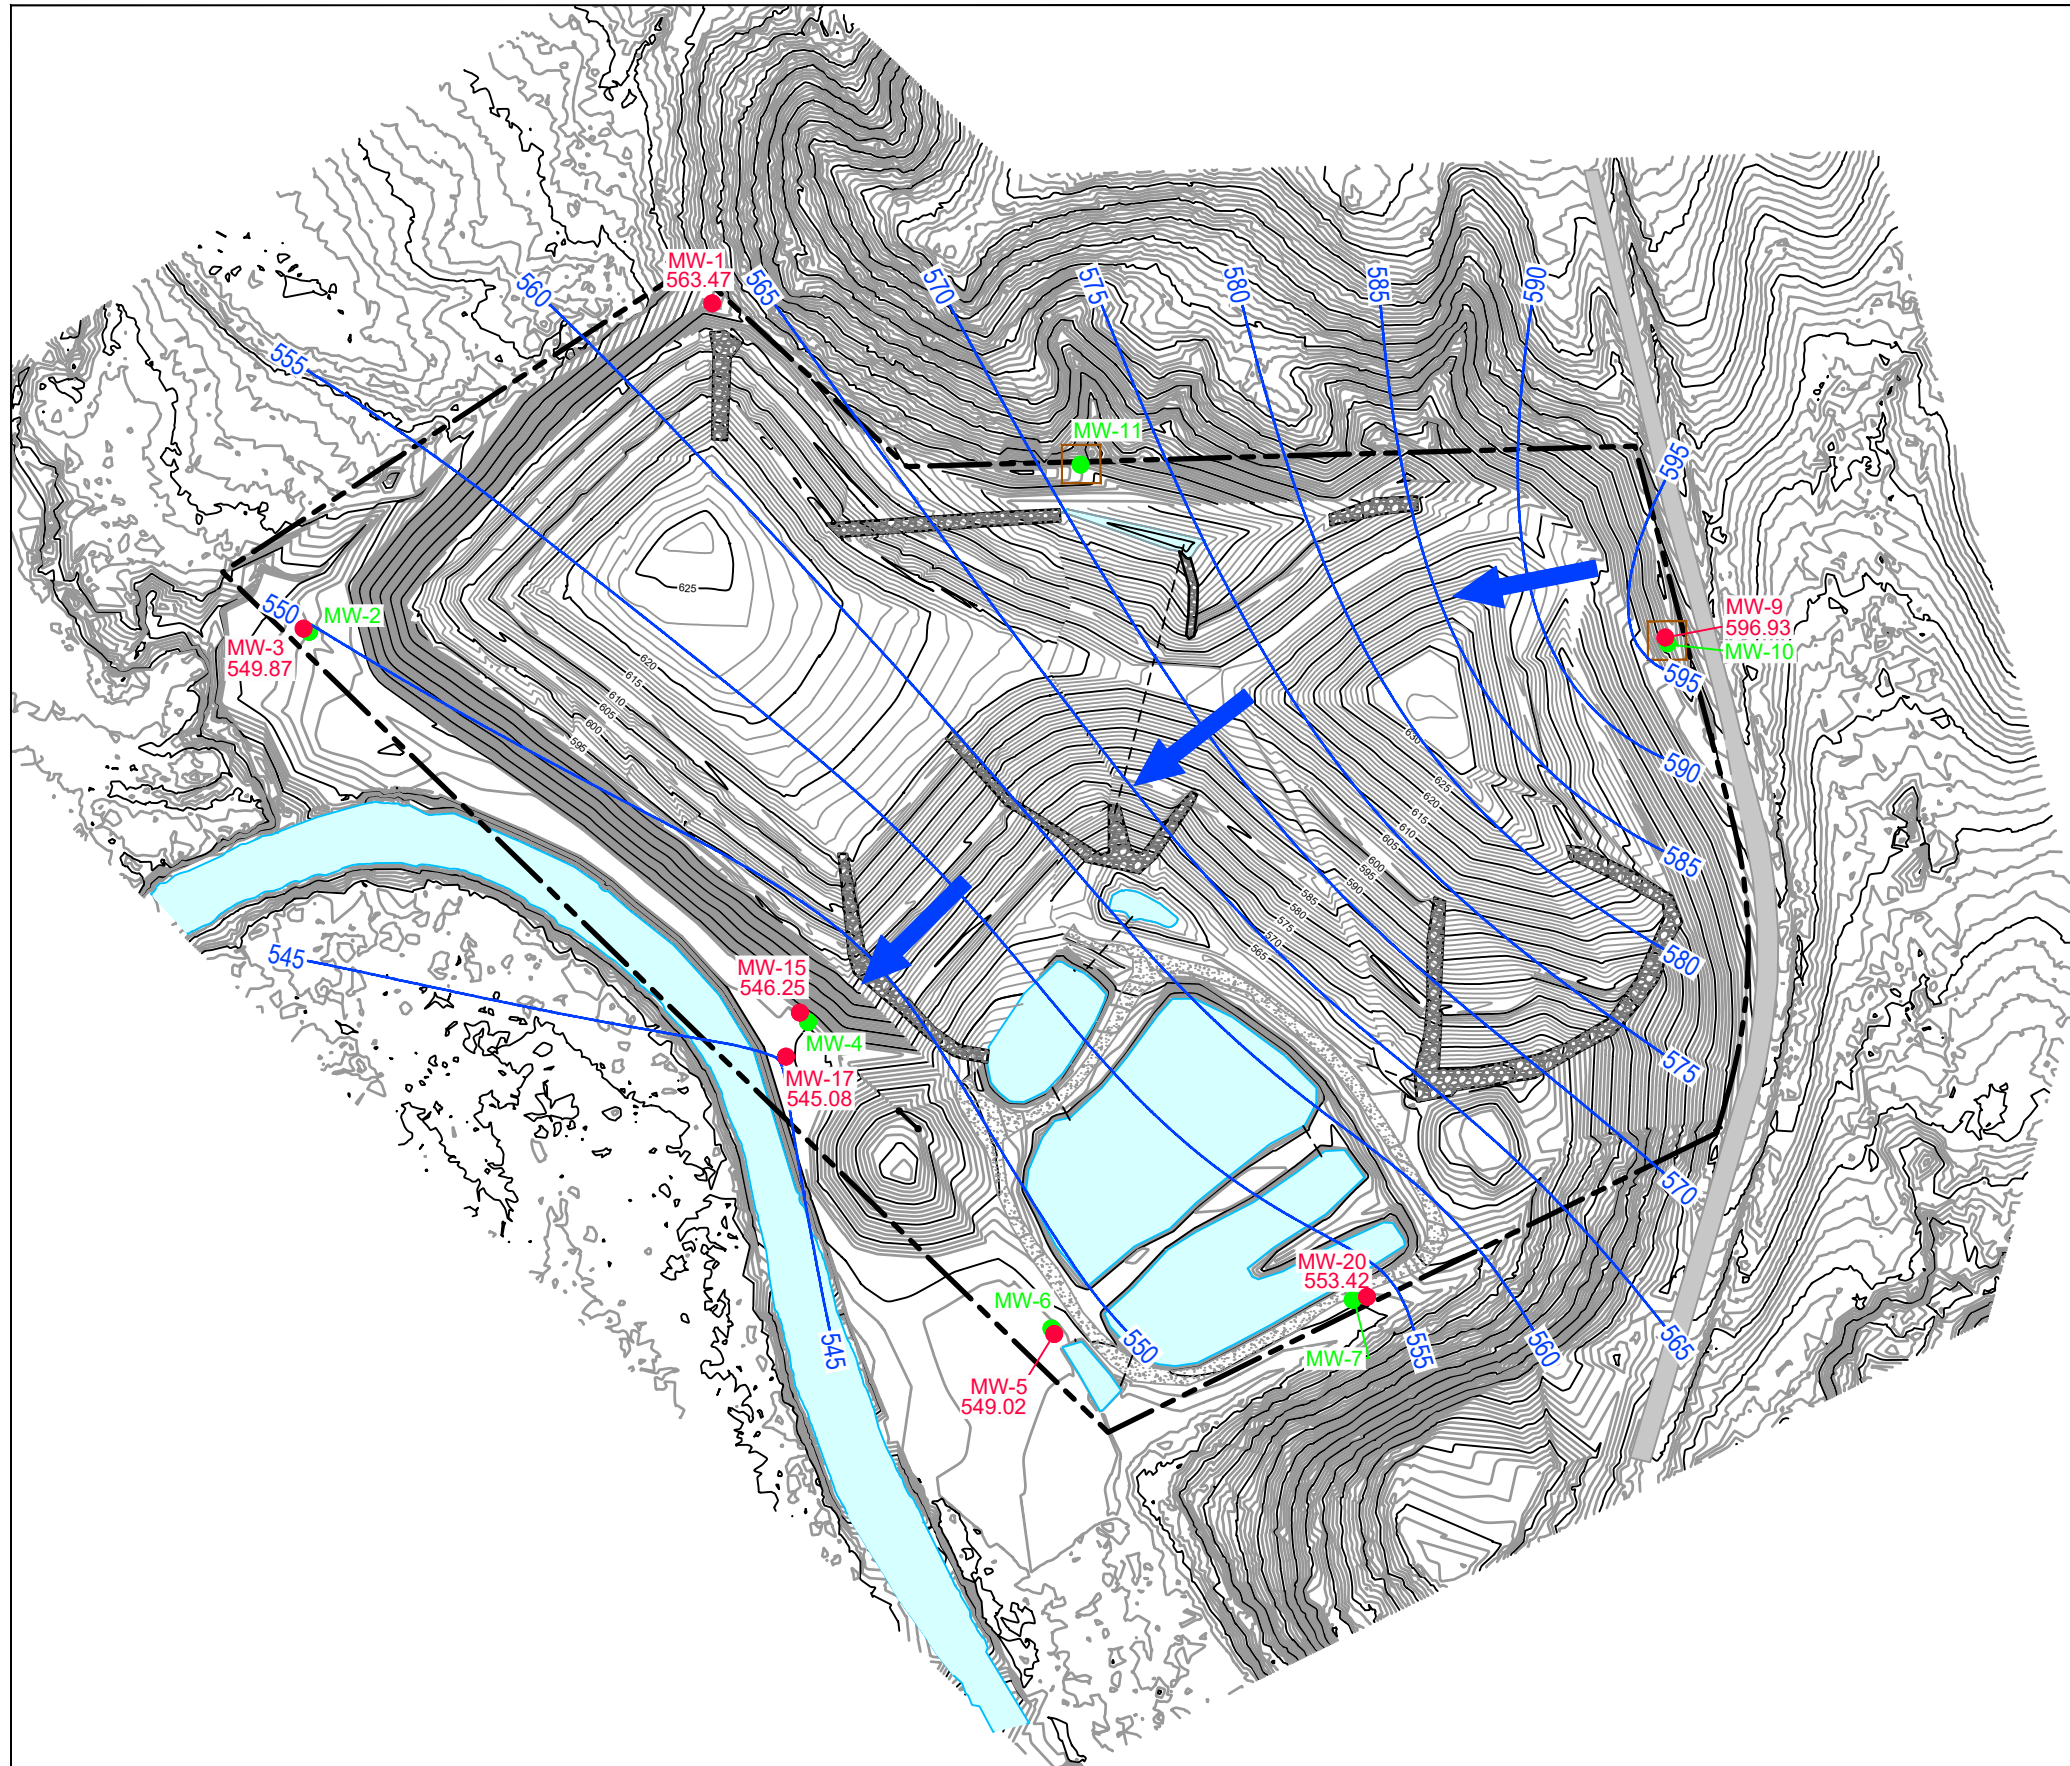**FIGURE 3**





**LEGEND:**

-  APPROXIMATE EXISTING GROUND SURFACE CONTOUR AND ELEVATION, FEET
-  CULVERT
-  PROPERTY LINE
-  RIP-RAP
-  PUBLIC ROAD
-  UPPERMOST AQUIFER MONITORING WELL LOCATION AND DESIGNATION
-  WATER TABLE MONITORING WELL LOCATION AND DESIGNATION
-  DENOTES UPGRADIENT LOCATION
-  GROUNDWATER ELEVATION CONTOUR
-  FLOW DIRECTION

**DRAWING REFERENCE(S):**


DATE OF SURVEY: MULTIPLE SURVEYS BY: IOWA LIDAR PROJECT, XCEL ENGINEERING, AND SNYDER AND ASSOCIATES.

**BASIS OF BEARING:**

IOWA STATE PLANE SOUTH COORDINATE SYSTEM

**NOTES:**

1. LIDAR DATA WERE USED TO CREATE CONTOURS IN A 300' AREA OUTSIDE OF THE PROPERTY LINE. LIDAR DATA WERE OBTAINED FROM THE IOWA DEPARTMENT OF NATURAL RESOURCES. MAPPING WAS PERFORMED FROM 2008-2010 AND IS SHOWN IN THE NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD88). ACCURACY OF LIDAR DATA STATED AS ±8 INCHES BY IOWA DEPARTMENT OF NATURAL RESOURCES.




CENTRAL IOWA POWER COOPERATIVE  
 CIPCO FAIR STATION MONOFILL  
 ANNUAL WATER QUALITY REPORT  
 UPPERMOST AQUIFER  
 POTENTIOMETRIC SURFACE  
 OCTOBER 22, 2024

Project No. 12560436  
 Date December 2024

**FIGURE 4**



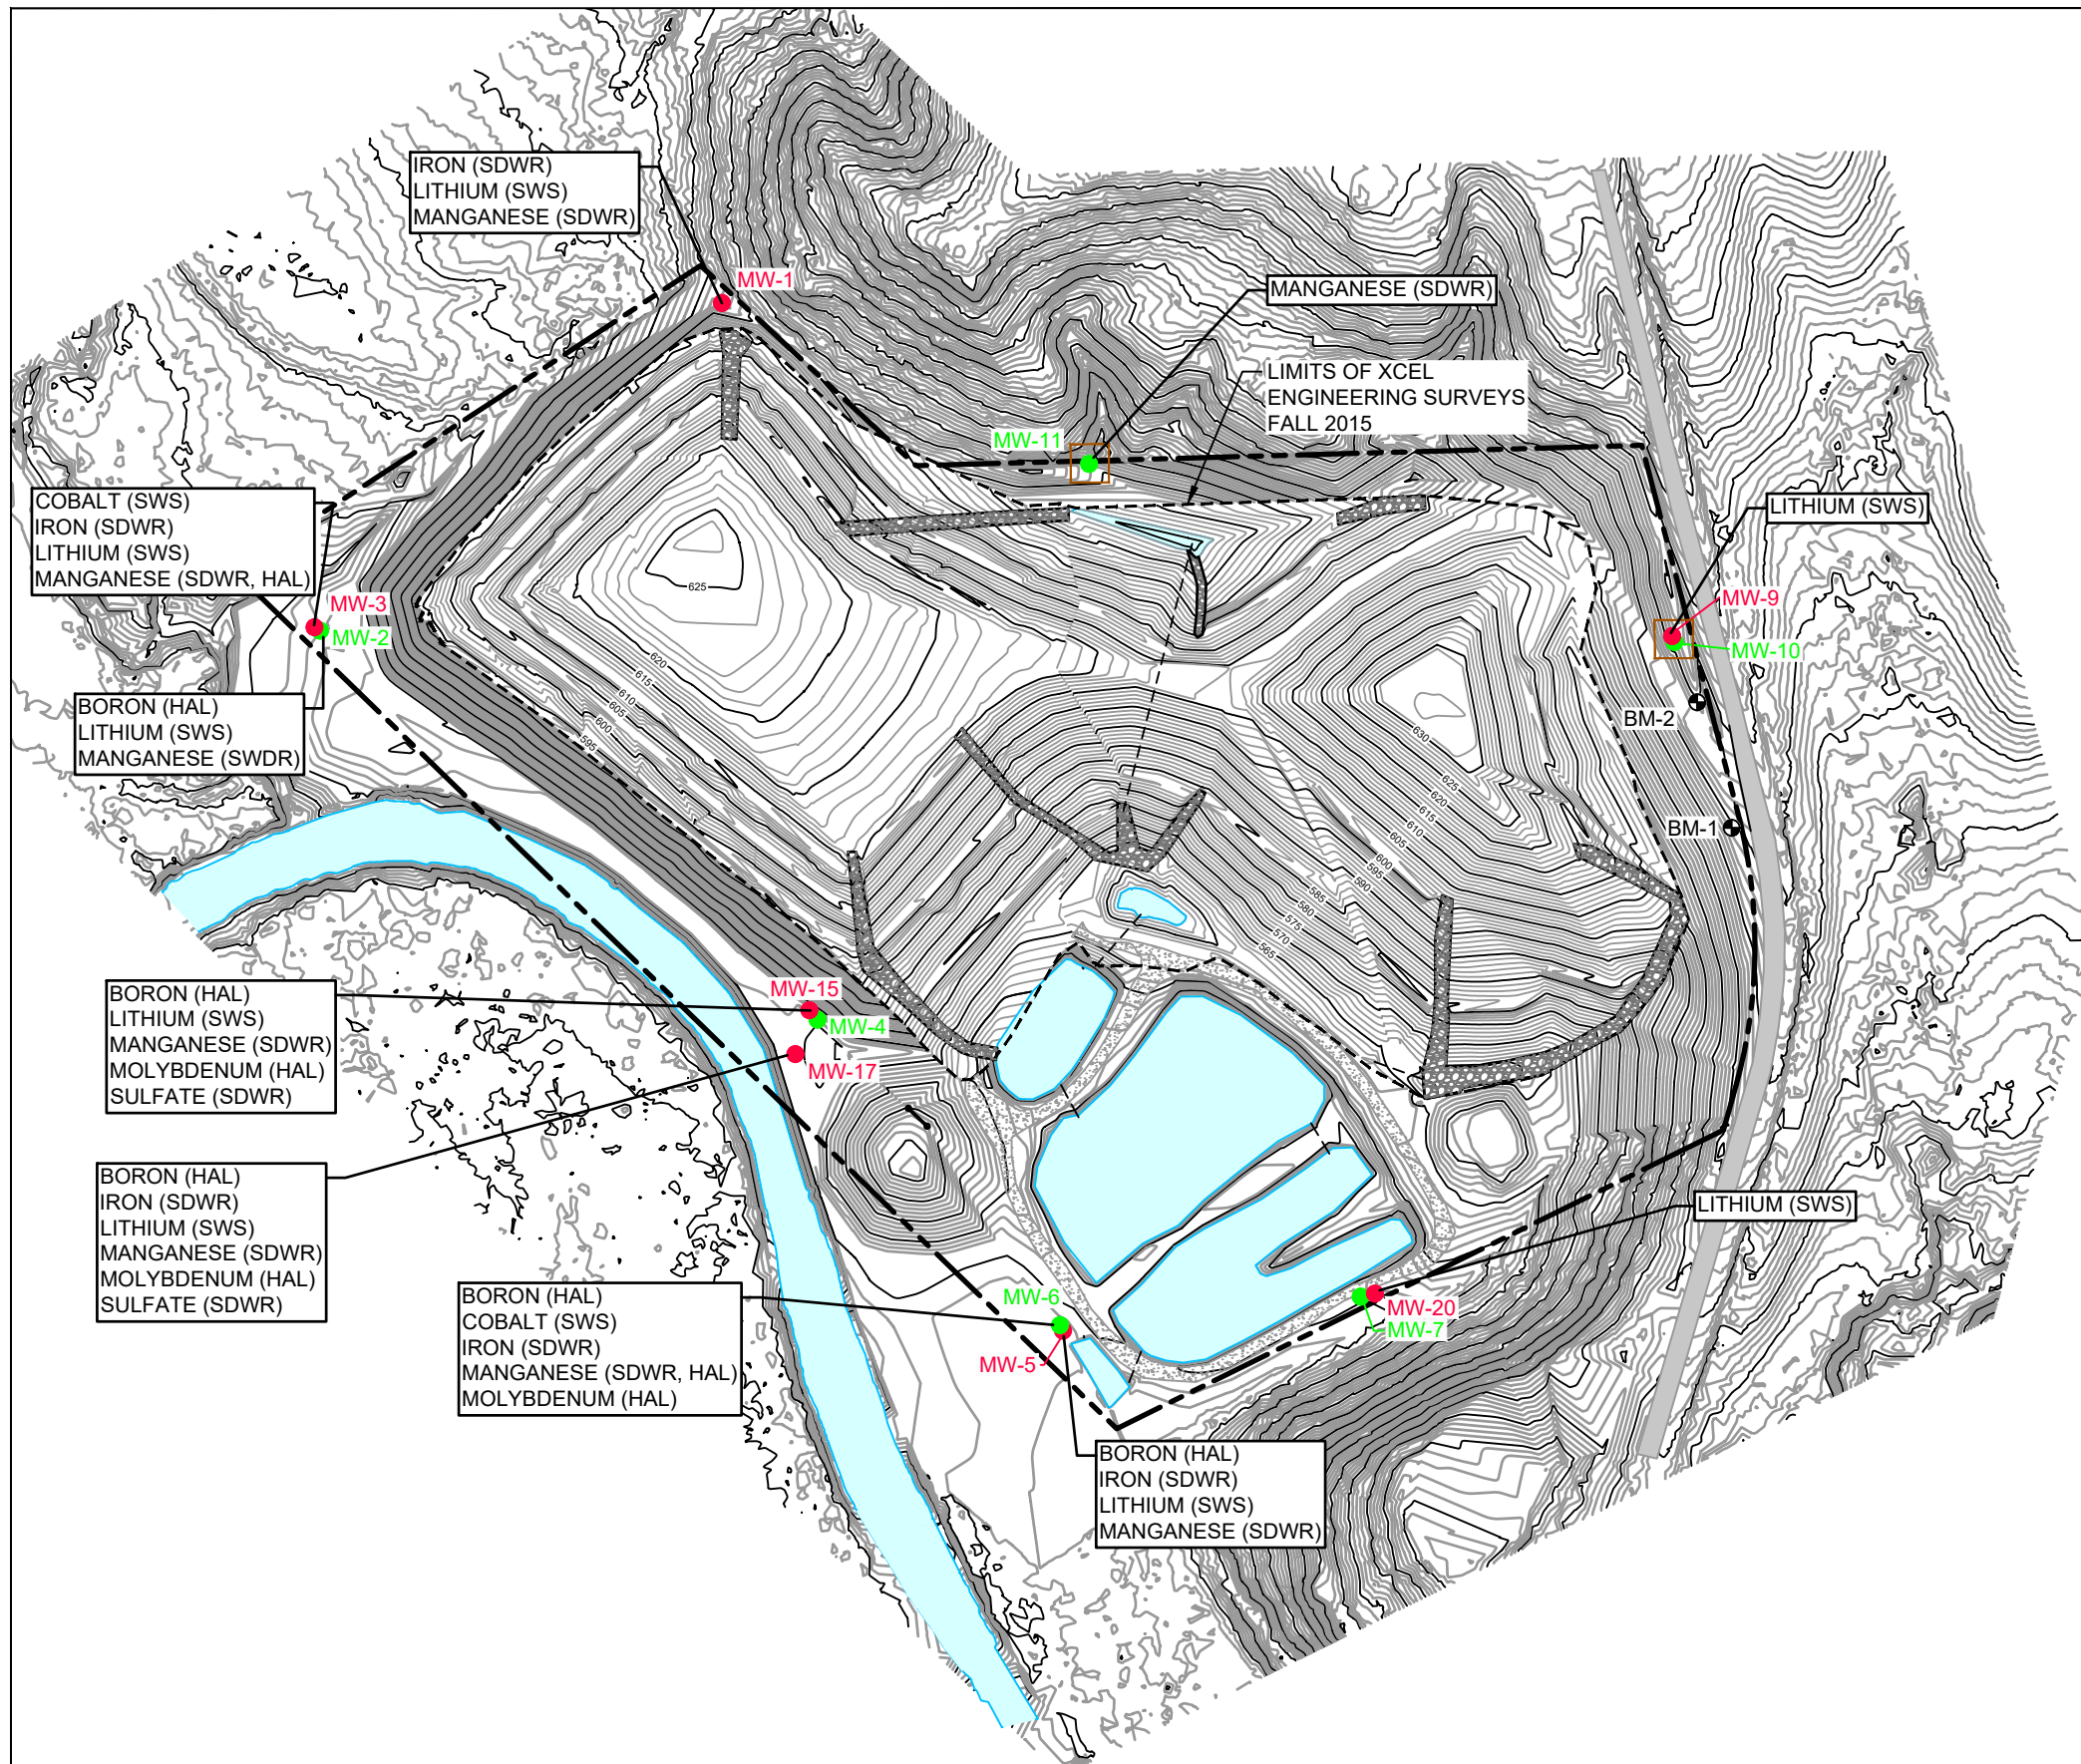

**LEGEND:**

- 650 — APPROXIMATE EXISTING GROUND SURFACE CONTOUR AND ELEVATION, FEET
- - - - - CULVERT
- — — — — PROPERTY LINE
- ▨ RIP-RAP
- ▬ PUBLIC ROAD
- MW-9 ● UPPERMOST AQUIFER MONITORING WELL LOCATION AND DESIGNATION
- MW-10 ● WATER TABLE MONITORING WELL LOCATION AND DESIGNATION
- DENOTES UPGRADIENT LOCATION
- HAL = HEALTH ADVISORY LEVEL
- SDWR = SECONDARY DRINKING WATER REGULATION
- SWS = STATEWIDE STANDARD

**DRAWING REFERENCE(S):**



DATE OF SURVEY: MULTIPLE SURVEYS BY: IOWA LIDAR PROJECT, XCEL ENGINEERING, AND SNYDER AND ASSOCIATES.

**BASIS OF BEARING:**

IOWA STATE PLANE SOUTH COORDINATE SYSTEM

**NOTES:**

1. LIDAR DATA WERE USED TO CREATE CONTOURS IN A 300' AREA OUTSIDE OF THE PROPERTY LINE. LIDAR DATA WERE OBTAINED FROM THE IOWA DEPARTMENT OF NATURAL RESOURCES. MAPPING WAS PERFORMED FROM 2008-2010 AND IS SHOWN IN THE NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD88). ACCURACY OF LIDAR DATA STATED AS ±8 INCHES BY IOWA DEPARTMENT OF NATURAL RESOURCES.
2. MW-4, MW-7, MW-10 USED FOR WATER LEVEL MEASUREMENT ONLY.
3. NO CONCENTRATION EXCEEDED A MAXIMUM CONTAMINANT LEVEL (MCL).




CENTRAL IOWA POWER COOPERATIVE  
 CIPSO FAIR STATION MONOFILL  
 ANNUAL WATER QUALITY REPORT  
**SUMMARY OF EXCEEDANCES OF  
 PUBLISHED STANDARDS  
 OCTOBER 2024**










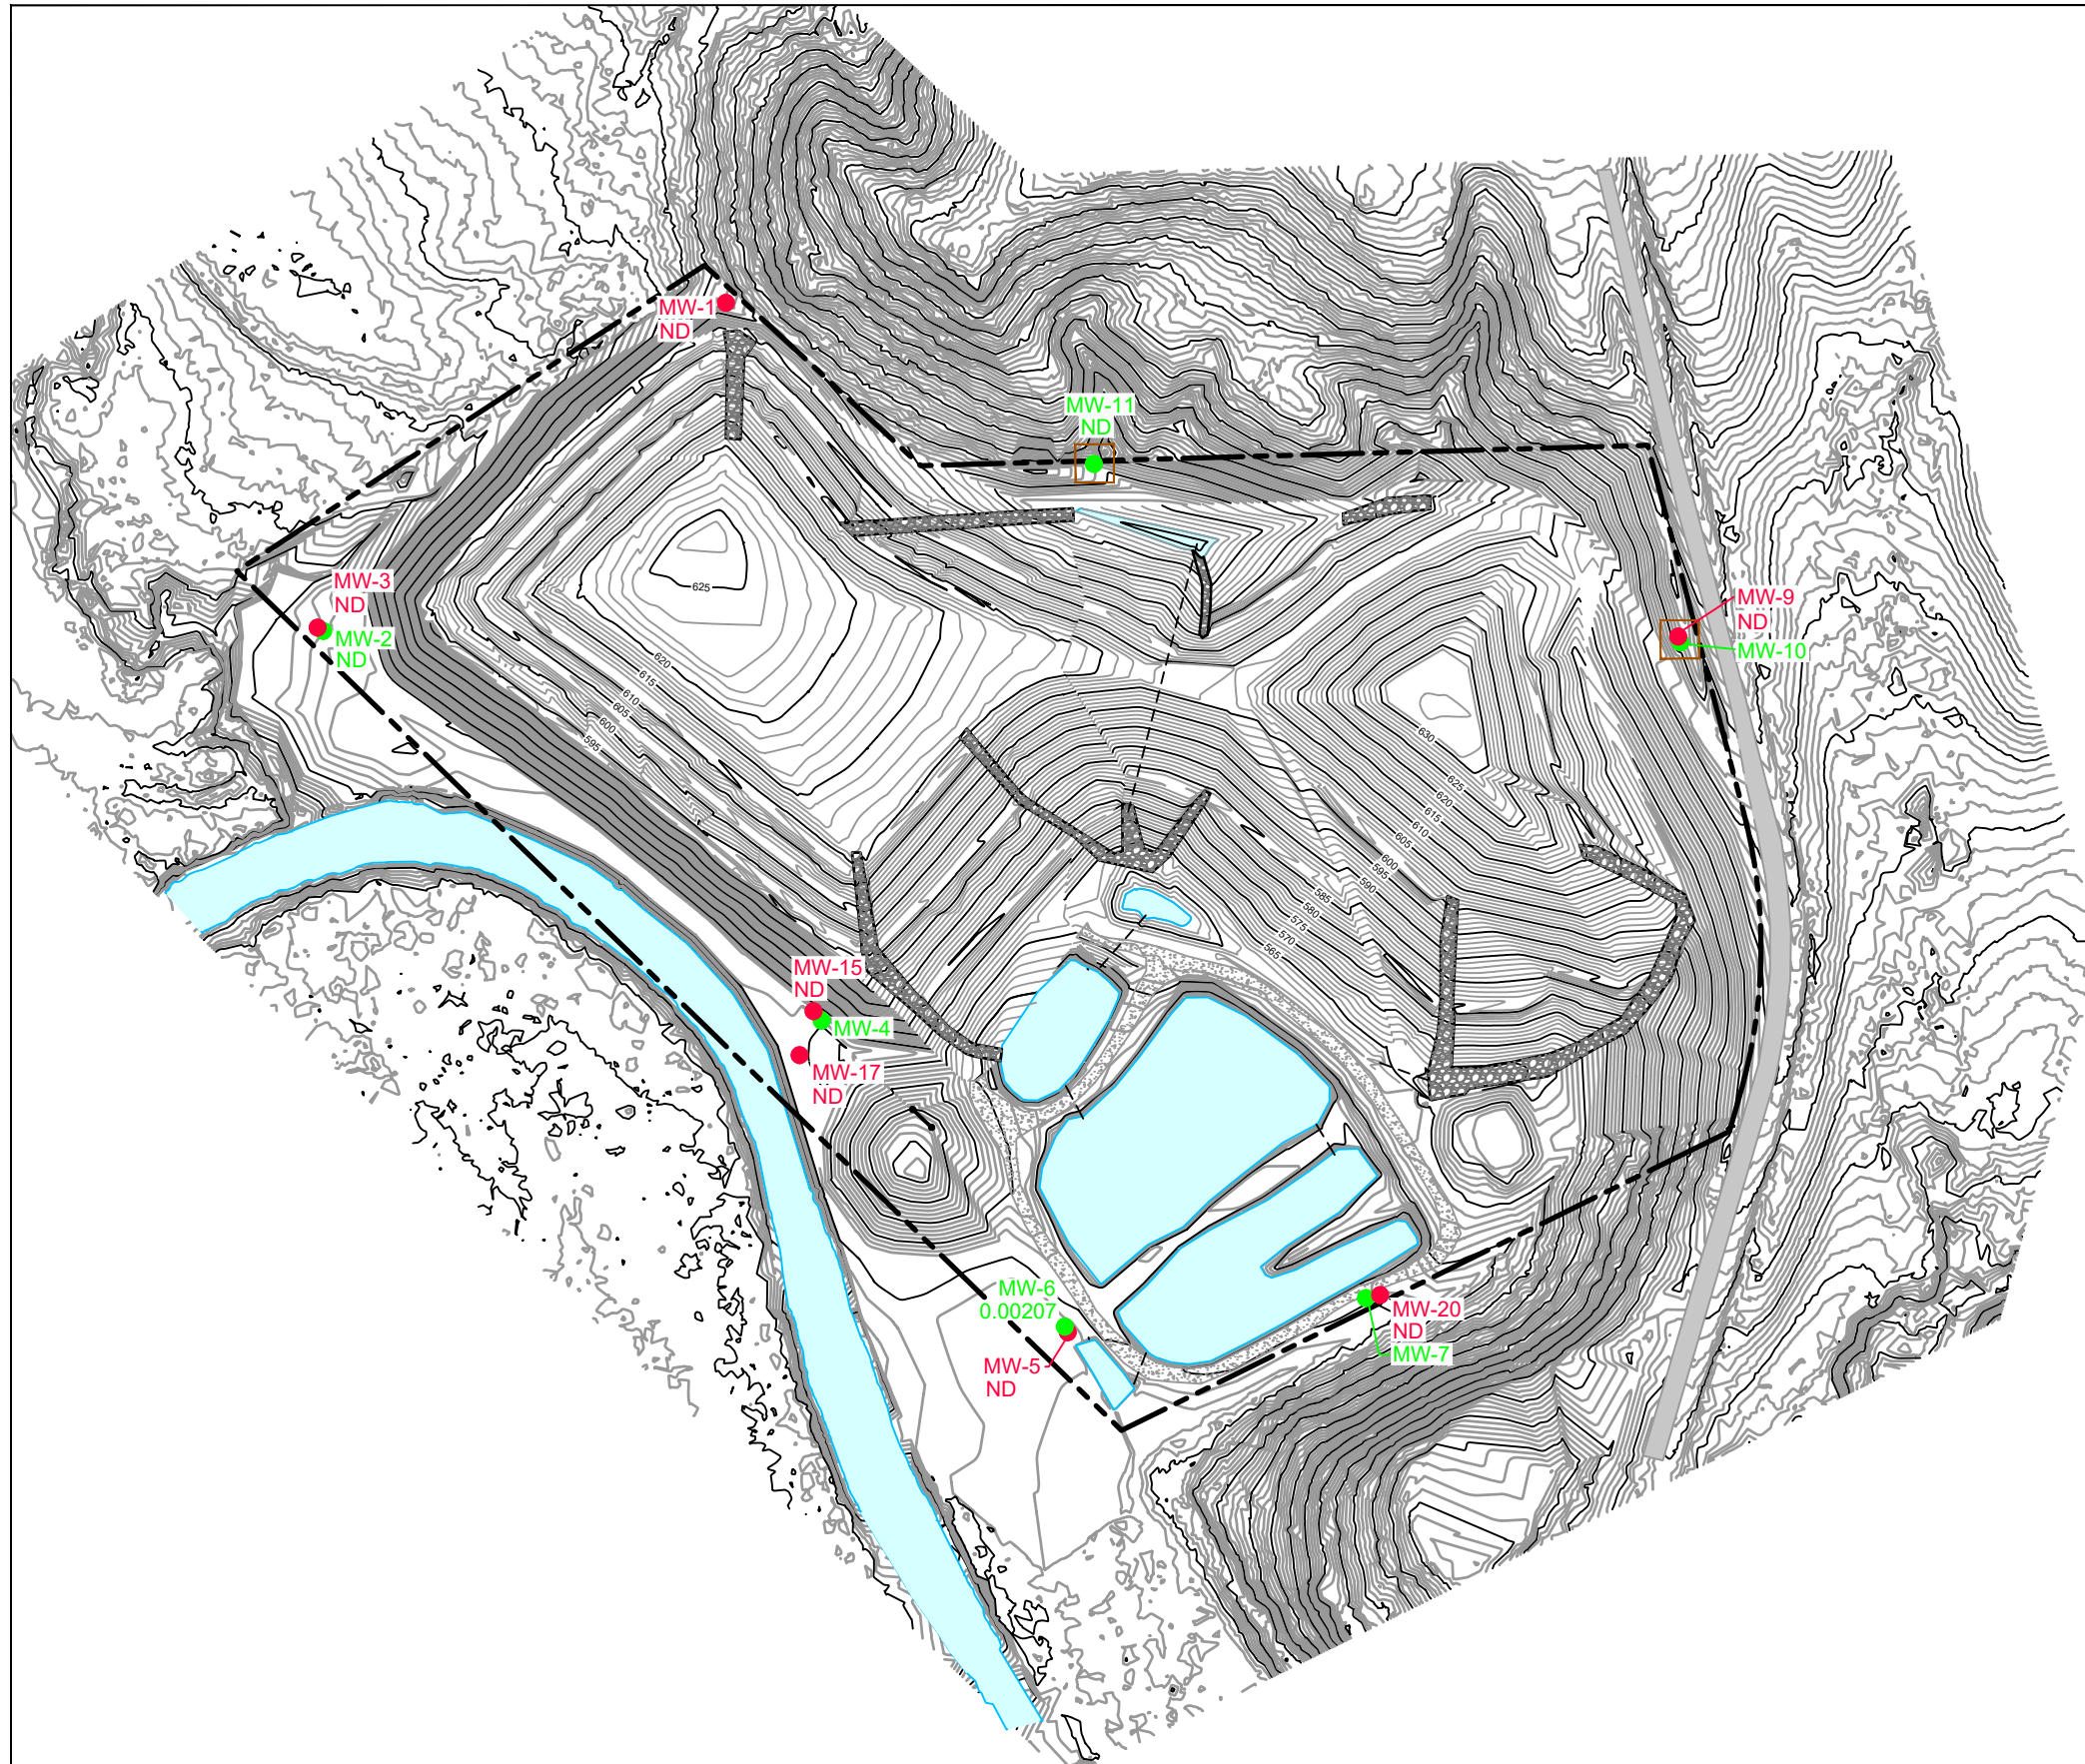

Project No. 12560436  
 Date November 2024

**FIGURE 5**





**LEGEND:**

-  APPROXIMATE EXISTING GROUND SURFACE CONTOUR AND ELEVATION, FEET
-  CULVERT
-  PROPERTY LINE
-  RIP-RAP
-  PUBLIC ROAD
-  MW-9 ● UPPERMOST AQUIFER MONITORING WELL LOCATION AND DESIGNATION
-  MW-10 ● WATER TABLE MONITORING WELL LOCATION AND DESIGNATION
-  DENOTES UPGRADIENT LOCATION
-  0.00630 ARSENIC CONCENTRATION (mg/L) OR NOT DETECTED (ND)
-  UPPERMOST AQUIFER ESTIMATED ISOCONCENTRATION
-  WATER TABLE AQUIFER ESTIMATED ISOCONCENTRATION

**DRAWING REFERENCE(S):**



DATE OF SURVEY: MULTIPLE  
 SURVEYS BY: IOWA LIDAR PROJECT, XCEL  
 ENGINEERING, AND SNYDER AND ASSOCIATES.

**BASIS OF BEARING:**

IOWA STATE PLANE SOUTH COORDINATE SYSTEM

**NOTES:**

1. LIDAR DATA WERE USED TO CREATE CONTOURS IN A 300' AREA OUTSIDE OF THE PROPERTY LINE. LIDAR DATA WERE OBTAINED FROM THE IOWA DEPARTMENT OF NATURAL RESOURCES. MAPPING WAS PERFORMED FROM 2008-2010 AND IS SHOWN IN THE NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD88). ACCURACY OF LIDAR DATA STATED AS ±8 INCHES BY IOWA DEPARTMENT OF NATURAL RESOURCES.
2. MW-4, MW-7, MW-10 USED FOR WATER LEVEL MEASUREMENT ONLY.




CENTRAL IOWA POWER COOPERATIVE  
 CIPCO FAIR STATION MONOFILL  
 ANNUAL WATER QUALITY REPORT

ARSENIC SAMPLE RESULTS  
 OCTOBER 2024

Project No. 12560436  
 Date November 2024

**FIGURE 6**



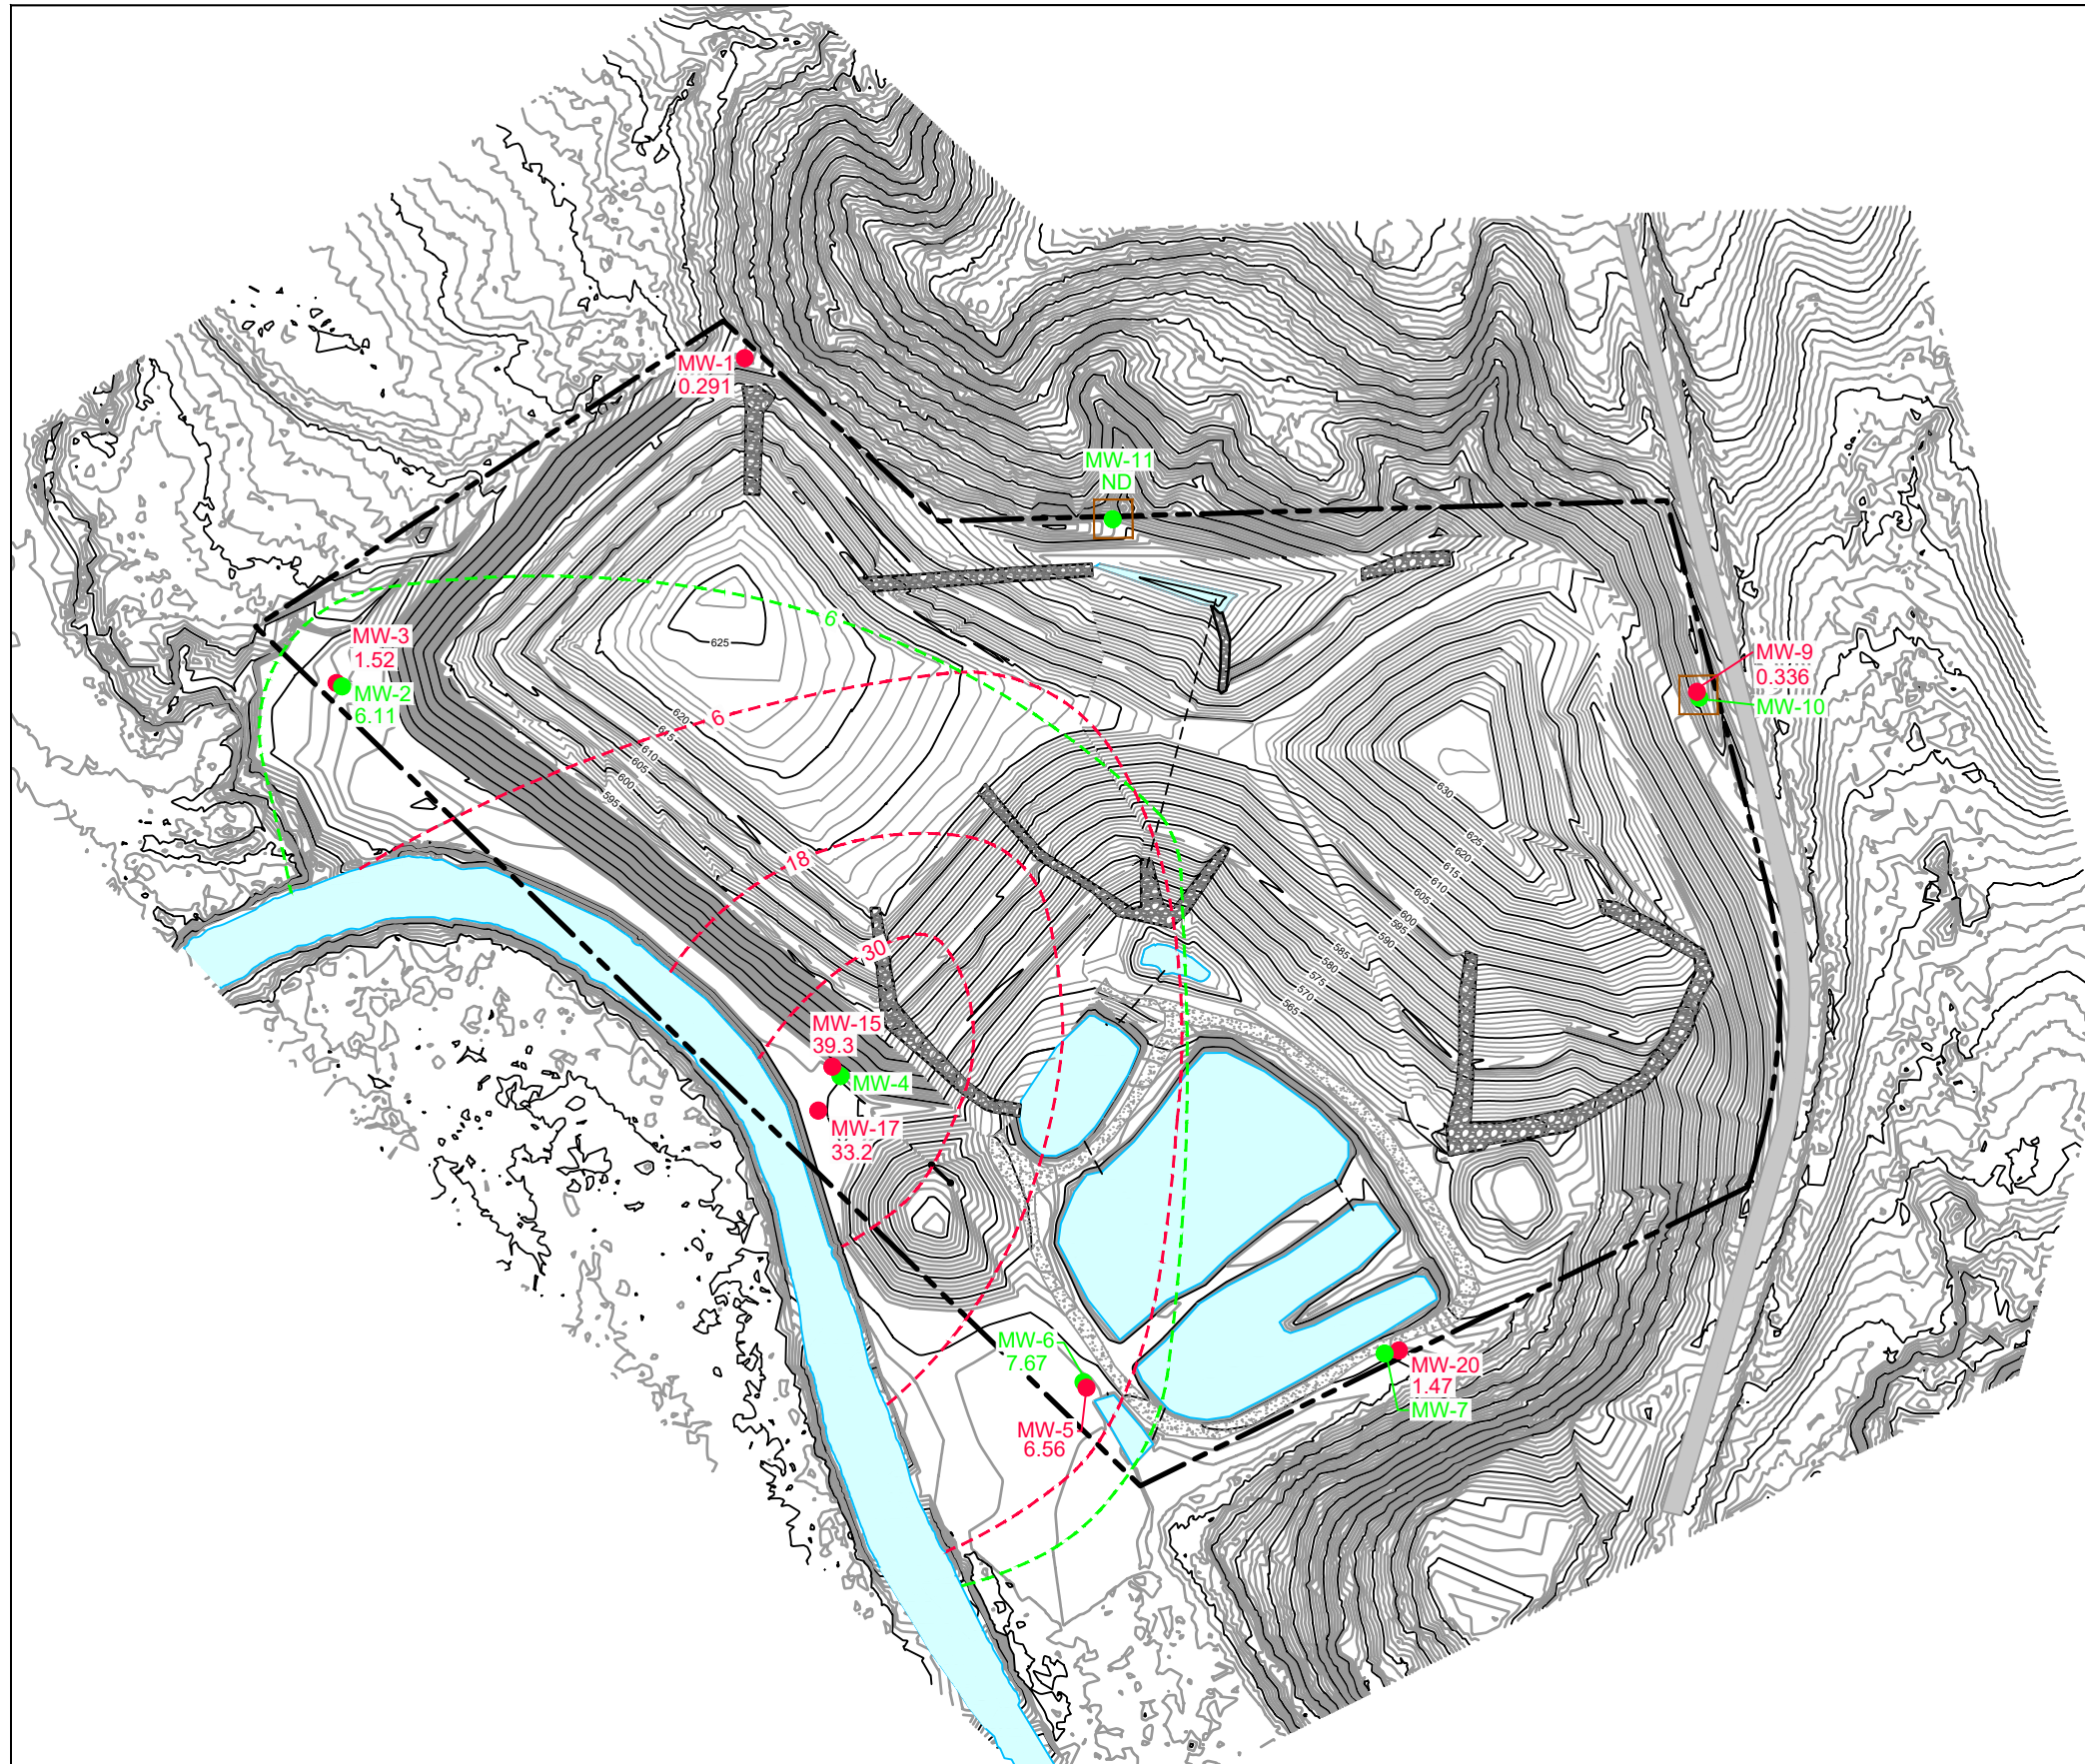

**LEGEND:**

- 650 — APPROXIMATE EXISTING GROUND SURFACE CONTOUR AND ELEVATION, FEET
- - - - - CULVERT
- - - - - PROPERTY LINE
- ▨ RIP-RAP
- ▬ PUBLIC ROAD
- MW-9 ● UPPERMOST AQUIFER MONITORING WELL LOCATION AND DESIGNATION
- MW-10 ● WATER TABLE MONITORING WELL LOCATION AND DESIGNATION
- DENOTES UPGRADIENT LOCATION
- 0.336 BORON CONCENTRATION (mg/L) OR NOT DETECTED (ND)
- - - - - UPPERMOST AQUIFER ESTIMATED ISOCONCENTRATION
- - - - - WATER TABLE AQUIFER ESTIMATED ISOCONCENTRATION

**DRAWING REFERENCE(S):**



DATE OF SURVEY: MULTIPLE  
 SURVEYS BY: IOWA LIDAR PROJECT, XCEL  
 ENGINEERING, AND SNYDER AND ASSOCIATES.

**BASIS OF BEARING:**

IOWA STATE PLANE SOUTH COORDINATE SYSTEM

**NOTES:**

1. LIDAR DATA WERE USED TO CREATE CONTOURS IN A 300' AREA OUTSIDE OF THE PROPERTY LINE. LIDAR DATA WERE OBTAINED FROM THE IOWA DEPARTMENT OF NATURAL RESOURCES. MAPPING WAS PERFORMED FROM 2008-2010 AND IS SHOWN IN THE NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD88). ACCURACY OF LIDAR DATA STATED AS ±8 INCHES BY IOWA DEPARTMENT OF NATURAL RESOURCES.
2. MW-4, MW-7, MW-10 USED FOR WATER LEVEL MEASUREMENT ONLY.




CENTRAL IOWA POWER COOPERATIVE  
 CIPCO FAIR STATION MONOFILL  
 ANNUAL WATER QUALITY REPORT

BORON SAMPLE RESULTS  
 OCTOBER 2024










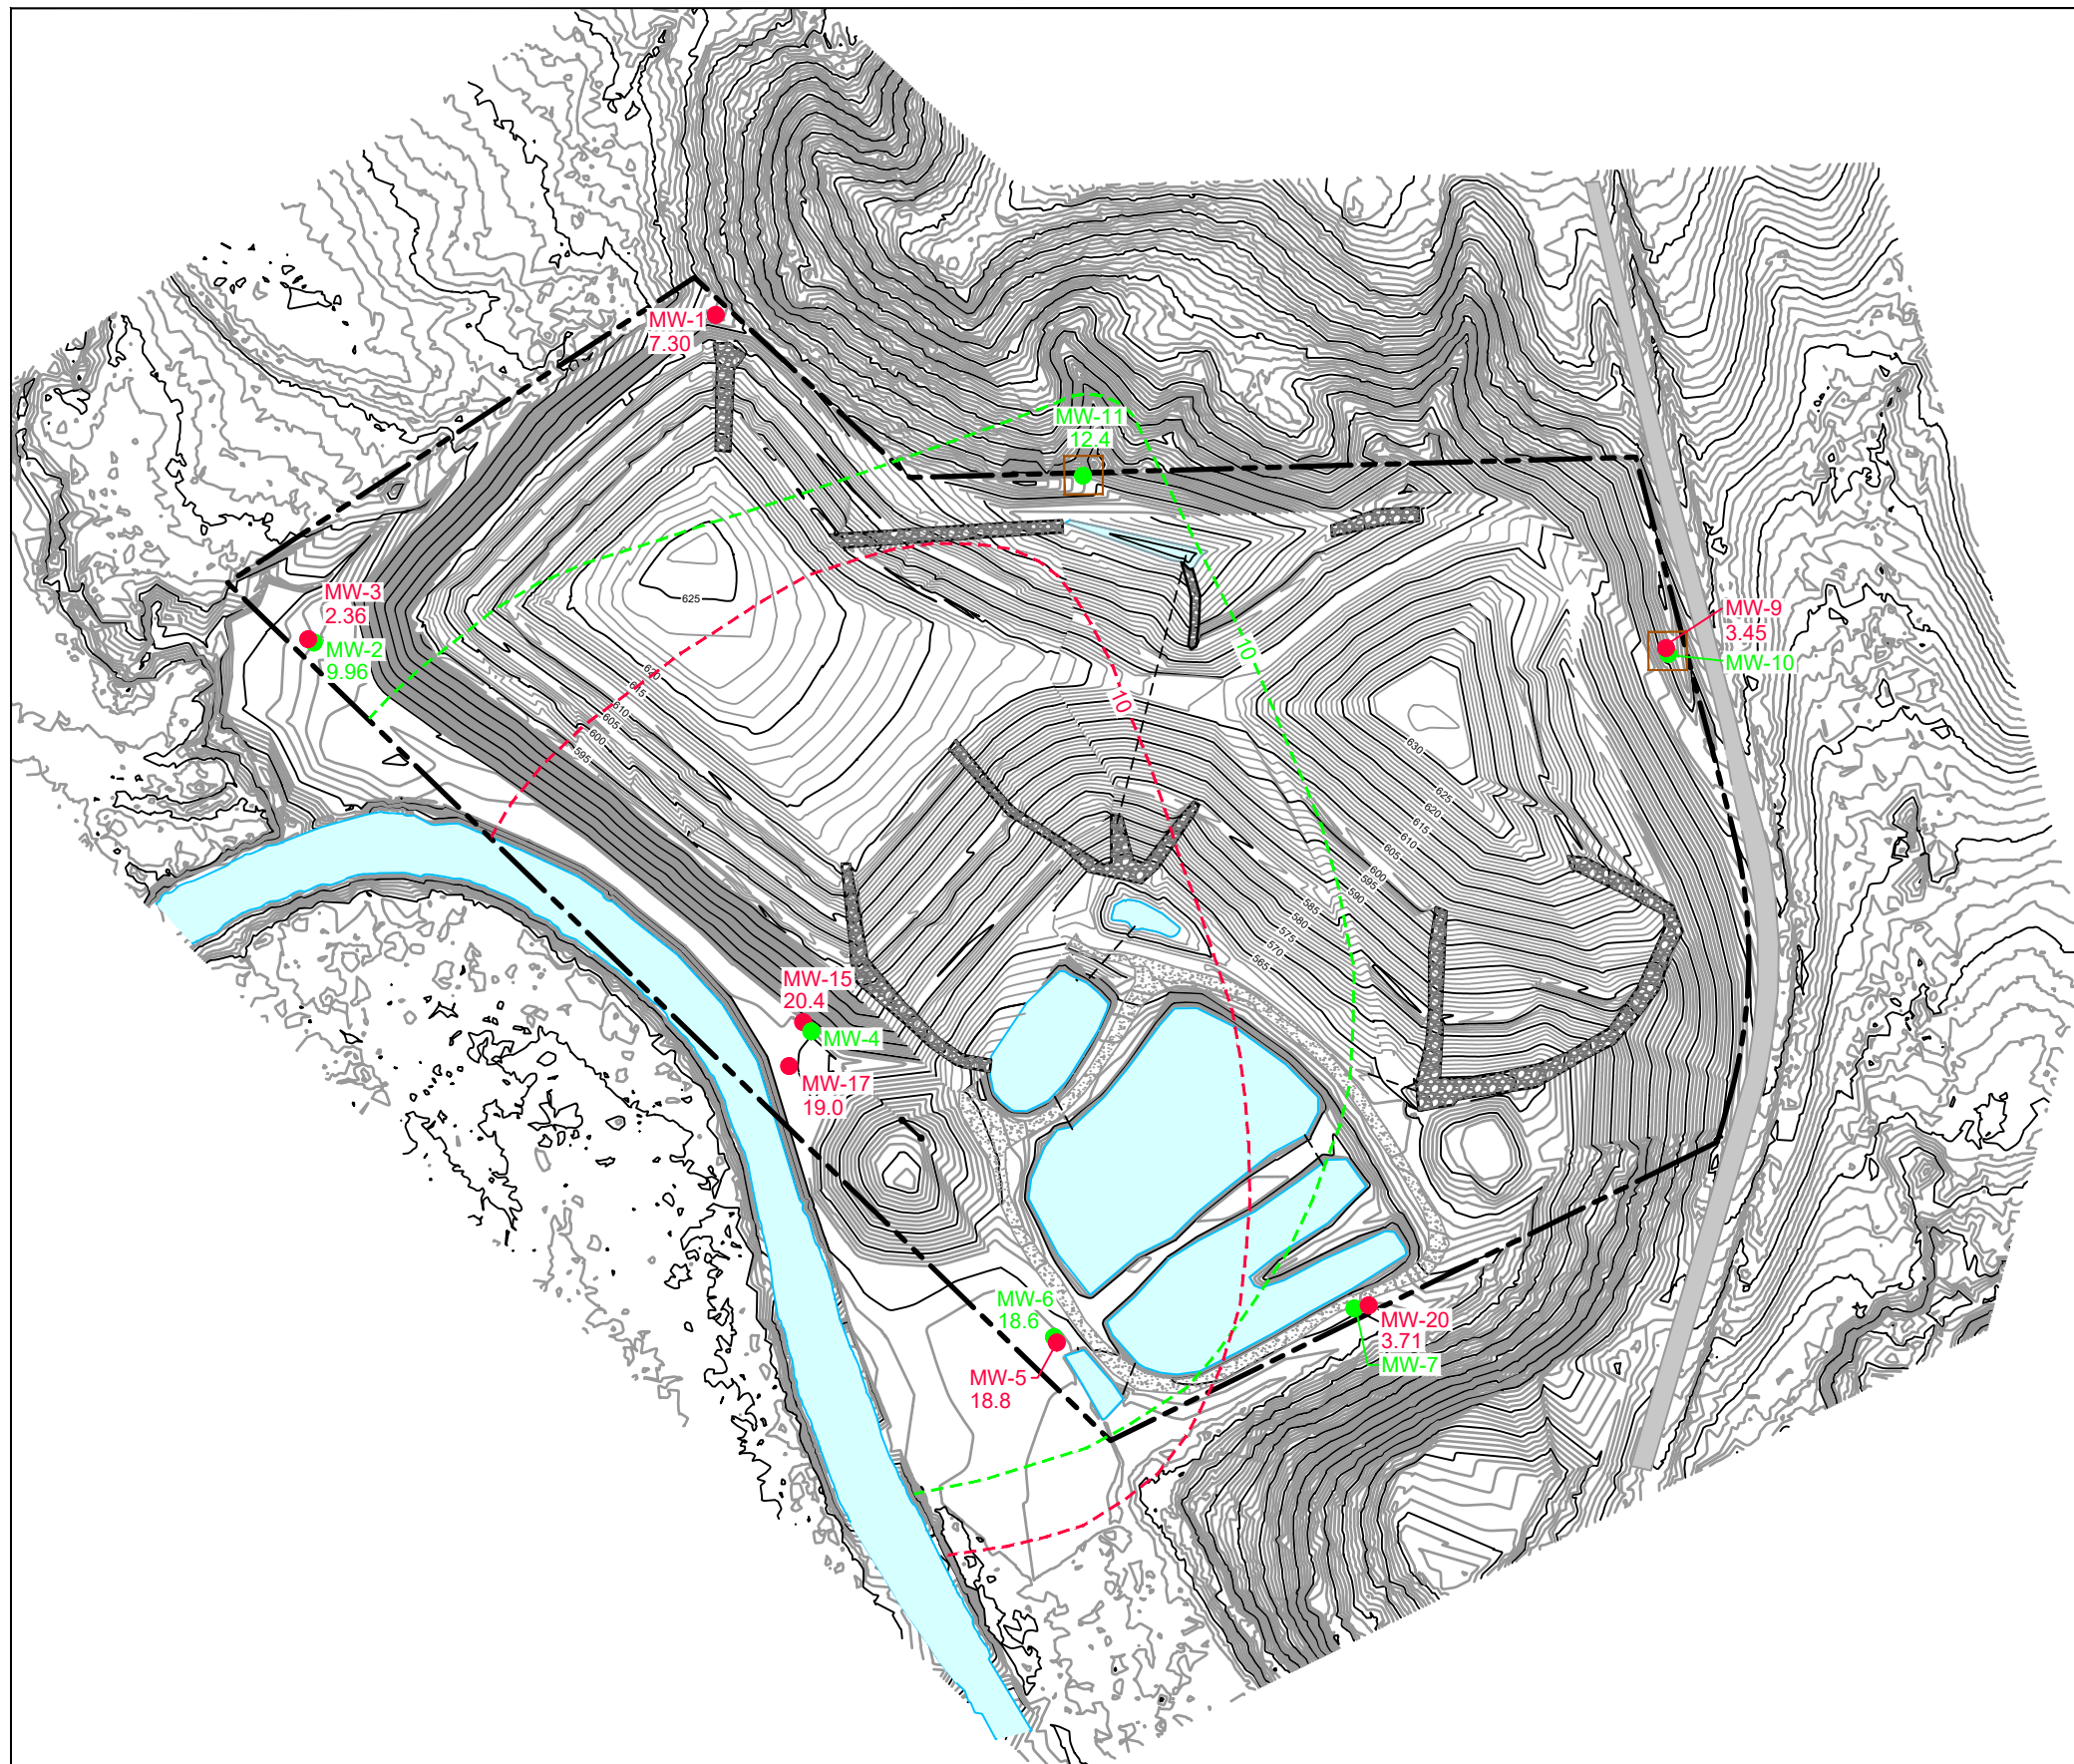

Project No. 12560436  
 Date November 2024

**FIGURE 7**





**LEGEND:**

-  APPROXIMATE EXISTING GROUND SURFACE CONTOUR AND ELEVATION, FEET
-  CULVERT
-  PROPERTY LINE
-  RIP-RAP
-  PUBLIC ROAD
-  MW-9 ● UPPERMOST AQUIFER MONITORING WELL LOCATION AND DESIGNATION
-  MW-10 ● WATER TABLE MONITORING WELL LOCATION AND DESIGNATION
-  DENOTES UPGRADIENT LOCATION
-  3.45 CHLORIDE CONCENTRATION (mg/L) OR NOT DETECTED (ND)
-  UPPERMOST AQUIFER ESTIMATED ISOCONCENTRATION
-  WATER TABLE AQUIFER ESTIMATED ISOCONCENTRATION

**DRAWING REFERENCE(S):**



DATE OF SURVEY: MULTIPLE  
 SURVEYS BY: IOWA LIDAR PROJECT, XCEL  
 ENGINEERING, AND SNYDER AND ASSOCIATES.

**BASIS OF BEARING:**

IOWA STATE PLANE SOUTH COORDINATE SYSTEM

**NOTES:**

1. LIDAR DATA WERE USED TO CREATE CONTOURS IN A 300' AREA OUTSIDE OF THE PROPERTY LINE. LIDAR DATA WERE OBTAINED FROM THE IOWA DEPARTMENT OF NATURAL RESOURCES. MAPPING WAS PERFORMED FROM 2008-2010 AND IS SHOWN IN THE NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD88). ACCURACY OF LIDAR DATA STATED AS ±8 INCHES BY IOWA DEPARTMENT OF NATURAL RESOURCES.
2. MW-4, MW-7, MW-10 USED FOR WATER LEVEL MEASUREMENT ONLY.




CENTRAL IOWA POWER COOPERATIVE  
 CIPCO FAIR STATION MONOFILL  
 ANNUAL WATER QUALITY REPORT

CHLORIDE SAMPLE RESULTS  
 OCTOBER 2024

Project No. 12560436  
 Date November 2024

**FIGURE 8**



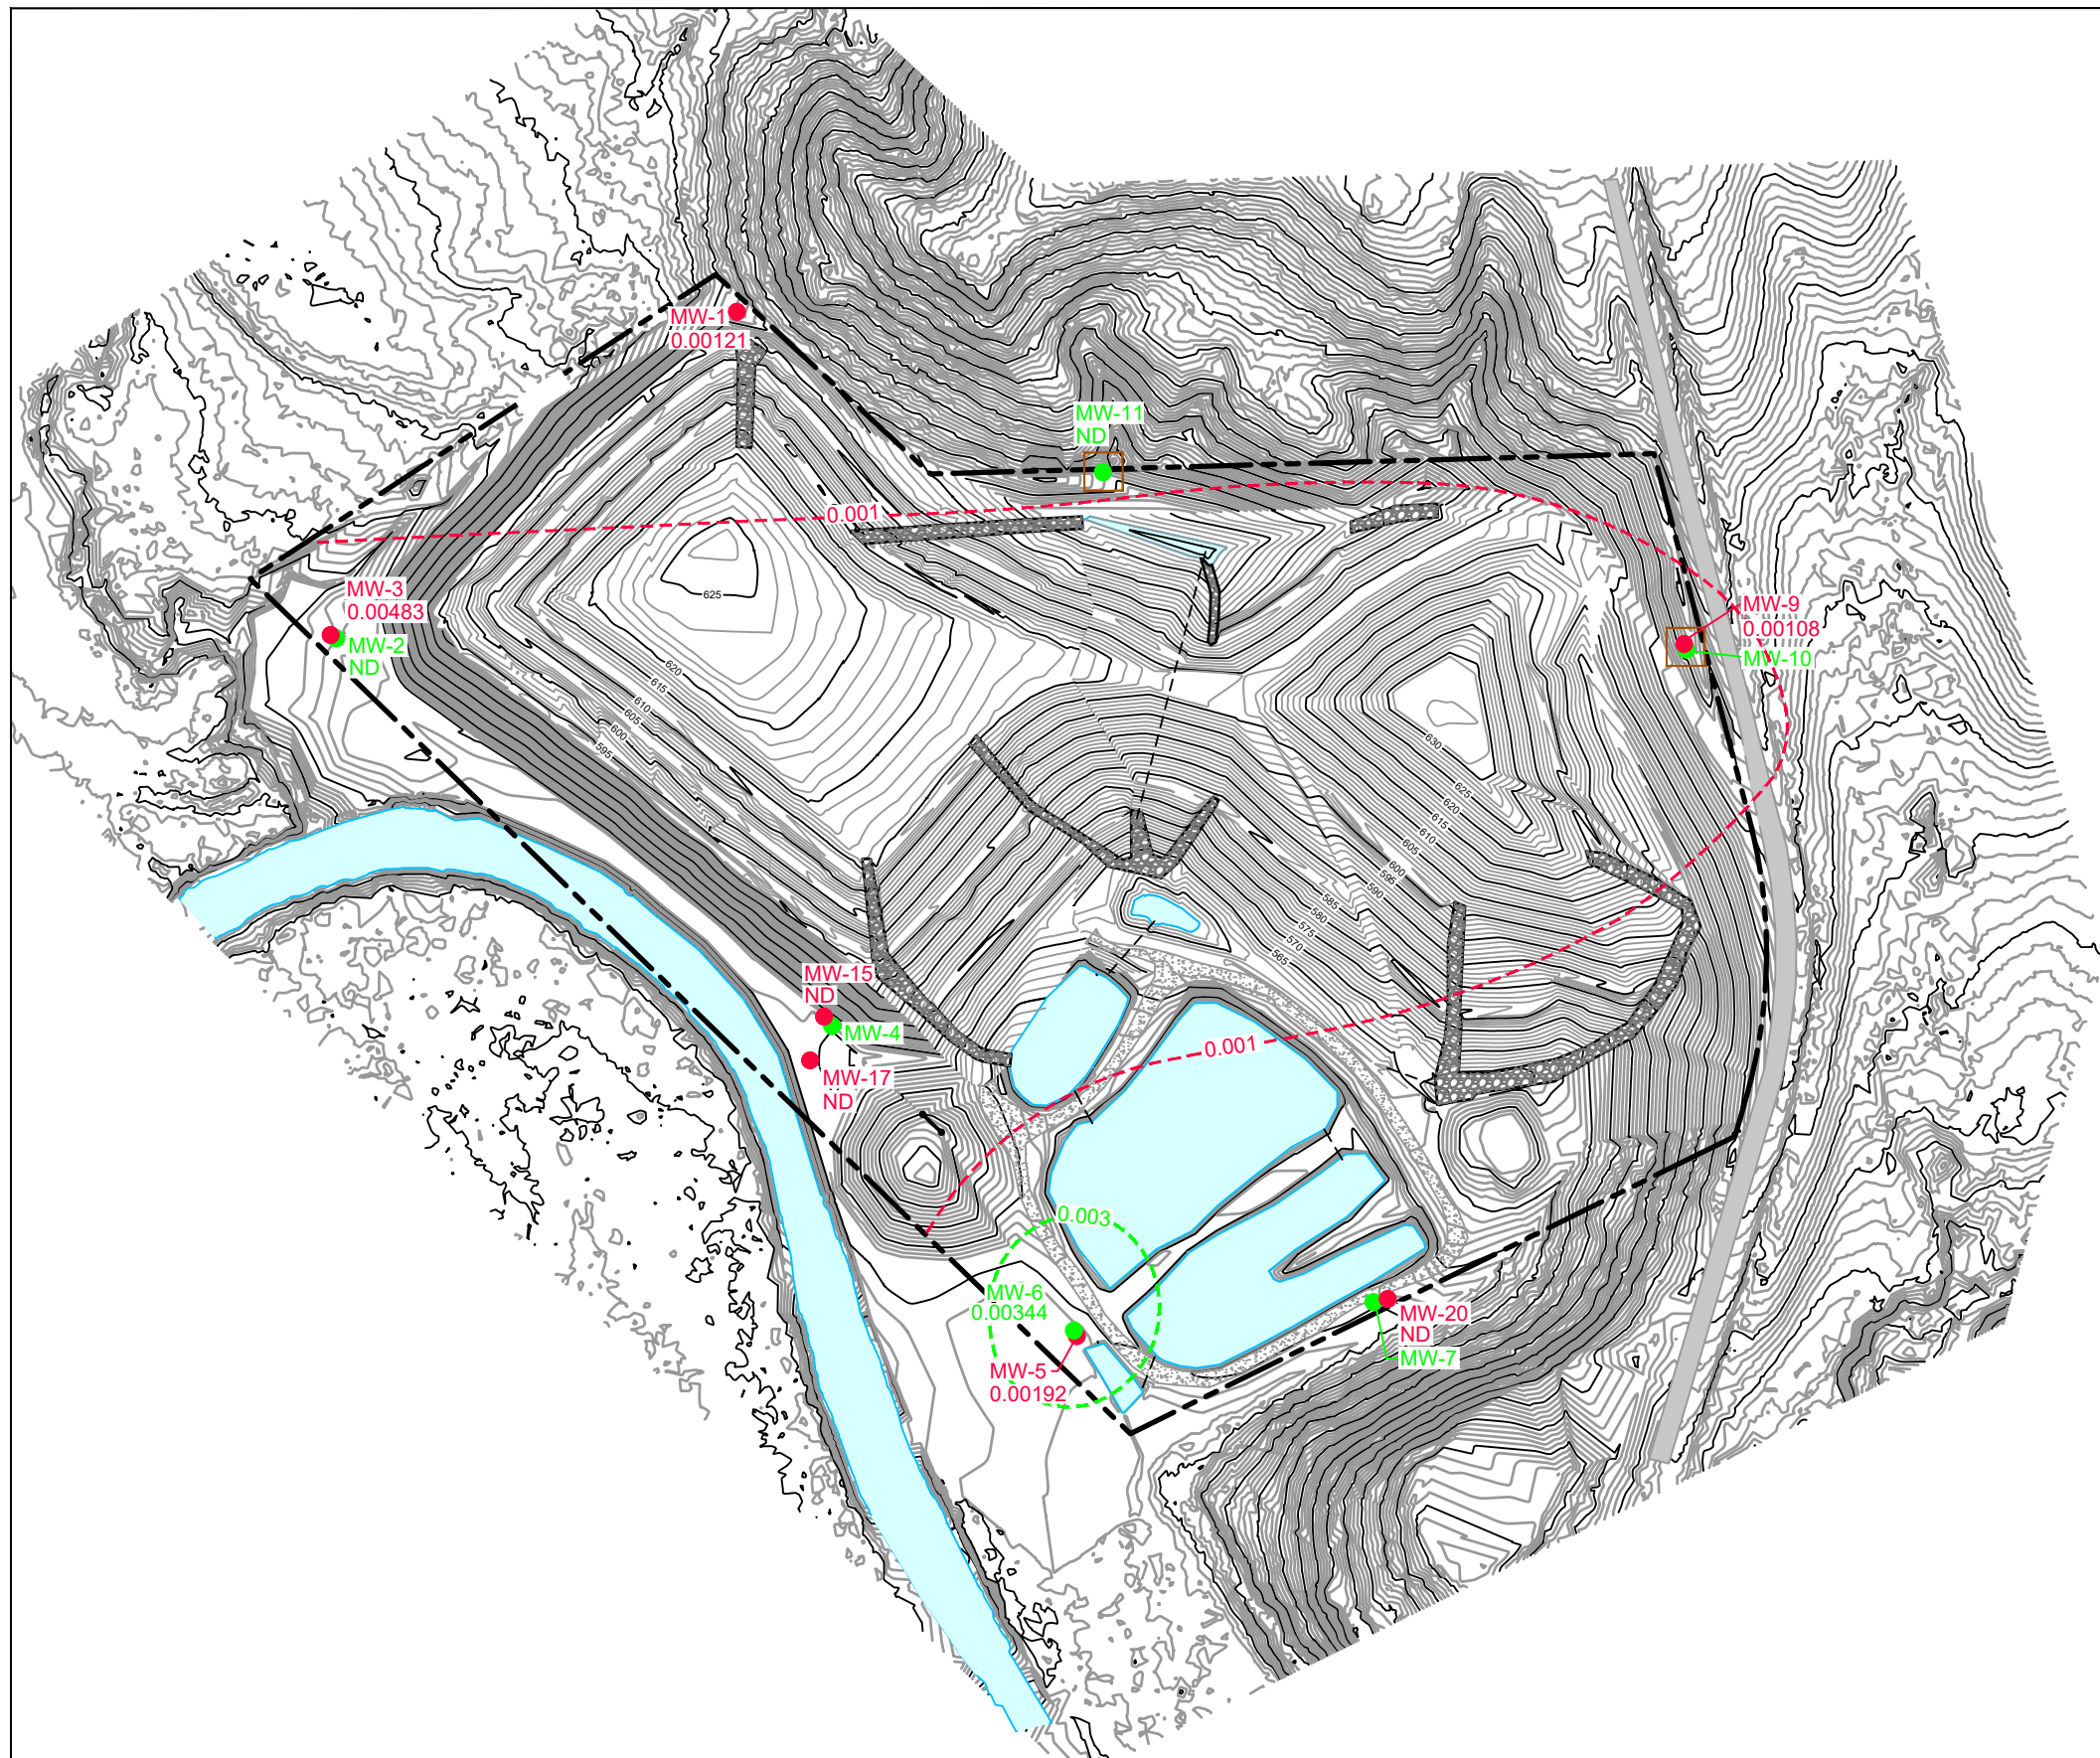

**LEGEND:**

- APPROXIMATE EXISTING GROUND SURFACE CONTOUR AND ELEVATION, FEET
- CULVERT
- PROPERTY LINE
- RIP-RAP
- PUBLIC ROAD
- MW-9 ● UPPERMOST AQUIFER MONITORING WELL LOCATION AND DESIGNATION
- MW-10 ● WATER TABLE MONITORING WELL LOCATION AND DESIGNATION
- DENOTES UPGRADIENT LOCATION
- COBALT CONCENTRATION (mg/L) OR NOT DETECTED (ND)
- UPPERMOST AQUIFER ESTIMATED ISOCONCENTRATION
- WATER TABLE AQUIFER ESTIMATED ISOCONCENTRATION

**DRAWING REFERENCE(S):**



DATE OF SURVEY: MULTIPLE  
 SURVEYS BY: IOWA LIDAR PROJECT, XCEL  
 ENGINEERING, AND SNYDER AND ASSOCIATES.

**BASIS OF BEARING:**

IOWA STATE PLANE SOUTH COORDINATE SYSTEM

**NOTES:**

1. LIDAR DATA WERE USED TO CREATE CONTOURS IN A 300' AREA OUTSIDE OF THE PROPERTY LINE. LIDAR DATA WERE OBTAINED FROM THE IOWA DEPARTMENT OF NATURAL RESOURCES. MAPPING WAS PERFORMED FROM 2008-2010 AND IS SHOWN IN THE NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD88). ACCURACY OF LIDAR DATA STATED AS ±8 INCHES BY IOWA DEPARTMENT OF NATURAL RESOURCES.
2. MW-4, MW-7, MW-10 USED FOR WATER LEVEL MEASUREMENT ONLY.



CENTRAL IOWA POWER COOPERATIVE  
 CIPCO FAIR STATION MONOFILL  
 ANNUAL WATER QUALITY REPORT

COBALT SAMPLE RESULTS  
 OCTOBER 2024

Project No. 12560436  
 Date November 2024

**FIGURE 9**





**LEGEND:**

- 650 APPROXIMATE EXISTING GROUND SURFACE CONTOUR AND ELEVATION, FEET
- CULVERT
- PROPERTY LINE
- RIP-RAP
- PUBLIC ROAD
- MW-9 UPPERMOST AQUIFER MONITORING WELL LOCATION AND DESIGNATION
- MW-10 WATER TABLE MONITORING WELL LOCATION AND DESIGNATION
- DENOTES UPGRADIENT LOCATION
- 1.92 IRON CONCENTRATION (mg/L) OR NOT DETECTED (ND)
- UPPERMOST AQUIFER ESTIMATED ISOCONCENTRATION
- WATER TABLE AQUIFER ESTIMATED ISOCONCENTRATION

**DRAWING REFERENCE(S):**



DATE OF SURVEY: MULTIPLE  
 SURVEYS BY: IOWA LIDAR PROJECT, XCEL ENGINEERING, AND SNYDER AND ASSOCIATES.

**BASIS OF BEARING:**

IOWA STATE PLANE SOUTH COORDINATE SYSTEM

**NOTES:**

- LIDAR DATA WERE USED TO CREATE CONTOURS IN A 300' AREA OUTSIDE OF THE PROPERTY LINE. LIDAR DATA WERE OBTAINED FROM THE IOWA DEPARTMENT OF NATURAL RESOURCES. MAPPING WAS PERFORMED FROM 2008-2010 AND IS SHOWN IN THE NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD88). ACCURACY OF LIDAR DATA STATED AS ±8 INCHES BY IOWA DEPARTMENT OF NATURAL RESOURCES.
- MW-4, MW-7, MW-10 USED FOR WATER LEVEL MEASUREMENT ONLY.




CENTRAL IOWA POWER COOPERATIVE  
 CIPCO FAIR STATION MONOFILL  
 ANNUAL WATER QUALITY REPORT

IRON SAMPLE RESULTS  
 OCTOBER 2024

Project No. 12560436  
 Date November 2024

**FIGURE 10**



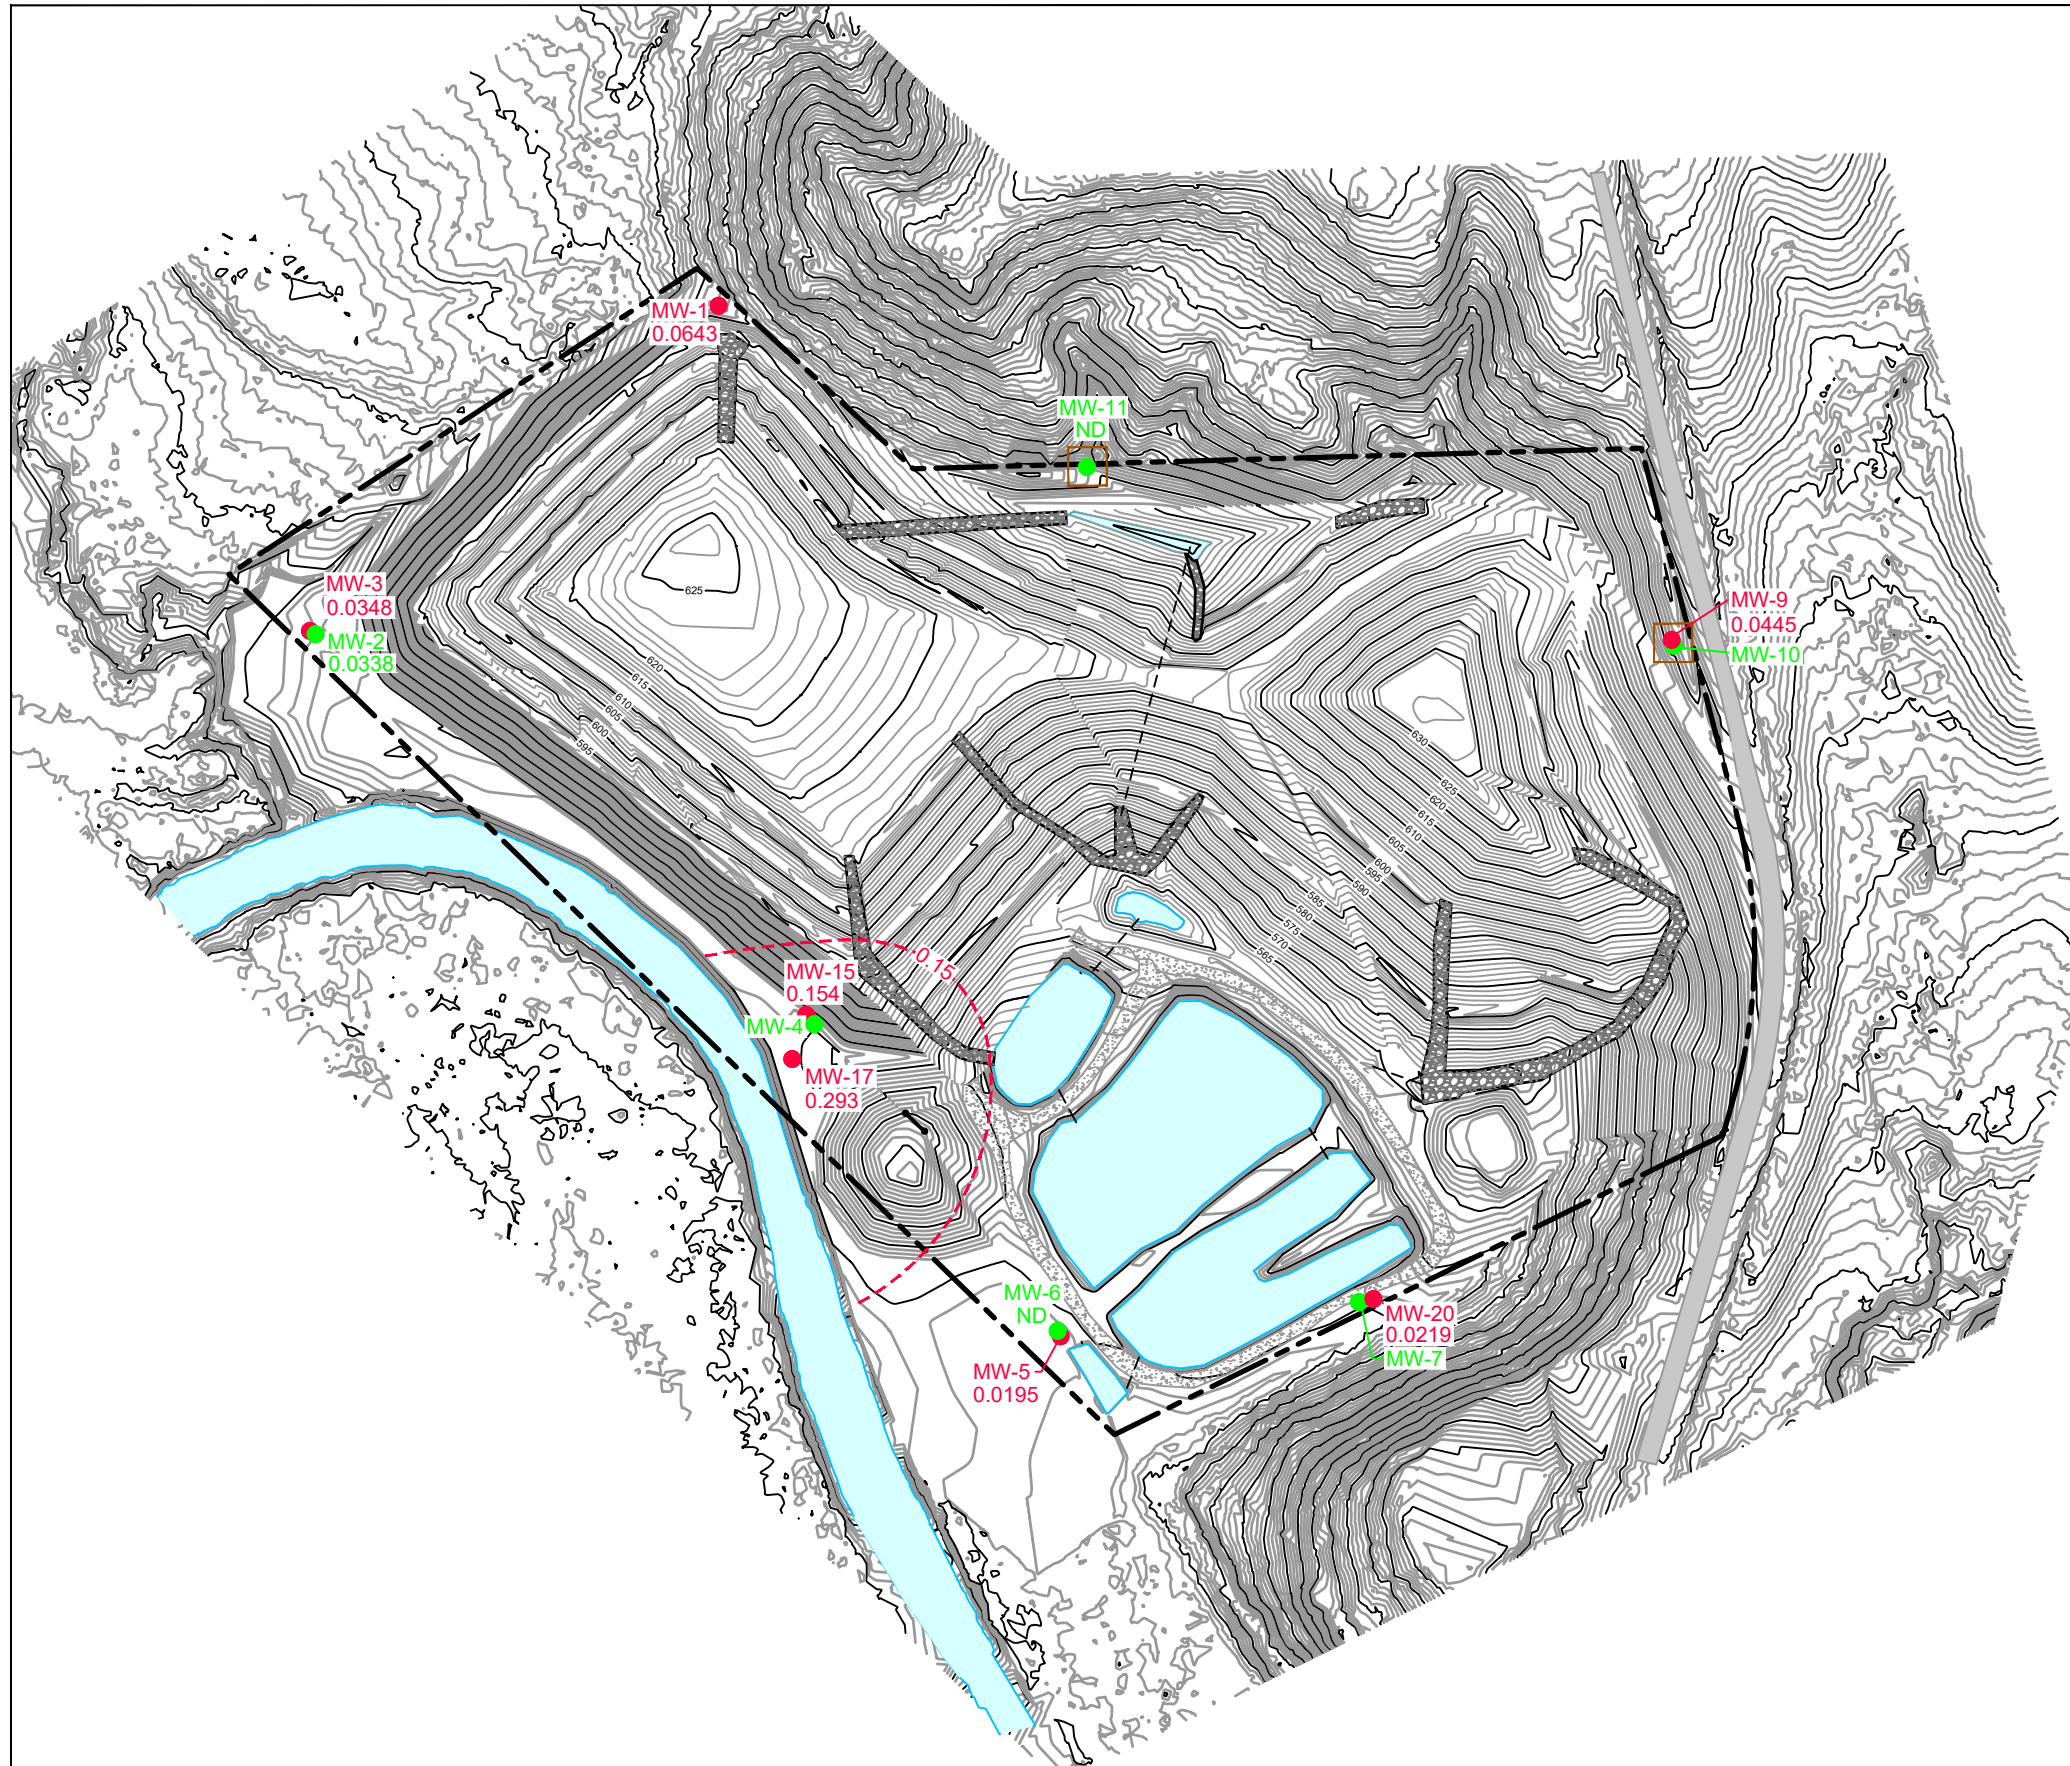

**LEGEND:**

- 650 — APPROXIMATE EXISTING GROUND SURFACE CONTOUR AND ELEVATION, FEET
- - - - - CULVERT
- - - - - PROPERTY LINE
- ▨ RIP-RAP
- ▬ PUBLIC ROAD
- MW-9 ● UPPERMOST AQUIFER MONITORING WELL LOCATION AND DESIGNATION
- MW-10 ● WATER TABLE MONITORING WELL LOCATION AND DESIGNATION
- DENOTES UPGRADIENT LOCATION
- 0.0445 LITHIUM CONCENTRATION (mg/L) OR NOT DETECTED (ND)
- - - - - UPPERMOST AQUIFER ESTIMATED ISOCONCENTRATION
- - - - - WATER TABLE AQUIFER ESTIMATED ISOCONCENTRATION

**DRAWING REFERENCE(S):**



DATE OF SURVEY: MULTIPLE SURVEYS BY: IOWA LIDAR PROJECT, XCEL ENGINEERING, AND SNYDER AND ASSOCIATES.

**BASIS OF BEARING:**

IOWA STATE PLANE SOUTH COORDINATE SYSTEM

**NOTES:**

1. LIDAR DATA WERE USED TO CREATE CONTOURS IN A 300' AREA OUTSIDE OF THE PROPERTY LINE. LIDAR DATA WERE OBTAINED FROM THE IOWA DEPARTMENT OF NATURAL RESOURCES. MAPPING WAS PERFORMED FROM 2008-2010 AND IS SHOWN IN THE NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD88). ACCURACY OF LIDAR DATA STATED AS ±8 INCHES BY IOWA DEPARTMENT OF NATURAL RESOURCES.
2. MW-4, MW-7, MW-10 USED FOR WATER LEVEL MEASUREMENT ONLY.




CENTRAL IOWA POWER COOPERATIVE  
CIPCO FAIR STATION MONOFILL  
ANNUAL WATER QUALITY REPORT

LITHIUM SAMPLE RESULTS  
OCTOBER 2024









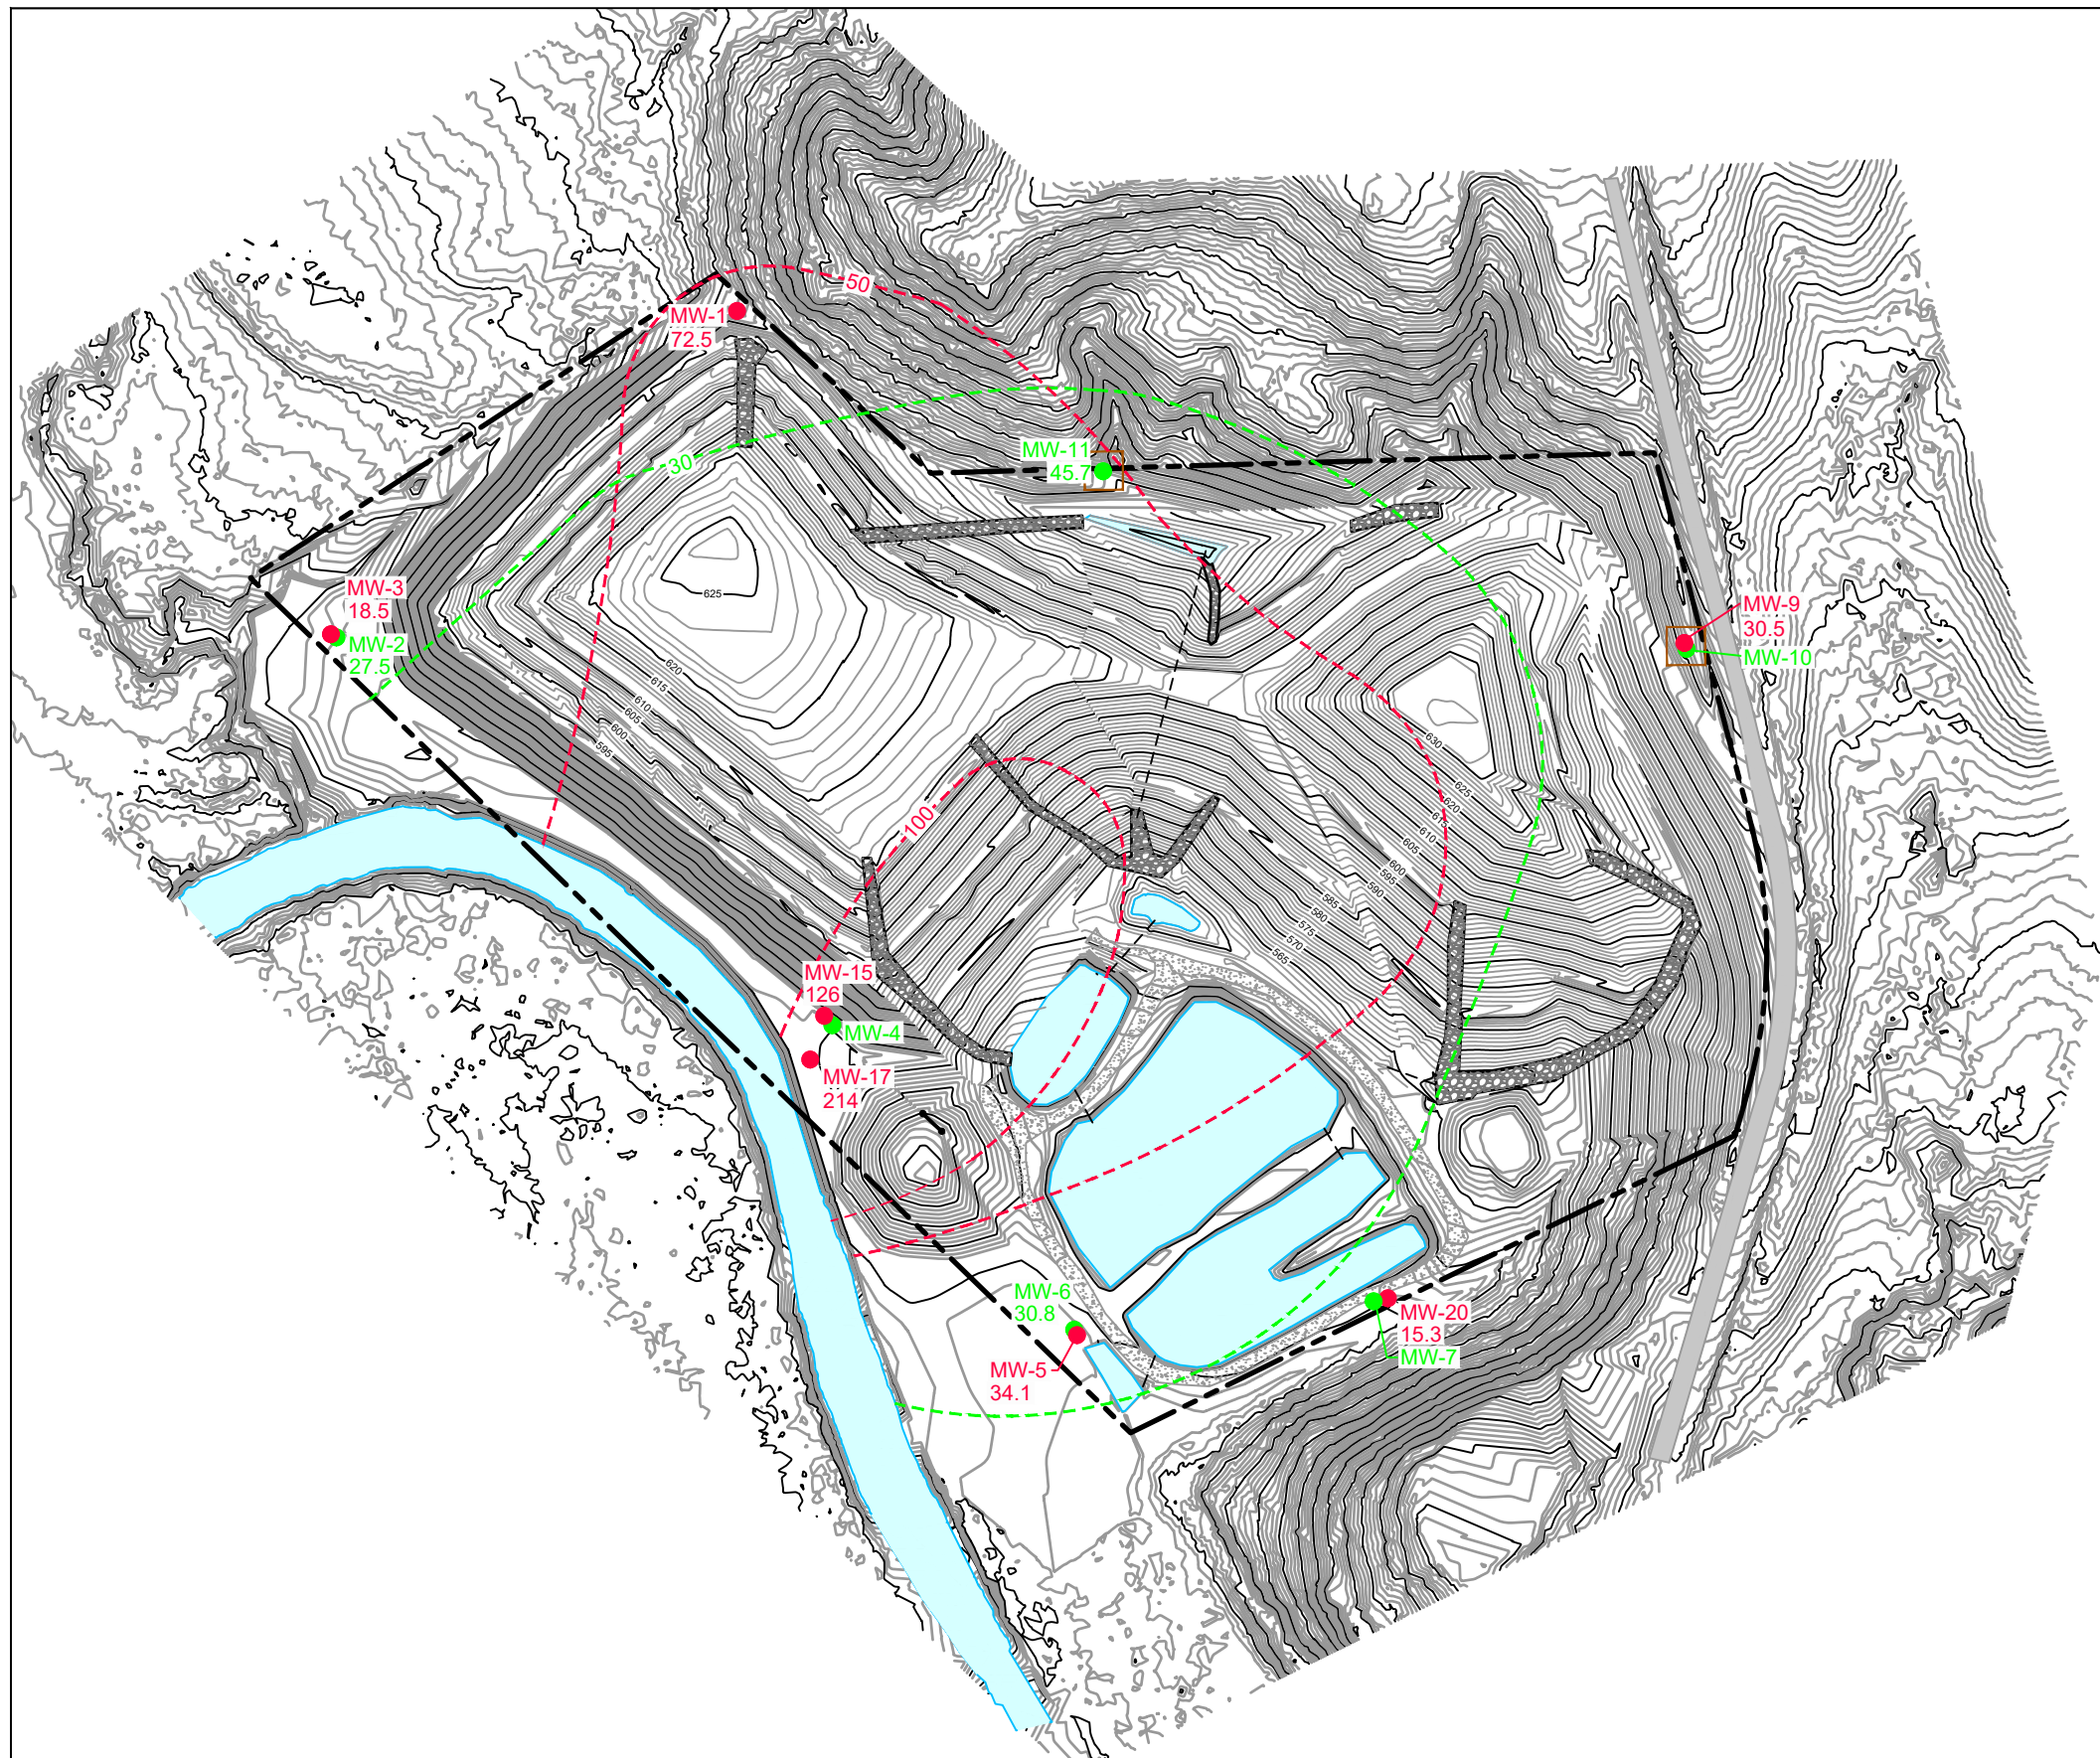



Project No. 12560436  
Date November 2024

**FIGURE 11**





**LEGEND:**

-  APPROXIMATE EXISTING GROUND SURFACE CONTOUR AND ELEVATION, FEET
-  CULVERT
-  PROPERTY LINE
-  RIP-RAP
-  PUBLIC ROAD
-  MW-9 ● UPPERMOST AQUIFER MONITORING WELL LOCATION AND DESIGNATION
-  MW-10 ● WATER TABLE MONITORING WELL LOCATION AND DESIGNATION
-  SURFACE WATER LOCATION AND DESIGNATION
-  DENOTES UPGRADIENT LOCATION
-  30.5 MAGNESIUM CONCENTRATION (mg/L) OR NOT DETECTED (ND)
-  UPPERMOST AQUIFER ESTIMATED ISOCONCENTRATION
-  WATER TABLE AQUIFER ESTIMATED ISOCONCENTRATION

**DRAWING REFERENCE(S):**



DATE OF SURVEY: MULTIPLE  
 SURVEYS BY: IOWA LIDAR PROJECT, XCEL  
 ENGINEERING, AND SNYDER AND ASSOCIATES.

**BASIS OF BEARING:**

IOWA STATE PLANE SOUTH COORDINATE SYSTEM

**NOTES:**

1. LIDAR DATA WERE USED TO CREATE CONTOURS IN A 300' AREA OUTSIDE OF THE PROPERTY LINE. LIDAR DATA WERE OBTAINED FROM THE IOWA DEPARTMENT OF NATURAL RESOURCES. MAPPING WAS PERFORMED FROM 2008-2010 AND IS SHOWN IN THE NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD88). ACCURACY OF LIDAR DATA STATED AS ±8 INCHES BY IOWA DEPARTMENT OF NATURAL RESOURCES.
2. MW-4, MW-7, MW-10 USED FOR WATER LEVEL MEASUREMENT ONLY.




CENTRAL IOWA POWER COOPERATIVE  
 CIPCO FAIR STATION MONOFILL  
 ANNUAL WATER QUALITY REPORT

MAGNESIUM SAMPLE RESULTS  
 OCTOBER 2024

Project No. 12560436  
 Date November 2024

**FIGURE 12**



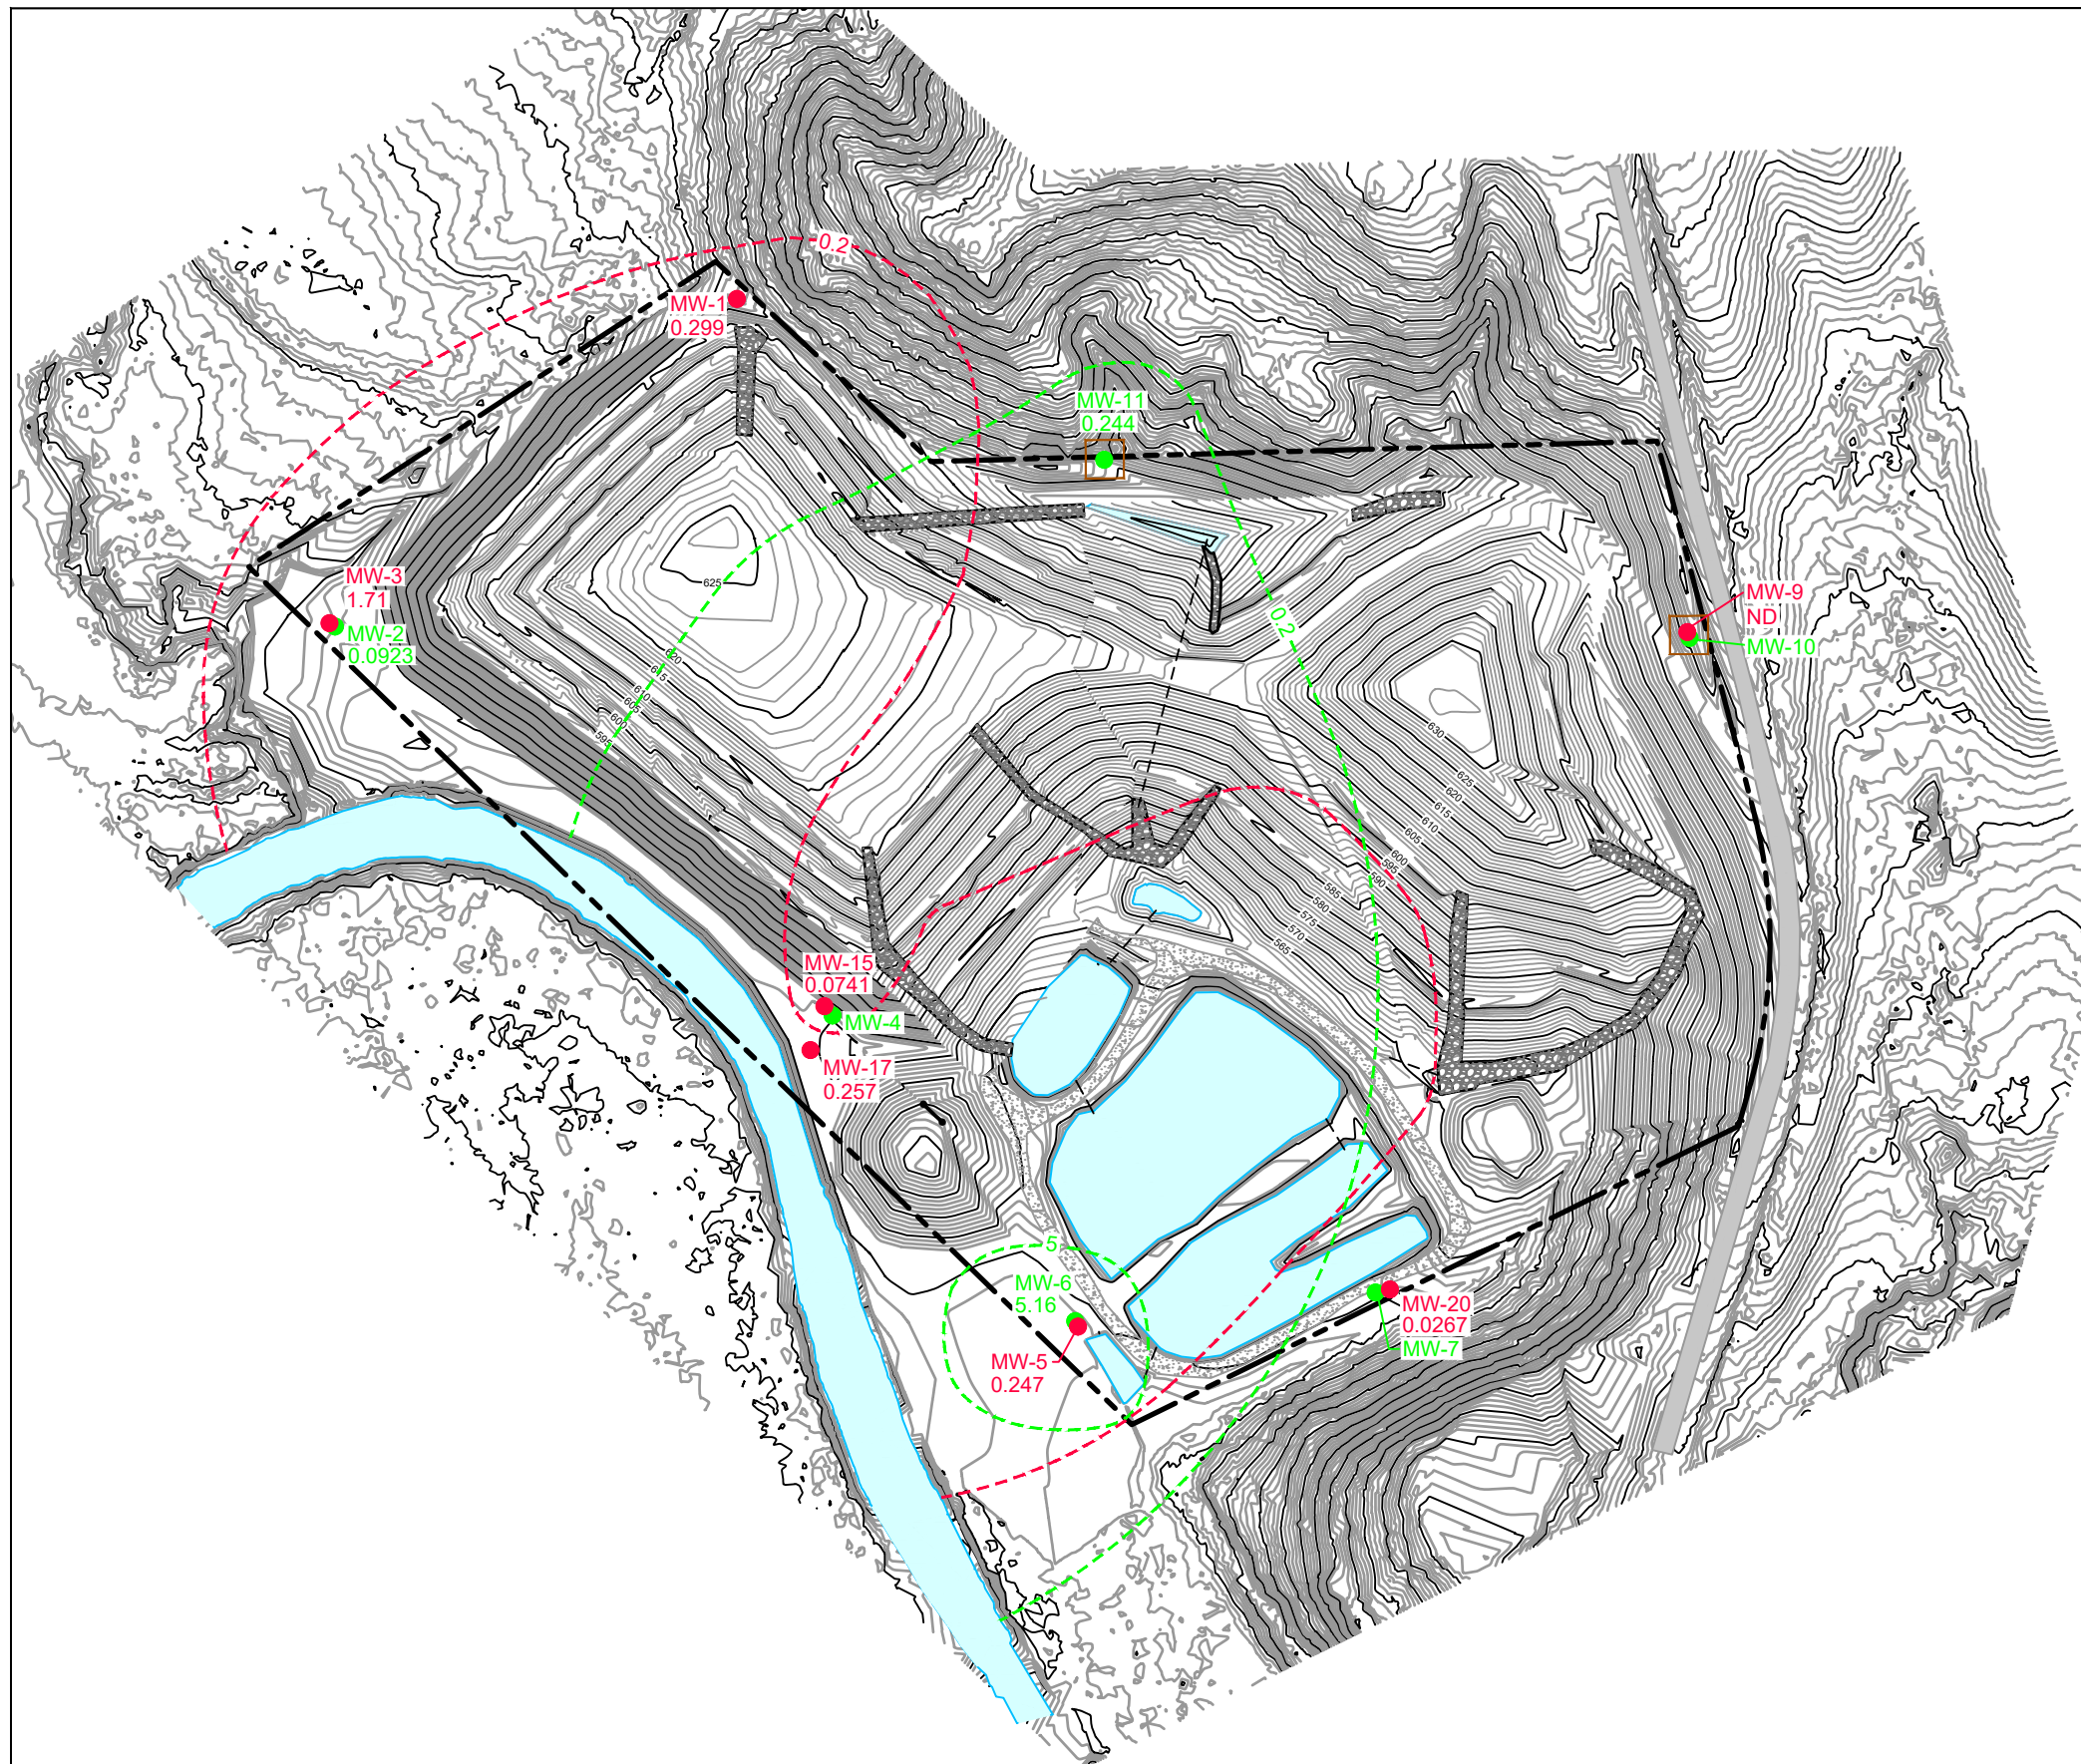

**LEGEND:**

- 650 APPROXIMATE EXISTING GROUND SURFACE CONTOUR AND ELEVATION, FEET
- CULVERT
- PROPERTY LINE
- RIP-RAP
- PUBLIC ROAD
- MW-9 ● UPPERMOST AQUIFER MONITORING WELL LOCATION AND DESIGNATION
- MW-10 ● WATER TABLE MONITORING WELL LOCATION AND DESIGNATION
- DENOTES UPGRADIENT LOCATION
- 0.299 MANGANESE CONCENTRATION (mg/L) OR NOT DETECTED (ND)
- UPPERMOST AQUIFER ESTIMATED ISOCONCENTRATION
- WATER TABLE AQUIFER ESTIMATED ISOCONCENTRATION

**DRAWING REFERENCE(S):**



DATE OF SURVEY: MULTIPLE  
 SURVEYS BY: IOWA LIDAR PROJECT, XCEL ENGINEERING, AND SNYDER AND ASSOCIATES.

**BASIS OF BEARING:**

IOWA STATE PLANE SOUTH COORDINATE SYSTEM

**NOTES:**

1. LIDAR DATA WERE USED TO CREATE CONTOURS IN A 300' AREA OUTSIDE OF THE PROPERTY LINE. LIDAR DATA WERE OBTAINED FROM THE IOWA DEPARTMENT OF NATURAL RESOURCES. MAPPING WAS PERFORMED FROM 2008-2010 AND IS SHOWN IN THE NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD88). ACCURACY OF LIDAR DATA STATED AS ±8 INCHES BY IOWA DEPARTMENT OF NATURAL RESOURCES.
2. MW-4, MW-7, MW-10 USED FOR WATER LEVEL MEASUREMENT ONLY.




CENTRAL IOWA POWER COOPERATIVE  
 CIPCO FAIR STATION MONOFILL  
 ANNUAL WATER QUALITY REPORT

**MANGANESE SAMPLE RESULTS  
 OCTOBER 2024**









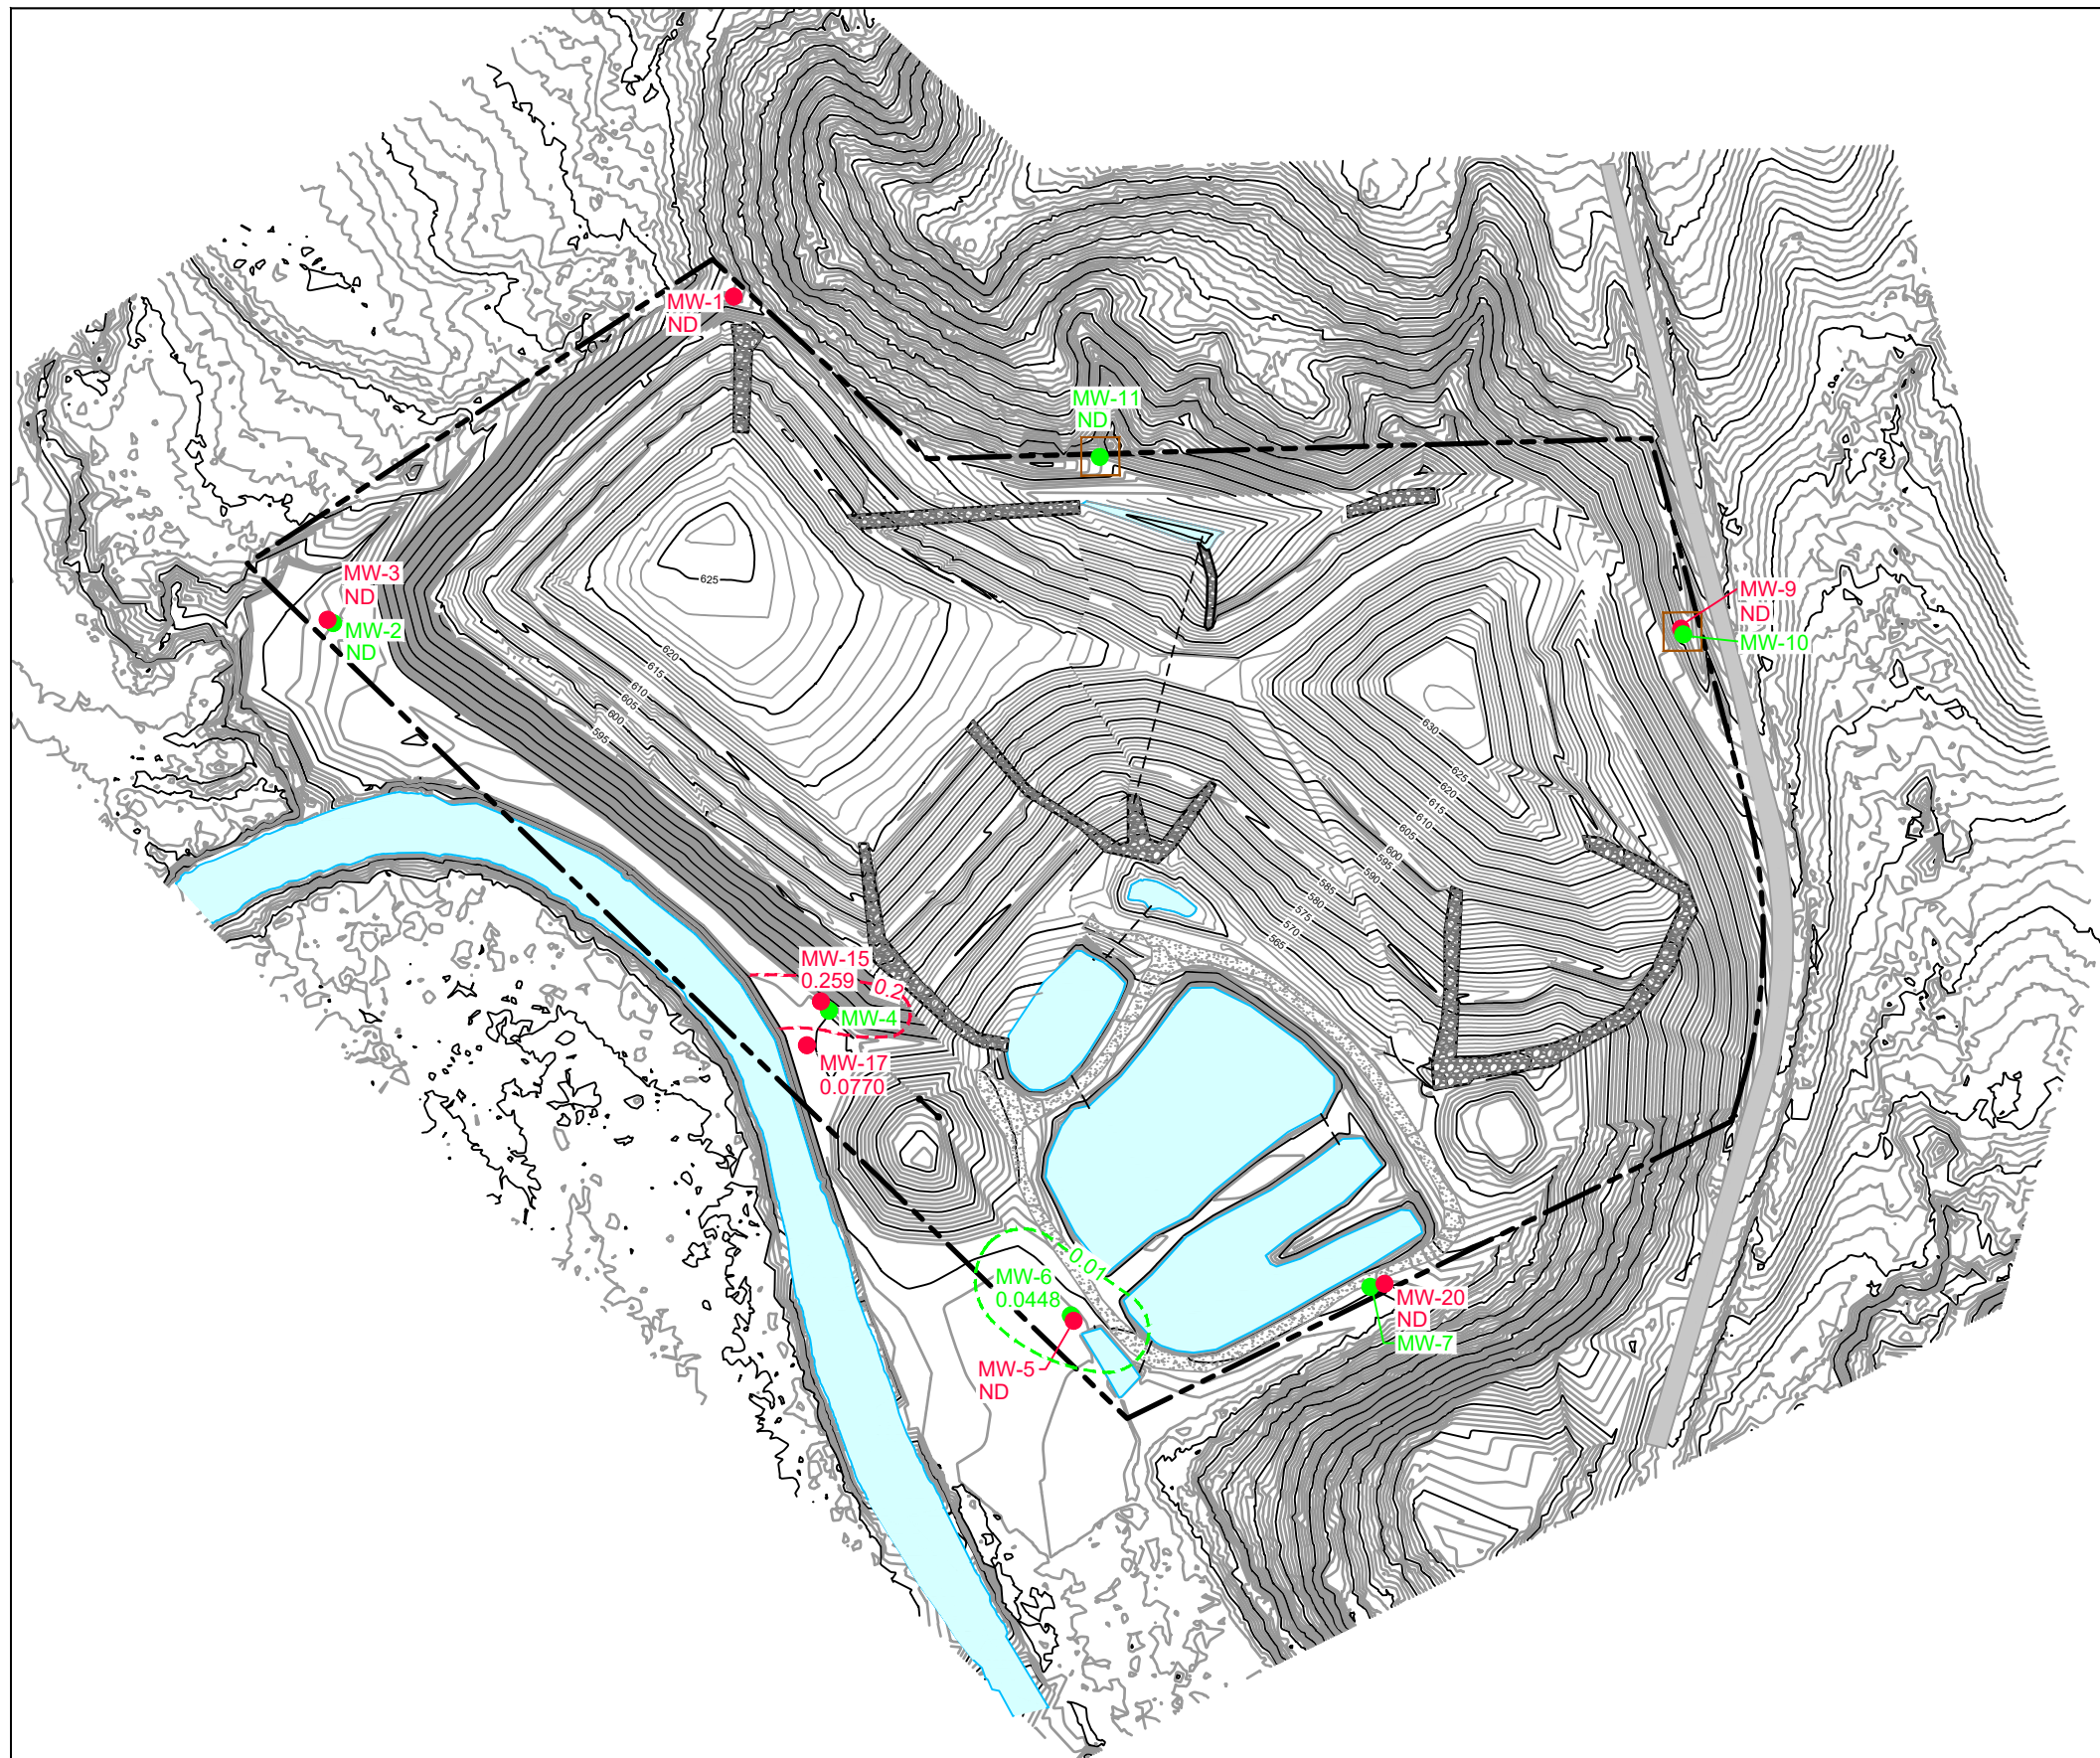


Project No. 12560436  
 Date November 2024

**FIGURE 13**





**LEGEND:**

-  APPROXIMATE EXISTING GROUND SURFACE CONTOUR AND ELEVATION, FEET
-  CULVERT
-  PROPERTY LINE
-  RIP-RAP
-  PUBLIC ROAD
-  MW-9 ● UPPERMOST AQUIFER MONITORING WELL LOCATION AND DESIGNATION
-  MW-10 ● WATER TABLE MONITORING WELL LOCATION AND DESIGNATION
-  DENOTES UPGRADIENT LOCATION
-  0.259 MOLYBDENUM CONCENTRATION (mg/L) OR NOT DETECTED (ND)
-  UPPERMOST AQUIFER ESTIMATED ISOCONCENTRATION
-  WATER TABLE AQUIFER ESTIMATED ISOCONCENTRATION

**DRAWING REFERENCE(S):**



DATE OF SURVEY: MULTIPLE  
 SURVEYS BY: IOWA LIDAR PROJECT, XCEL ENGINEERING, AND SNYDER AND ASSOCIATES.

**BASIS OF BEARING:**

IOWA STATE PLANE SOUTH COORDINATE SYSTEM

**NOTES:**

1. LIDAR DATA WERE USED TO CREATE CONTOURS IN A 300' AREA OUTSIDE OF THE PROPERTY LINE. LIDAR DATA WERE OBTAINED FROM THE IOWA DEPARTMENT OF NATURAL RESOURCES. MAPPING WAS PERFORMED FROM 2008-2010 AND IS SHOWN IN THE NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD88). ACCURACY OF LIDAR DATA STATED AS ±8 INCHES BY IOWA DEPARTMENT OF NATURAL RESOURCES.
2. MW-4, MW-7, MW-10 USED FOR WATER LEVEL MEASUREMENT ONLY.




CENTRAL IOWA POWER COOPERATIVE  
 CIPCO FAIR STATION MONOFILL  
 ANNUAL WATER QUALITY REPORT

**MOLYBDENUM SAMPLE RESULTS**  
 OCTOBER 2024

Project No. 12560436  
 Date November 2024

**FIGURE 14**



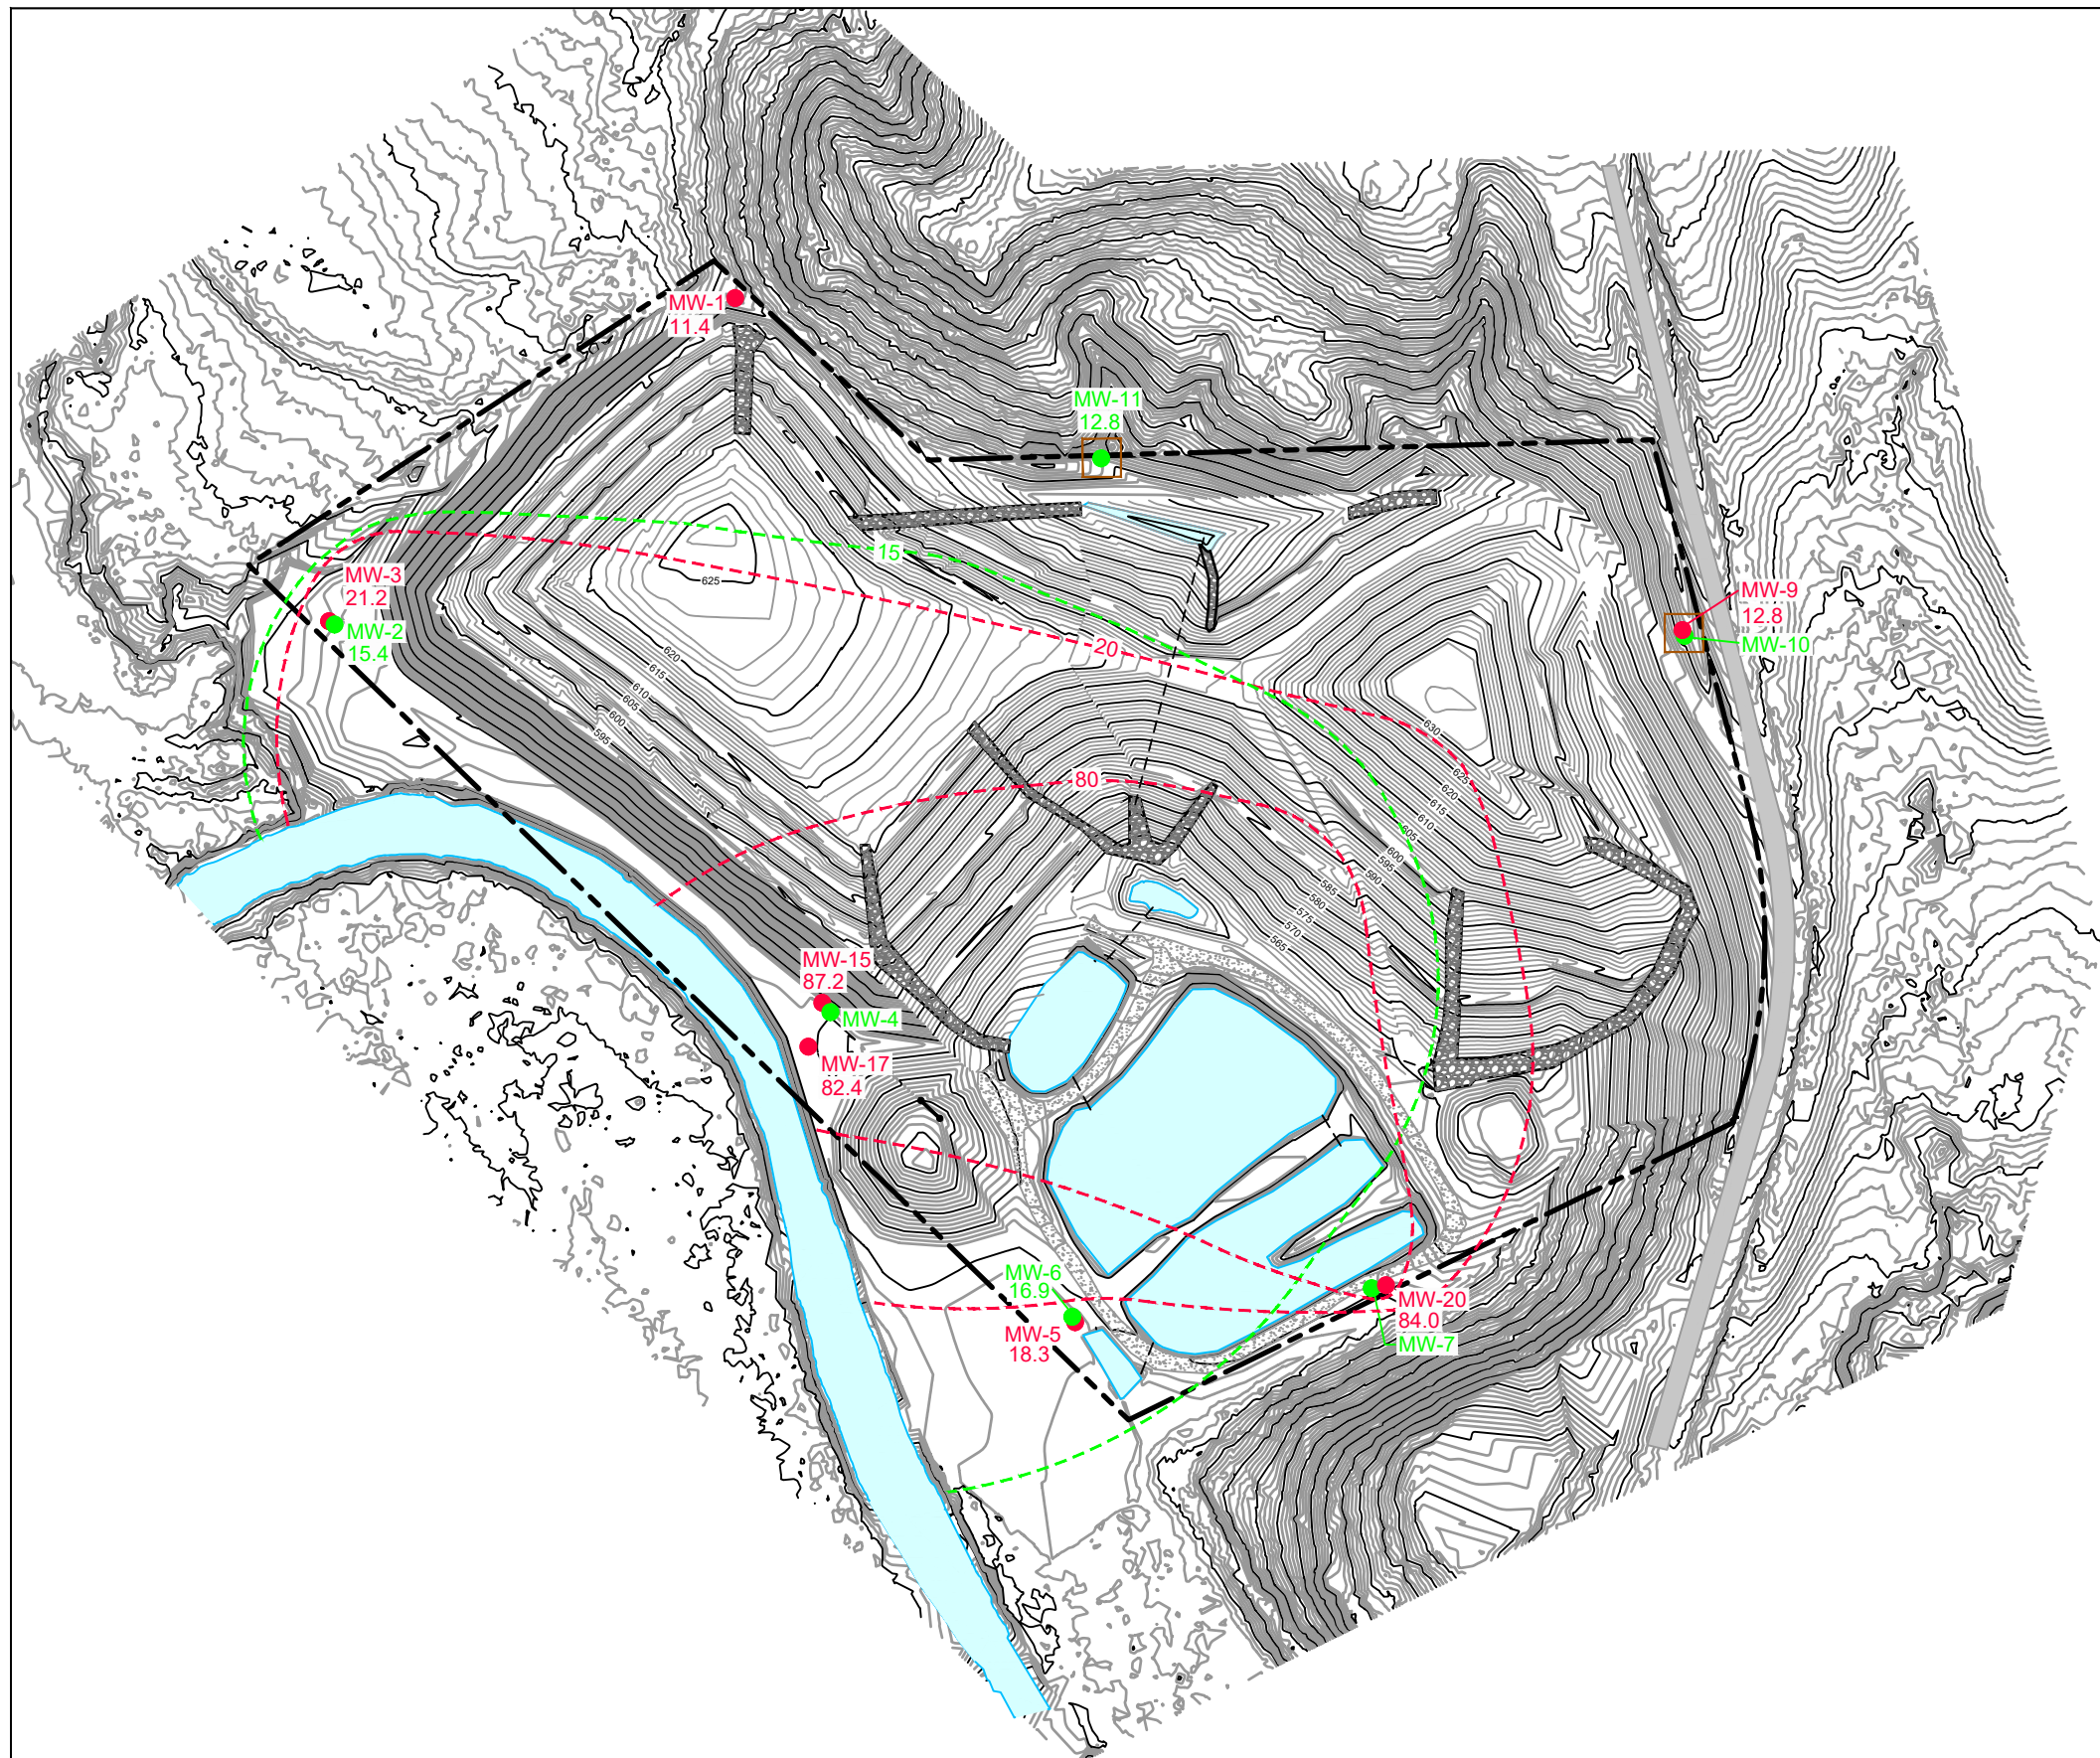

**LEGEND:**

- APPROXIMATE EXISTING GROUND SURFACE CONTOUR AND ELEVATION, FEET
- CULVERT
- PROPERTY LINE
- RIP-RAP
- PUBLIC ROAD
- MW-9 ● UPPERMOST AQUIFER MONITORING WELL LOCATION AND DESIGNATION
- MW-10 ● WATER TABLE MONITORING WELL LOCATION AND DESIGNATION
- DENOTES UPGRADIENT LOCATION
- 12.8 SODIUM CONCENTRATION (mg/L) OR NOT DETECTED (ND)
- UPPERMOST AQUIFER ESTIMATED ISOCONCENTRATION
- WATER TABLE AQUIFER ESTIMATED ISOCONCENTRATION

**DRAWING REFERENCE(S):**



DATE OF SURVEY: MULTIPLE  
 SURVEYS BY: IOWA LIDAR PROJECT, XCEL ENGINEERING, AND SNYDER AND ASSOCIATES.

**BASIS OF BEARING:**

IOWA STATE PLANE SOUTH COORDINATE SYSTEM

**NOTES:**

- LIDAR DATA WERE USED TO CREATE CONTOURS IN A 300' AREA OUTSIDE OF THE PROPERTY LINE. LIDAR DATA WERE OBTAINED FROM THE IOWA DEPARTMENT OF NATURAL RESOURCES. MAPPING WAS PERFORMED FROM 2008-2010 AND IS SHOWN IN THE NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD88). ACCURACY OF LIDAR DATA STATED AS ±8 INCHES BY IOWA DEPARTMENT OF NATURAL RESOURCES.
- MW-4, MW-7, MW-10 USED FOR WATER LEVEL MEASUREMENT ONLY.



CENTRAL IOWA POWER COOPERATIVE  
 CIPCO FAIR STATION MONOFILL  
 ANNUAL WATER QUALITY REPORT

SODIUM SAMPLE RESULTS  
 OCTOBER 2024

Project No. 12560436  
 Date November 2024





**LEGEND:**

- 650 — APPROXIMATE EXISTING GROUND SURFACE CONTOUR AND ELEVATION, FEET
- - - - - CULVERT
- - - - - PROPERTY LINE
- ▨ RIP-RAP
- ▬ PUBLIC ROAD
- MW-9 ● UPPERMOST AQUIFER MONITORING WELL LOCATION AND DESIGNATION
- MW-10 ● WATER TABLE MONITORING WELL LOCATION AND DESIGNATION
- DENOTES UPGRADIENT LOCATION
- 0.706 STRONTIUM CONCENTRATION (mg/L) OR NOT DETECTED (ND)
- - - - - UPPERMOST AQUIFER ESTIMATED ISOCONCENTRATION
- - - - - WATER TABLE AQUIFER ESTIMATED ISOCONCENTRATION

**DRAWING REFERENCE(S):**



DATE OF SURVEY: MULTIPLE  
 SURVEYS BY: IOWA LIDAR PROJECT, XCEL  
 ENGINEERING, AND SNYDER AND ASSOCIATES.

**BASIS OF BEARING:**

IOWA STATE PLANE SOUTH COORDINATE SYSTEM

**NOTES:**

- LIDAR DATA WERE USED TO CREATE CONTOURS IN A 300' AREA OUTSIDE OF THE PROPERTY LINE. LIDAR DATA WERE OBTAINED FROM THE IOWA DEPARTMENT OF NATURAL RESOURCES. MAPPING WAS PERFORMED FROM 2008-2010 AND IS SHOWN IN THE NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD88). ACCURACY OF LIDAR DATA STATED AS ±8 INCHES BY IOWA DEPARTMENT OF NATURAL RESOURCES.
- MW-4, MW-7, MW-10 USED FOR WATER LEVEL MEASUREMENT ONLY.




CENTRAL IOWA POWER COOPERATIVE  
 CIPCO FAIR STATION MONOFILL  
 ANNUAL WATER QUALITY REPORT

STRONTIUM SAMPLE RESULTS  
 OCTOBER 2024

Project No. 12560436  
 Date November 2024



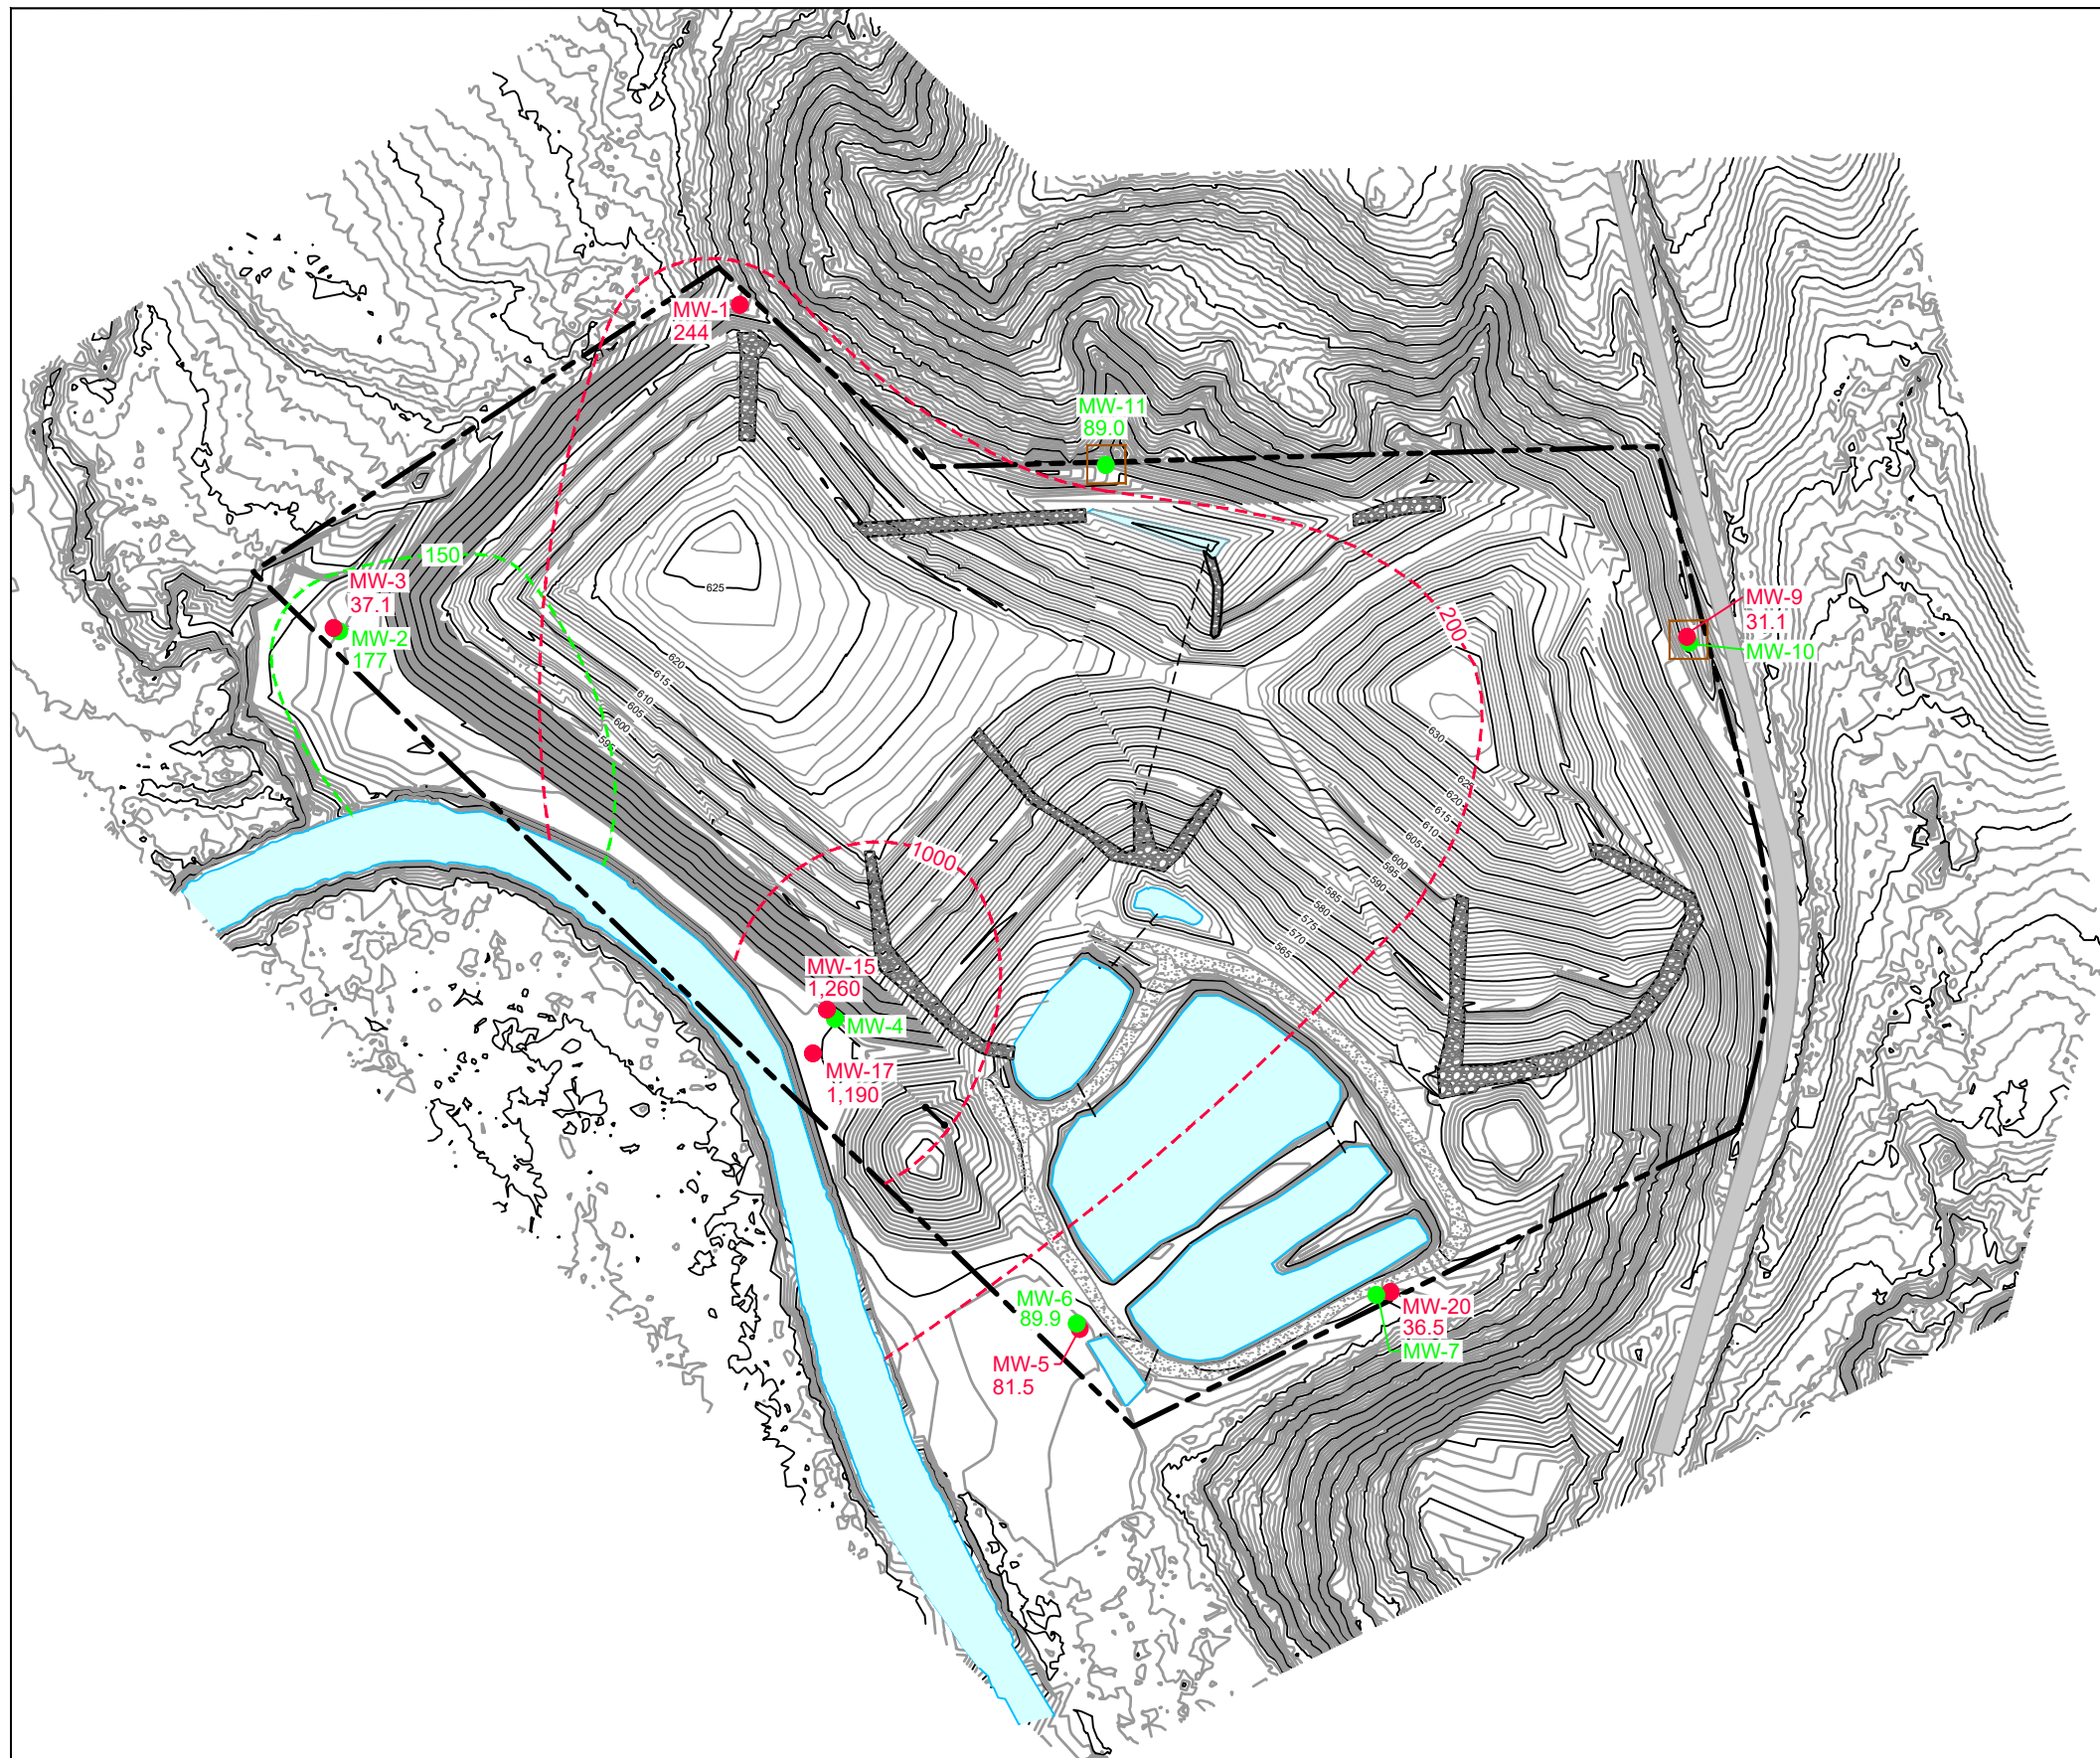

**LEGEND:**

- APPROXIMATE EXISTING GROUND SURFACE CONTOUR AND ELEVATION, FEET
- CULVERT
- PROPERTY LINE
- RIP-RAP
- PUBLIC ROAD
- MW-9 ● UPPERMOST AQUIFER MONITORING WELL LOCATION AND DESIGNATION
- MW-10 ● WATER TABLE MONITORING WELL LOCATION AND DESIGNATION
- DENOTES UPGRADIENT LOCATION
- 31.1 SULFATE CONCENTRATION (mg/L) OR NOT DETECTED (ND)
- UPPERMOST AQUIFER ESTIMATED ISOCONCENTRATION
- WATER TABLE AQUIFER ESTIMATED ISOCONCENTRATION

**DRAWING REFERENCE(S):**

DATE OF SURVEY: MULTIPLE  
 SURVEYS BY: IOWA LIDAR PROJECT, XCEL ENGINEERING, AND SNYDER AND ASSOCIATES.

**BASIS OF BEARING:**

IOWA STATE PLANE SOUTH COORDINATE SYSTEM


**NOTES:**

1. LIDAR DATA WERE USED TO CREATE CONTOURS IN A 300' AREA OUTSIDE OF THE PROPERTY LINE. LIDAR DATA WERE OBTAINED FROM THE IOWA DEPARTMENT OF NATURAL RESOURCES. MAPPING WAS PERFORMED FROM 2008-2010 AND IS SHOWN IN THE NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD88). ACCURACY OF LIDAR DATA STATED AS ±8 INCHES BY IOWA DEPARTMENT OF NATURAL RESOURCES.
2. MW-4, MW-7, MW-10 USED FOR WATER LEVEL MEASUREMENT ONLY.

 Coordinate System: IOWA STATE PLANE SOUTH			<b>CENTRAL IOWA POWER COOPERATIVE</b> <b>CIPCO FAIR STATION MONOFILL</b> <b>ANNUAL WATER QUALITY REPORT</b>  <b>SULFATE SAMPLE RESULTS</b> <b>OCTOBER 2024</b>	Project No. 12560436 Date November 2024
--	--	--	---	--

**FIGURE 17**



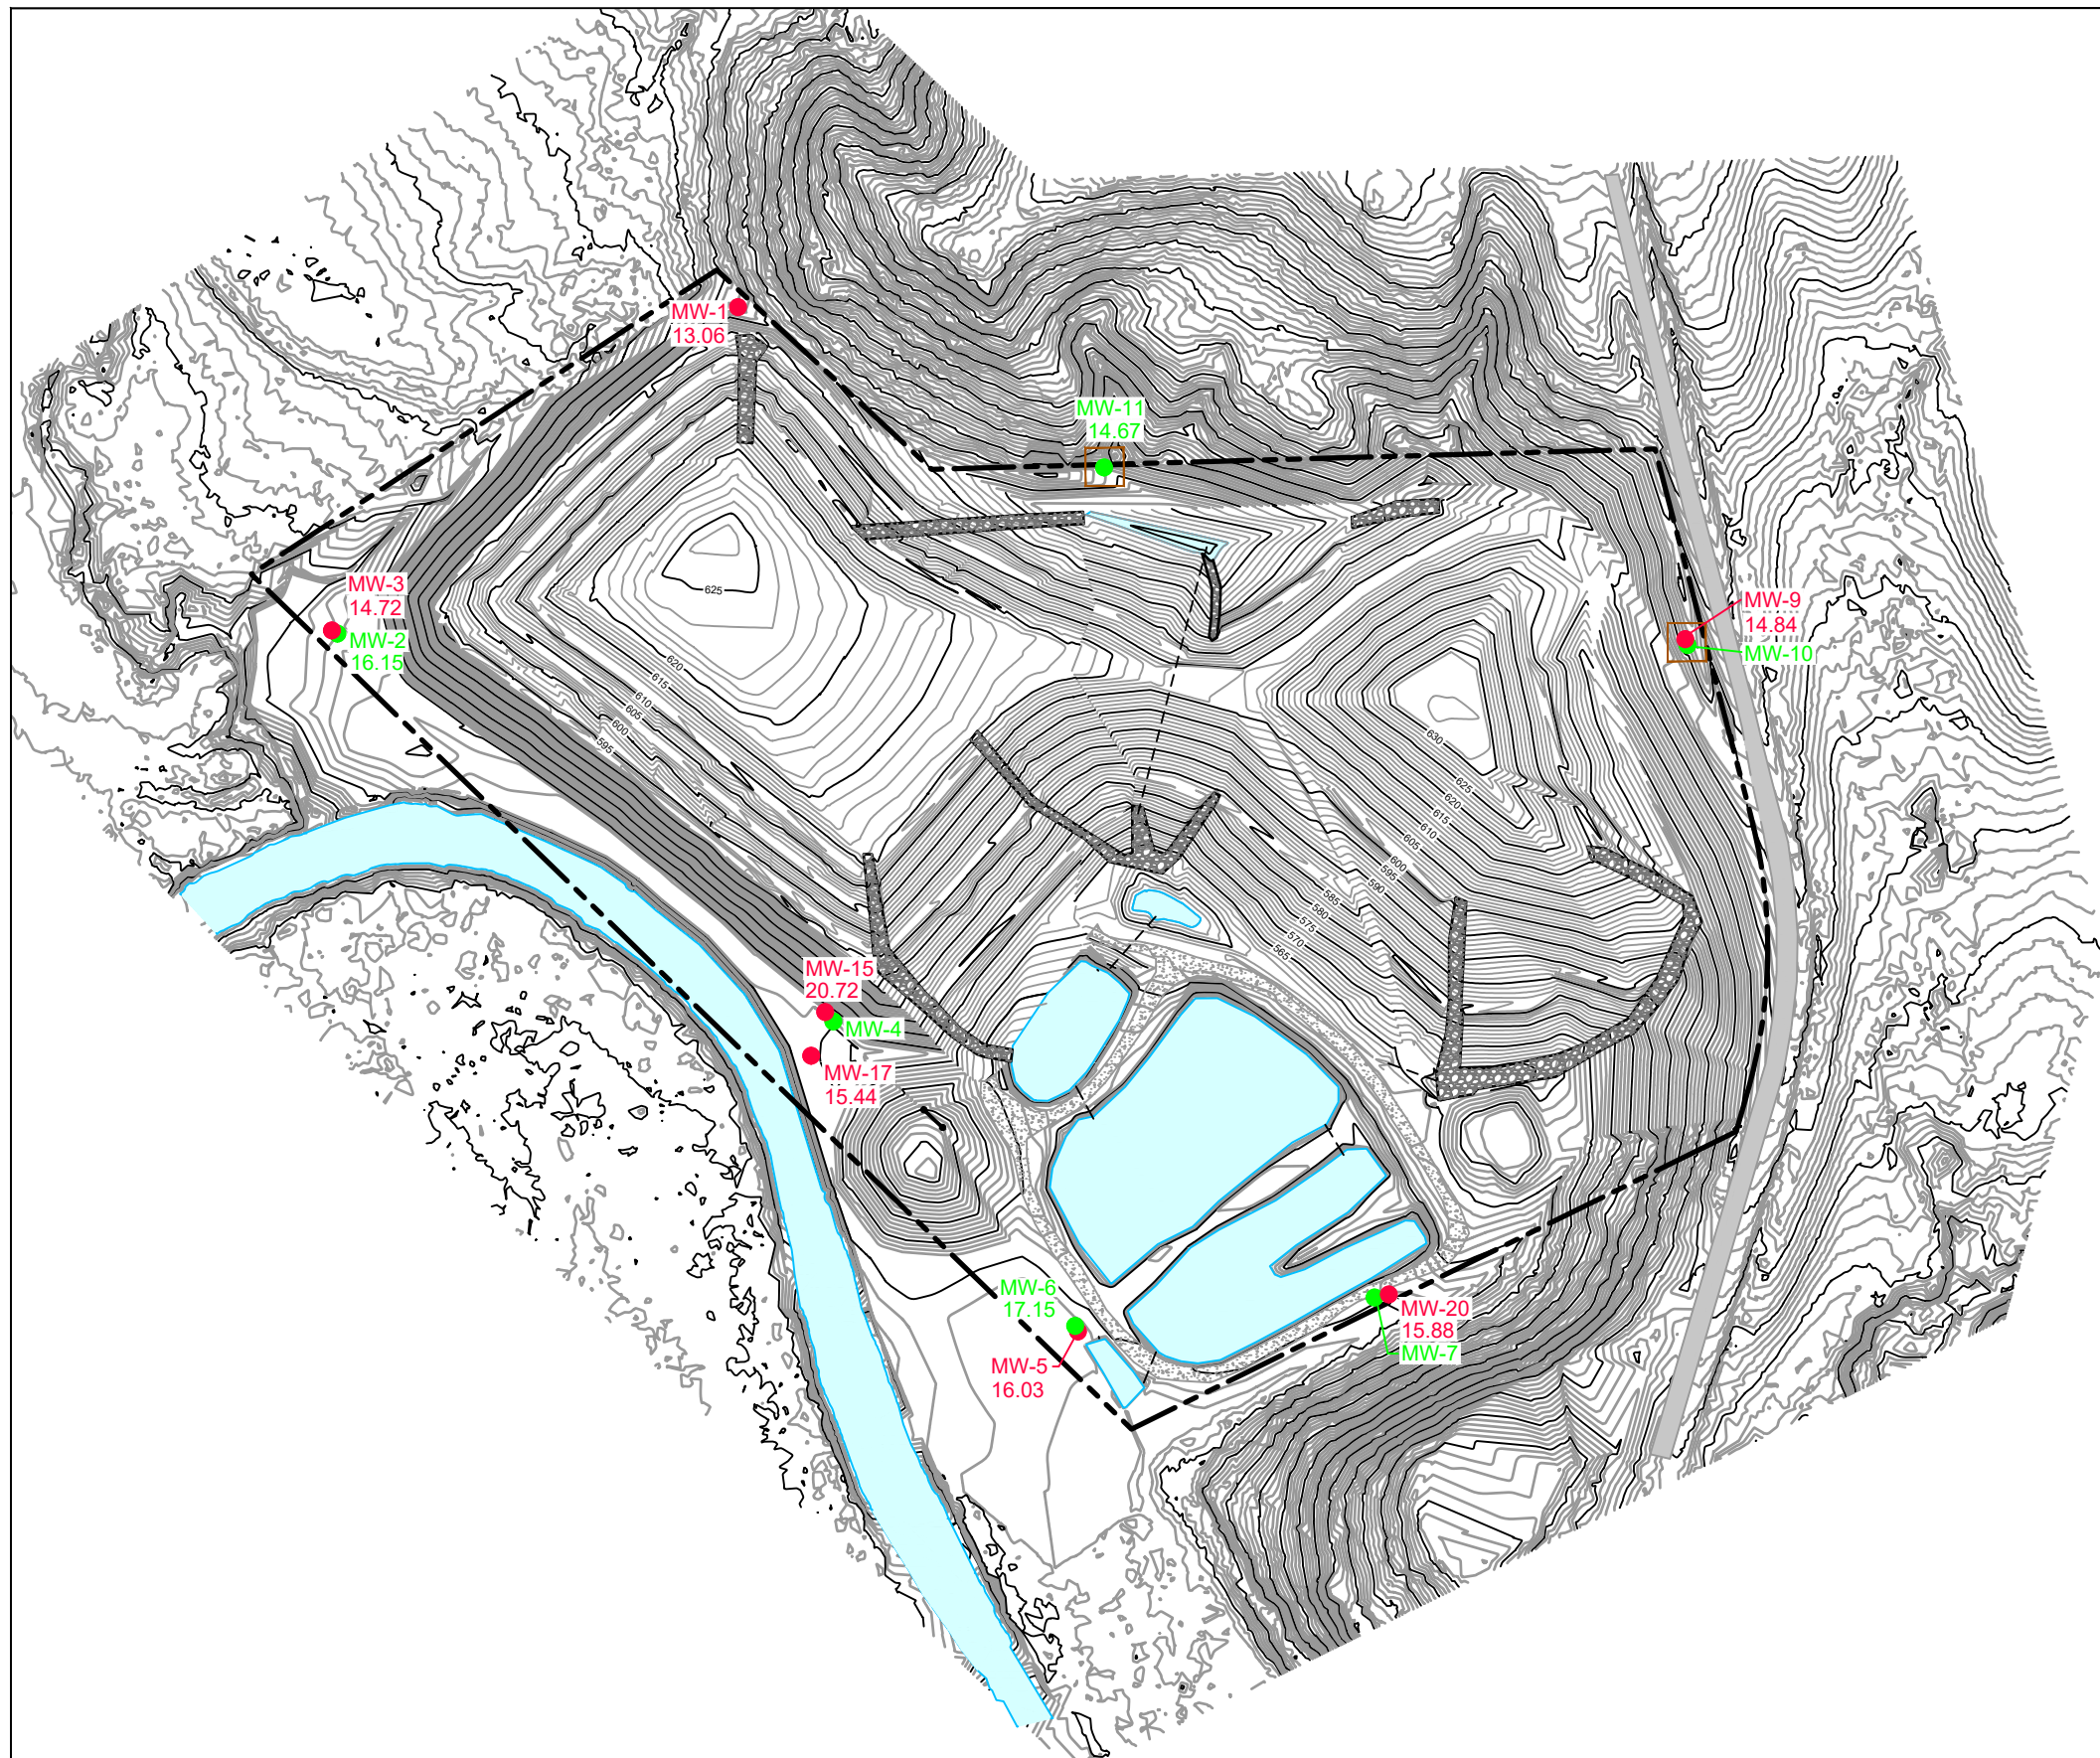

**LEGEND:**

- 650 ——— APPROXIMATE EXISTING GROUND SURFACE CONTOUR AND ELEVATION, FEET
- CULVERT
- PROPERTY LINE
- RIP-RAP
- PUBLIC ROAD
- MW-9 ● UPPERMOST AQUIFER MONITORING WELL LOCATION AND DESIGNATION
- MW-10 ● WATER TABLE MONITORING WELL LOCATION AND DESIGNATION
- DENOTES UPGRADIENT LOCATION
- 14.84 TEMP (DEGREES CELSIUS) OR NOT RECORDED (NR)

**DRAWING REFERENCE(S):**



DATE OF SURVEY: MULTIPLE  
 SURVEYS BY: IOWA LIDAR PROJECT, XCEL ENGINEERING, AND SNYDER AND ASSOCIATES.

**BASIS OF BEARING:**

IOWA STATE PLANE SOUTH COORDINATE SYSTEM

**NOTES:**

1. LIDAR DATA WERE USED TO CREATE CONTOURS IN A 300' AREA OUTSIDE OF THE PROPERTY LINE. LIDAR DATA WERE OBTAINED FROM THE IOWA DEPARTMENT OF NATURAL RESOURCES. MAPPING WAS PERFORMED FROM 2008-2010 AND IS SHOWN IN THE NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD88). ACCURACY OF LIDAR DATA STATED AS ±8 INCHES BY IOWA DEPARTMENT OF NATURAL RESOURCES.
2. MW-4, MW-7, MW-10 USED FOR WATER LEVEL MEASUREMENT ONLY.




CENTRAL IOWA POWER COOPERATIVE  
 CIPCO FAIR STATION MONOFILL  
 ANNUAL WATER QUALITY REPORT

TEMPERATURE VALUES  
 OCTOBER 2024

Project No. 12560436  
 Date November 2024

**FIGURE 18**



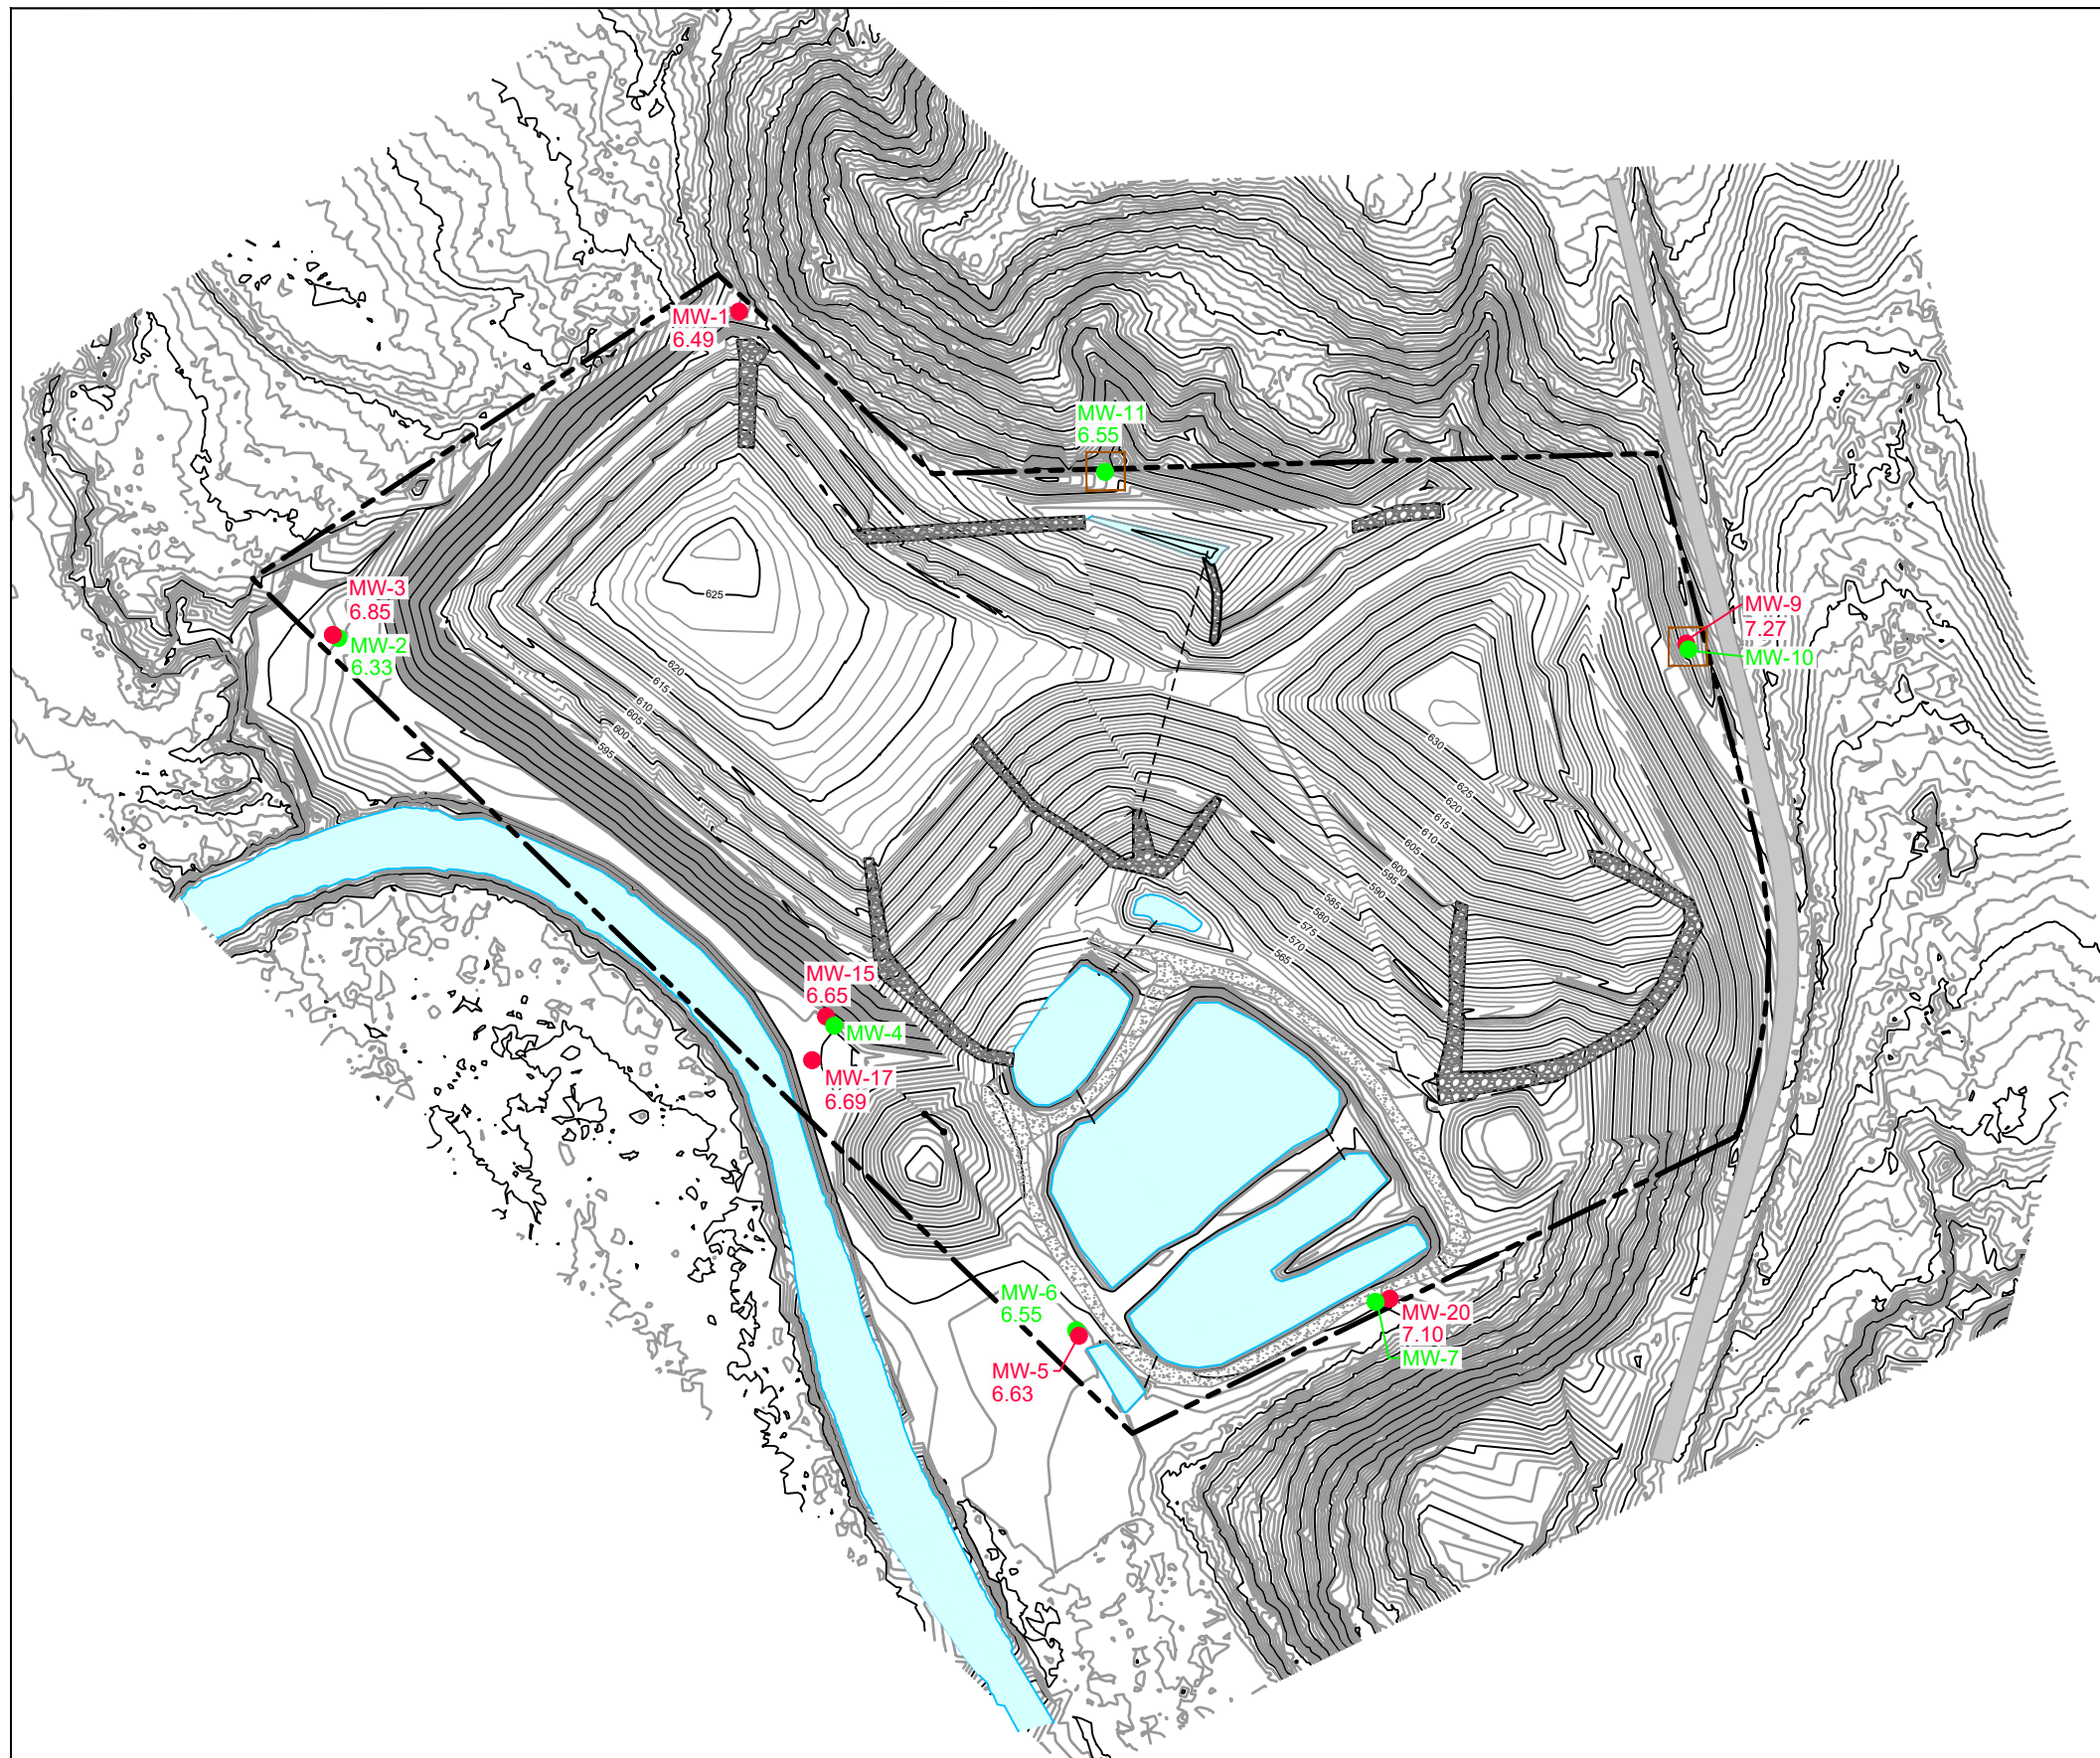

**LEGEND:**

- 650 — APPROXIMATE EXISTING GROUND SURFACE CONTOUR AND ELEVATION, FEET
- - - - - CULVERT
- - - - - PROPERTY LINE
- ▨ RIP-RAP
- ▬ PUBLIC ROAD
- MW-9 ● UPPERMOST AQUIFER MONITORING WELL LOCATION AND DESIGNATION
- MW-10 ● WATER TABLE MONITORING WELL LOCATION AND DESIGNATION
- DENOTES UPGRADIENT LOCATION
- 7.27 pH CONCENTRATION (mg/L), NOT DETECTED (ND) OR NOT RECORDED (NR)

**DRAWING REFERENCE(S):**



DATE OF SURVEY: MULTIPLE  
 SURVEYS BY: IOWA LIDAR PROJECT, XCEL  
 ENGINEERING, AND SNYDER AND ASSOCIATES.

**BASIS OF BEARING:**

IOWA STATE PLANE SOUTH COORDINATE SYSTEM

**NOTES:**

1. LIDAR DATA WERE USED TO CREATE CONTOURS IN A 300' AREA OUTSIDE OF THE PROPERTY LINE. LIDAR DATA WERE OBTAINED FROM THE IOWA DEPARTMENT OF NATURAL RESOURCES. MAPPING WAS PERFORMED FROM 2008-2010 AND IS SHOWN IN THE NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD88). ACCURACY OF LIDAR DATA STATED AS ±8 INCHES BY IOWA DEPARTMENT OF NATURAL RESOURCES.
2. MW-4, MW-7, MW-10 USED FOR WATER LEVEL MEASUREMENT ONLY.




CENTRAL IOWA POWER COOPERATIVE  
 CIPCO FAIR STATION MONOFILL  
 ANNUAL WATER QUALITY REPORT

Project No. 12560436  
 Date November 2024

pH VALUES  
 OCTOBER 2024

**FIGURE 19**



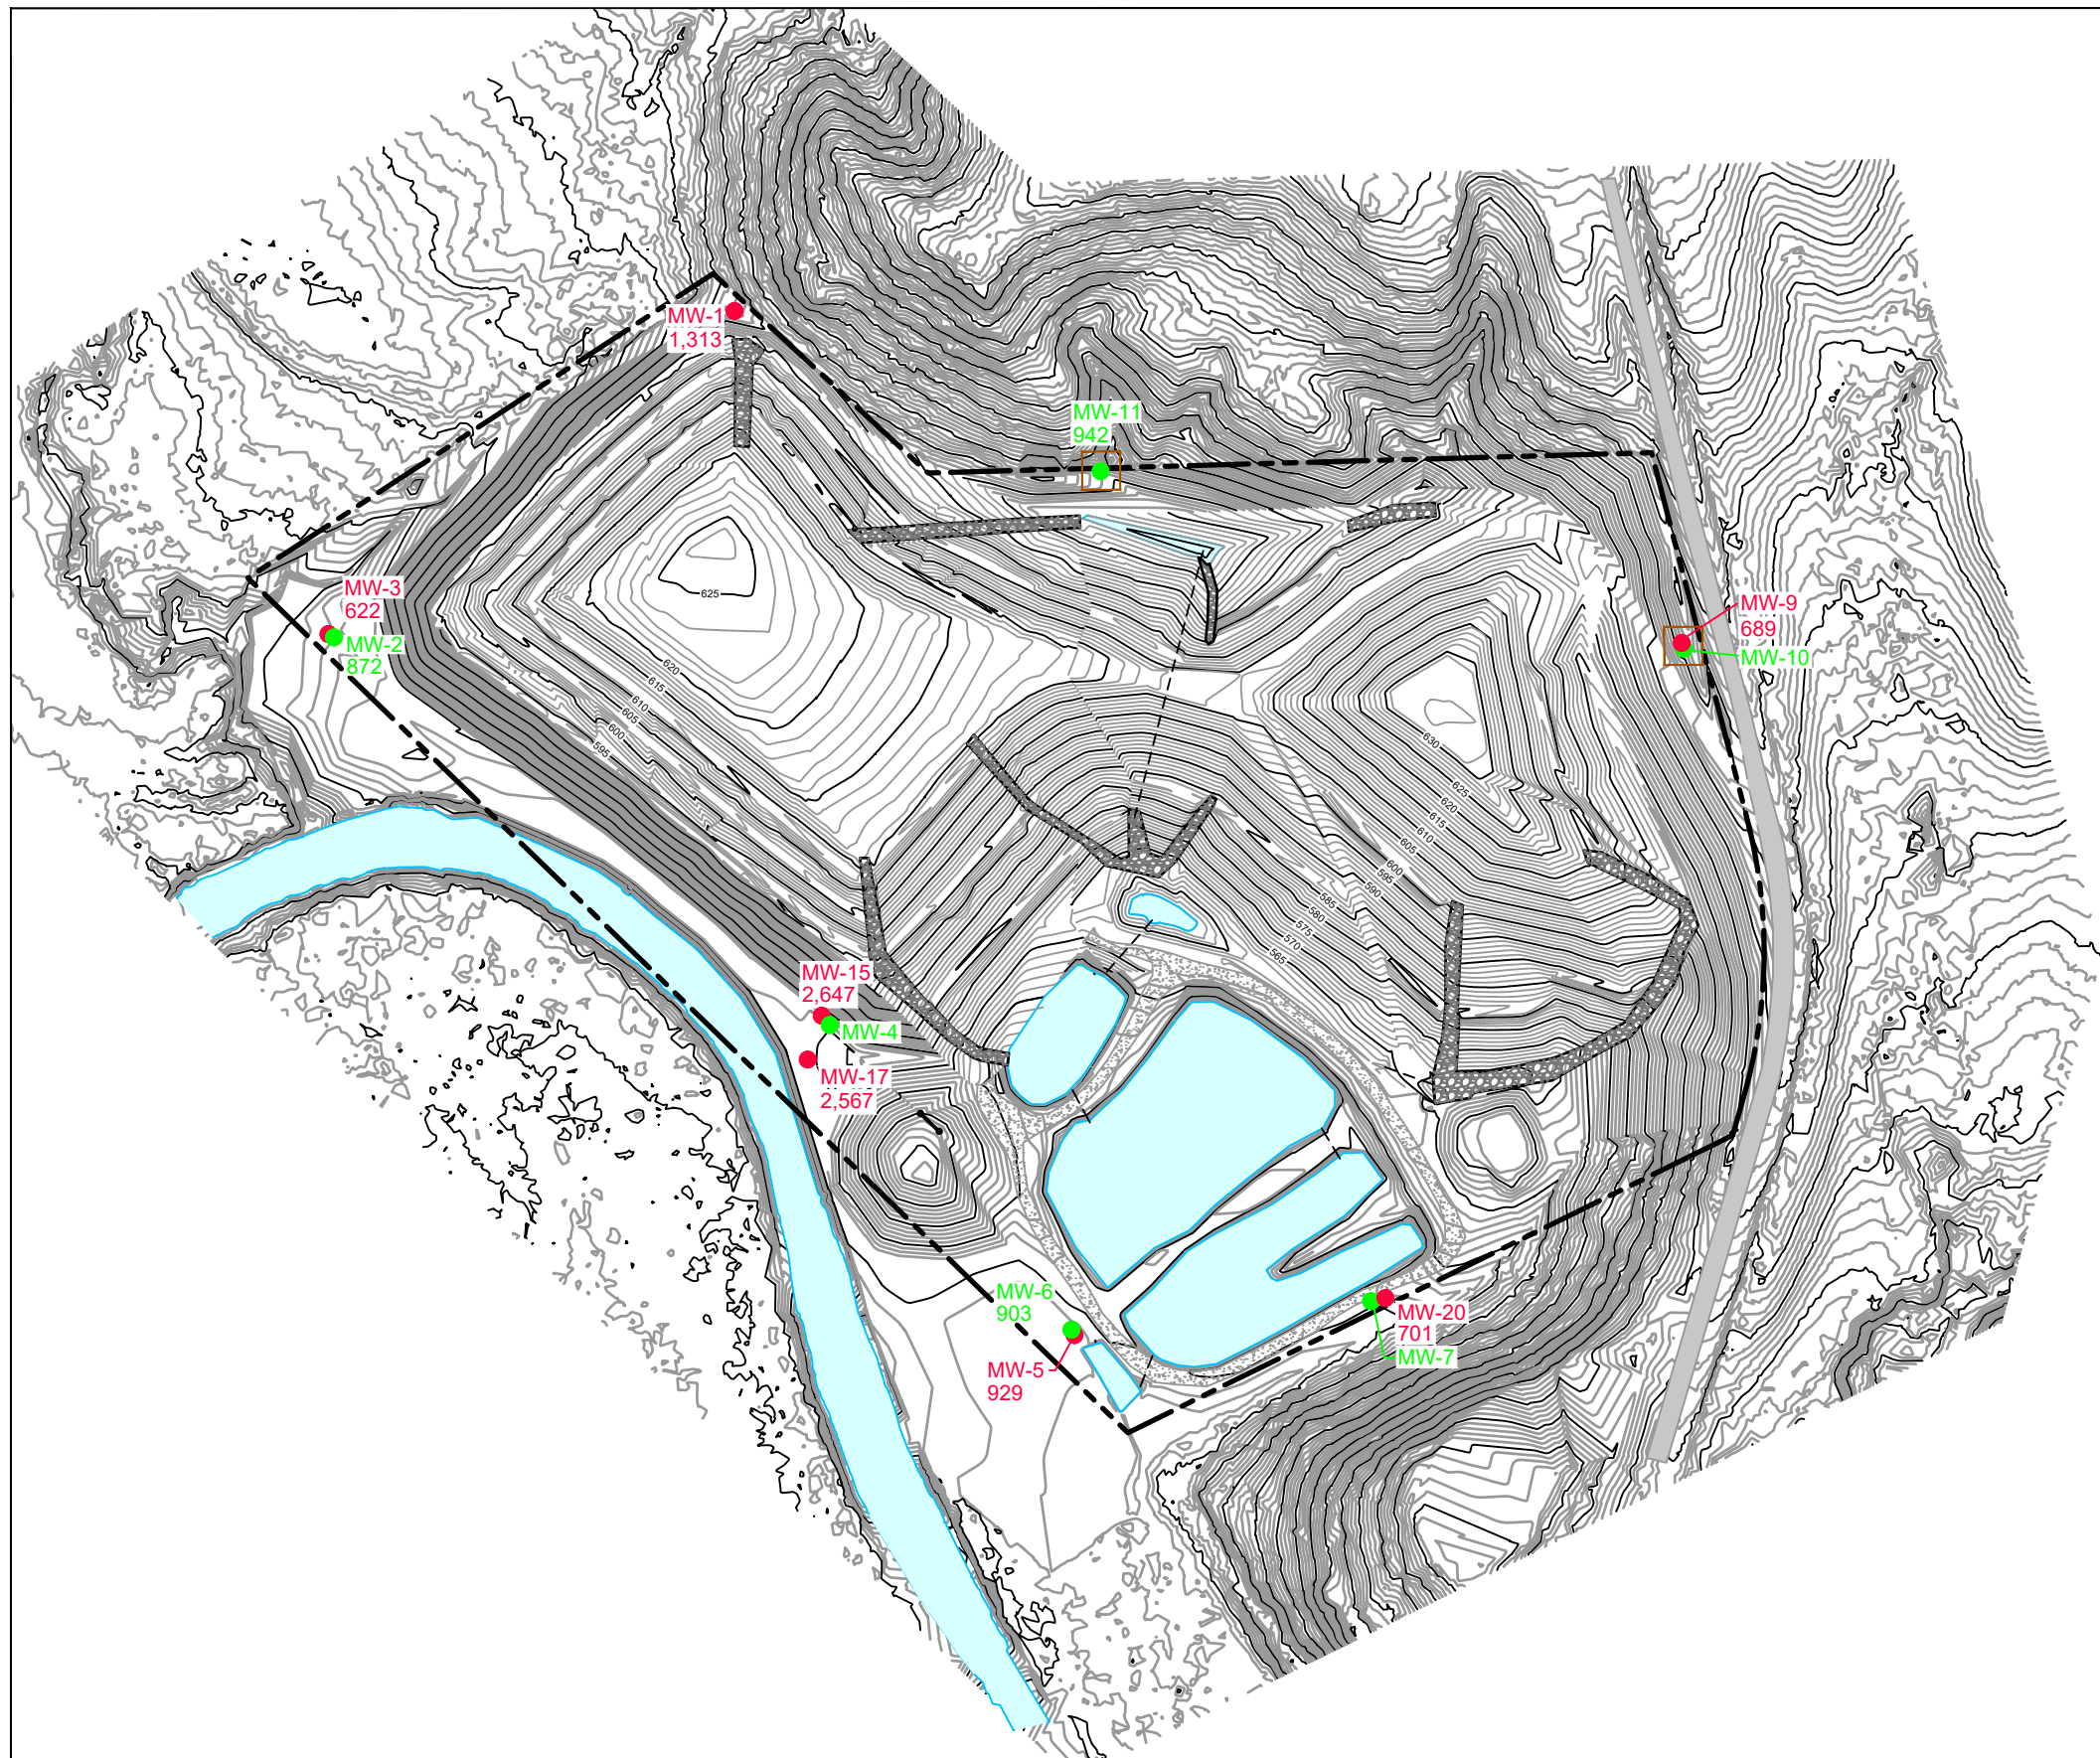

**LEGEND:**

- 650 — APPROXIMATE EXISTING GROUND SURFACE CONTOUR AND ELEVATION, FEET
- - - - - CULVERT
- - - - - PROPERTY LINE
- ▨ RIP-RAP
- ▬ PUBLIC ROAD
- MW-9 ● UPPERMOST AQUIFER MONITORING WELL LOCATION AND DESIGNATION
- MW-10 ● WATER TABLE MONITORING WELL LOCATION AND DESIGNATION
- DENOTES UPGRADIENT LOCATION
- 1,313 SPECIFIC CONDUCTANCE (uS/cm), NOT DETECTED (ND) OR NOT RECORDED (NR)

**DRAWING REFERENCE(S):**



DATE OF SURVEY: MULTIPLE  
 SURVEYS BY: IOWA LIDAR PROJECT, XCEL ENGINEERING, AND SNYDER AND ASSOCIATES.

**BASIS OF BEARING:**

IOWA STATE PLANE SOUTH COORDINATE SYSTEM

**NOTES:**

1. LIDAR DATA WERE USED TO CREATE CONTOURS IN A 300' AREA OUTSIDE OF THE PROPERTY LINE. LIDAR DATA WERE OBTAINED FROM THE IOWA DEPARTMENT OF NATURAL RESOURCES. MAPPING WAS PERFORMED FROM 2008-2010 AND IS SHOWN IN THE NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD88). ACCURACY OF LIDAR DATA STATED AS ±8 INCHES BY IOWA DEPARTMENT OF NATURAL RESOURCES.
2. MW-4, MW-7, MW-10 USED FOR WATER LEVEL MEASUREMENT ONLY.



CENTRAL IOWA POWER COOPERATIVE  
 CIPCO FAIR STATION MONOFILL  
 ANNUAL WATER QUALITY REPORT

**SPECIFIC CONDUCTANCE VALUES  
 OCTOBER 2024**

Project No. 12560436  
 Date November 2024

**FIGURE 20**

# Appendices

# **Appendix A**

## **Monitoring Forms**



FORM FOR  
GROUNDWATER SAMPLING AND/OR  
GROUNDWATER ELEVATION MEASUREMENT

Site Name CIPCO Ash Disposal Landfill Permit No. 70-SDP-09-91P

Monitoring Well/Piezometer No. MW-1 Upgradient X  
Downgradient \_\_\_\_\_

Name Of person sampling Clint Oberbroeckling

A. MONITORING WELL/PIEZOMETER CONDITIONS

Well/piezometer Properly Capped? Yes Standing Water or Litter? No  
If no, explain \_\_\_\_\_ If yes, explain \_\_\_\_\_

B. GROUNDWATER ELEVATION MEASUREMENT (+/- 0.01 foot, MSL)

Elevation: Top of inner well casing 588.13 ft Ground Elevation 587.23 ft  
Depth of Well 36.27 ft Inside Casing Diameter (inches) 2.0 in  
Equipment Used Solinst Model 101 Water Level Probe

Groundwater Level (+/- 0.01 foot below top of inner casing, MSL):

	Date/Time	Depth to Groundwater	Groundwater Elevation
Before Purging	<u>10/22/2024 9:55</u>	<u>24.66 ft</u>	<u>563.47 ft</u>
* After Purging	<u>10/22/2024 10:35</u>	<u>24.68 ft</u>	<u>563.45 ft</u>
* Before Sampling	<u>10/22/2024 10:35</u>	<u>24.68 ft</u>	<u>563.45 ft</u>

\*C. WELL PURGING

Quantity of Water Removed from Well (gallons) 1.24 gallons  
No. of Well Volumes (based on current water level) 0.65 well volumes  
Was well pumped/bailed dry? No

Equipment used:

Bailer type \_\_\_\_\_ Dedicated Bailer \_\_\_\_\_  
Pump type Pneumatic Bladder Dedicated Pump No  
If not dedicated, method of cleaning Replace bladder, rinse w/water, dedicated tubing

\*D. FIELD MEASUREMENT

Weather Conditions Overcast  
Field Measurements (after stabilization)  
Temperature 13.06 Units °C  
Equipment Used Aquatroll 500  
pH 6.49  
Equipment Used Aquatroll 500  
Specific Cond. 1,313 Units µS/cm  
Equipment Used Aquatroll 500

Comments: ORP: -84.5 DO: 0.25 Turb.: 17.65 Sample Time: 10/22/2024 10:35

Note: Attach Laboratory Report and 8-1/2" x 11" site plan showing locations of all surface and groundwater monitoring points. One map per sampling round.

\*Omit if only measuring groundwater elevations.

# Low-Flow Test Report:

Test Date / Time: 10/22/2024 10:05:01 AM

Project: CIPCO-MW-1 (2)

Operator Name: Clint Oberbroeckling

<b>Location Name: MW-1</b> <b>Well Diameter: 2 in</b> <b>Casing Type: PVC</b> <b>Screen Length: 10 ft</b> <b>Top of Screen: 25 ft</b> <b>Total Depth: 35 ft</b> <b>Initial Depth to Water: 24.66 ft</b>	<b>Pump Type: QED Sample PRO</b> <b>Tubing Type: Nylon- Double Bonded</b> <b>Tubing Inner Diameter: 0.25 in</b> <b>Tubing Length: 35 ft</b> <b>Pump Intake From TOC: 30 ft</b> <b>Estimated Total Volume Pumped: 4680 ml</b> <b>Flow Cell Volume: 130 ml</b> <b>Final Flow Rate: 200 ml/min</b> <b>Final Draw Down: 0.02 ft</b>	<b>Instrument Used: Aqua TROLL 500</b> <b>Serial Number: 745294</b>
---	---	--

## Test Notes:

## Weather Conditions:

60° overcast

## Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 0.3	+/- 10	+/- 10	+/- 0.33	
10/22/2024 10:05 AM	00:00	6.70 pH	12.81 °C	1,223.9 µS/cm	7.37 mg/L	32.67 NTU	-73.0 mV	24.66 ft	200.00 ml/min
10/22/2024 10:08 AM	03:05	6.57 pH	12.43 °C	1,221.5 µS/cm	1.09 mg/L	24.07 NTU	-68.0 mV	24.68 ft	200.00 ml/min
10/22/2024 10:11 AM	06:10	6.55 pH	12.54 °C	1,223.6 µS/cm	0.53 mg/L	13.14 NTU	-70.6 mV	24.68 ft	200.00 ml/min
10/22/2024 10:14 AM	09:15	6.56 pH	12.54 °C	1,223.0 µS/cm	0.40 mg/L	8.99 NTU	-74.1 mV	24.68 ft	200.00 ml/min
10/22/2024 10:17 AM	12:20	6.51 pH	12.55 °C	1,233.9 µS/cm	0.36 mg/L	8.87 NTU	-74.6 mV	24.68 ft	200.00 ml/min
10/22/2024 10:20 AM	15:25	6.50 pH	12.97 °C	1,271.2 µS/cm	0.31 mg/L	10.79 NTU	-77.5 mV	24.68 ft	200.00 ml/min
10/22/2024 10:23 AM	18:30	6.49 pH	12.99 °C	1,299.7 µS/cm	0.30 mg/L	17.16 NTU	-80.5 mV	24.68 ft	200.00 ml/min
10/22/2024 10:25 AM	20:19	6.49 pH	12.96 °C	1,306.9 µS/cm	0.29 mg/L	16.93 NTU	-81.9 mV	24.68 ft	200.00 ml/min
10/22/2024 10:28 AM	23:24	6.49 pH	13.06 °C	1,312.5 µS/cm	0.25 mg/L	17.65 NTU	-84.5 mV	24.68 ft	200.00 ml/min

## Samples

Sample ID:	Description:
------------	--------------

MW-1	ST 1035
------	---------

Created using VuSitu from In-Situ, Inc.

FORM FOR  
GROUNDWATER SAMPLING AND/OR  
GROUNDWATER ELEVATION MEASUREMENT

Site Name CIPCO Ash Disposal Landfill Permit No. 70-SDP-09-91P

Monitoring Well/Piezometer No. MW-2 Upgradient \_\_\_\_\_  
Downgradient X

Name Of person sampling Clint Oberbroeckling

A. MONITORING WELL/PIEZOMETER CONDITIONS

Well/piezometer Properly Capped? Yes Standing Water or Litter? No  
If no, explain \_\_\_\_\_ If yes, explain \_\_\_\_\_

B. GROUNDWATER ELEVATION MEASUREMENT (+/- 0.01 foot, MSL)

Elevation: Top of inner well casing 559.43 ft Ground Elevation 557.67 ft  
Depth of Well 12.95 ft Inside Casing Diameter (inches) 2.0 in  
Equipment Used Solinst Model 101 Water Level Probe

Groundwater Level (+/- 0.01 foot below top of inner casing, MSL):

	Date/Time	Depth to Groundwater	Groundwater Elevation
Before Purging	<u>10/22/2024 15:30</u>	<u>7.08 ft</u>	<u>552.35 ft</u>
* After Purging	<u>10/22/2024 15:55</u>	<u>7.12 ft</u>	<u>552.31 ft</u>
* Before Sampling	<u>10/22/2024 15:55</u>	<u>7.12 ft</u>	<u>552.31 ft</u>

\*C. WELL PURGING

Quantity of Water Removed from Well (gallons) 0.47 gallons  
No. of Well Volumes (based on current water level) 0.49 well volumes  
Was well pumped/bailed dry? No

Equipment used:

Bailer type \_\_\_\_\_ Dedicated Bailer \_\_\_\_\_  
Pump type Pneumatic Bladder Dedicated Pump No  
If not dedicated, method of cleaning Replace bladder, rinse w/water, dedicated tubing

\*D. FIELD MEASUREMENT

Weather Conditions Sunny  
Field Measurements (after stabilization)  
Temperature 16.15 Units \_\_\_\_\_ °C  
Equipment Used Aquatroll 500  
pH 6.33  
Equipment Used Aquatroll 500  
Specific Cond. 872 Units \_\_\_\_\_ μS/cm  
Equipment Used Aquatroll 500

Comments: ORP: 119.6 DO: 0.76 Turb.: 8.10 Sample Time: 10/22/2024 15:55

Note: Attach Laboratory Report and 8-1/2" x 11" site plan showing locations of all surface and groundwater monitoring points. One map per sampling round.

\*Omit if only measuring groundwater elevations.

# Low-Flow Test Report:

Test Date / Time: 10/22/2024 3:32:28 PM

Project: CIPCO-MW-2 (2)

Operator Name: Clint Oberbroeckling

<b>Location Name: MW-2</b> <b>Well Diameter: 2 in</b> <b>Casing Type: PVC</b> <b>Screen Length: 10 ft</b> <b>Top of Screen: 2.95 ft</b> <b>Total Depth: 12.95 ft</b> <b>Initial Depth to Water: 7.08 ft</b>	<b>Pump Type: QED Sample PRO</b> <b>Tubing Type: Nylon- Double Bonded</b> <b>Tubing Inner Diameter: 0.25 in</b> <b>Tubing Length: 12.95 ft</b> <b>Pump Intake From TOC: 7.95 ft</b> <b>Estimated Total Volume Pumped: 1787.5 ml</b> <b>Flow Cell Volume: 130 ml</b> <b>Final Flow Rate: 150 ml/min</b> <b>Final Draw Down: 0.04 ft</b>	<b>Instrument Used: Aqua TROLL 500</b> <b>Serial Number: 745294</b>
---	--	--

## Test Notes:

## Weather Conditions:

80° sunny

## Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 0.3	+/- 10	+/- 10	+/- 0.33	
10/22/2024 3:32 PM	00:00	6.31 pH	17.02 °C	890.56 µS/cm	1.61 mg/L	55.14 NTU	120.5 mV	7.08 ft	150.00 ml/min
10/22/2024 3:34 PM	02:23	6.32 pH	16.64 °C	869.12 µS/cm	1.33 mg/L	35.02 NTU	118.8 mV	7.12 ft	150.00 ml/min
10/22/2024 3:37 PM	04:46	6.32 pH	16.41 °C	879.67 µS/cm	1.03 mg/L	26.44 NTU	119.2 mV	7.12 ft	150.00 ml/min
10/22/2024 3:39 PM	07:09	6.32 pH	16.34 °C	873.19 µS/cm	0.90 mg/L	12.87 NTU	119.2 mV	7.12 ft	150.00 ml/min
10/22/2024 3:42 PM	09:32	6.33 pH	16.20 °C	877.08 µS/cm	0.83 mg/L	12.33 NTU	119.7 mV	7.12 ft	150.00 ml/min
10/22/2024 3:44 PM	11:55	6.33 pH	16.15 °C	871.52 µS/cm	0.76 mg/L	8.10 NTU	119.6 mV	7.12 ft	150.00 ml/min

## Samples

Sample ID:	Description:
MW-2	ST-1555

FORM FOR  
GROUNDWATER SAMPLING AND/OR  
GROUNDWATER ELEVATION MEASUREMENT

Site Name CIPCO Ash Disposal Landfill Permit No. 70-SDP-09-91P

Monitoring Well/Piezometer No. MW-3 Upgradient \_\_\_\_\_  
Downgradient X

Name Of person sampling Clint Oberbroeckling

A. MONITORING WELL/PIEZOMETER CONDITIONS

Well/piezometer Properly Capped? Yes Standing Water or Litter? No  
If no, explain \_\_\_\_\_ If yes, explain \_\_\_\_\_

B. GROUNDWATER ELEVATION MEASUREMENT (+/- 0.01 foot, MSL)

Elevation: Top of inner well casing 559.17 ft Ground Elevation 556.69 ft  
Depth of Well 46.75 ft Inside Casing Diameter (inches) 2.0 in  
Equipment Used Solinst Model 101 Water Level Probe

Groundwater Level (+/- 0.01 foot below top of inner casing, MSL):

	Date/Time	Depth to Groundwater	Groundwater Elevation
Before Purging	<u>10/22/2024 15:30</u>	<u>9.30 ft</u>	<u>549.87 ft</u>
* After Purging	<u>10/22/2024 17:30</u>	<u>9.55 ft</u>	<u>549.62 ft</u>
* Before Sampling	<u>10/22/2024 17:30</u>	<u>9.55 ft</u>	<u>549.62 ft</u>

\*C. WELL PURGING

Quantity of Water Removed from Well (gallons) 6.47 gallons  
No. of Well Volumes (based on current water level) 1.06 well volumes  
Was well pumped/bailed dry? No

Equipment used:

Bailer type \_\_\_\_\_ Dedicated Bailer \_\_\_\_\_  
Pump type Pneumatic Bladder Dedicated Pump No  
If not dedicated, method of cleaning Replace bladder, rinse w/water, dedicated tubing

\*D. FIELD MEASUREMENT

Weather Conditions Sunny  
Field Measurements (after stabilization)  
Temperature 14.72 Units \_\_\_\_\_ °C  
Equipment Used Aquatroll 500  
pH 6.85  
Equipment Used Aquatroll 500  
Specific Cond. 622 Units \_\_\_\_\_ μS/cm  
Equipment Used Aquatroll 500

Comments: ORP: 15.8 DO: 0.07 Turb.: 15.80 Sample Time: 10/22/2024 17:30

Note: Attach Laboratory Report and 8-1/2" x 11" site plan showing locations of all surface and groundwater monitoring points. One map per sampling round.

\*Omit if only measuring groundwater elevations.

# Low-Flow Test Report:

Test Date / Time: 10/22/2024 3:58:06 PM

Project: CIPCO-MW-3 (3)

Operator Name: Clint Oberbroeckling

<b>Location Name: MW-3</b> <b>Well Diameter: 2 in</b> <b>Casing Type: PVC</b> <b>Screen Length: 10 ft</b> <b>Top of Screen: 36.5 ft</b> <b>Total Depth: 46.5 ft</b> <b>Initial Depth to Water: 9.3 ft</b>	<b>Pump Type: QED Sample PRO</b> <b>Tubing Type: Nylon- Double Bonded</b> <b>Tubing Inner Diameter: 0.25 in</b> <b>Tubing Length: 46.5 ft</b> <b>Pump Intake From TOC: 41.5 ft</b> <b>Estimated Total Volume Pumped: 24510 ml</b> <b>Flow Cell Volume: 130 ml</b> <b>Final Flow Rate: 300 ml/min</b> <b>Final Draw Down: 0.25 ft</b>	<b>Instrument Used: Aqua TROLL 500</b> <b>Serial Number: 745294</b>
---	--	--

## Test Notes:

## Weather Conditions:

80° sunny

## Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 0.3	+/- 10	+/- 10	+/- 0.33	
10/22/2024 3:58 PM	00:00	6.72 pH	17.36 °C	596.50 µS/cm	2.15 mg/L	45.97 NTU	122.5 mV	9.30 ft	300.00 ml/min
10/22/2024 4:01 PM	03:27	6.91 pH	16.96 °C	555.38 µS/cm	2.16 mg/L	718.11 NTU	-15.9 mV	9.45 ft	300.00 ml/min
10/22/2024 4:05 PM	06:54	6.96 pH	16.69 °C	531.62 µS/cm	1.18 mg/L	957.61 NTU	-20.6 mV	9.55 ft	300.00 ml/min
10/22/2024 4:08 PM	10:21	6.96 pH	16.42 °C	527.11 µS/cm	0.83 mg/L	1,243.5 NTU	-15.9 mV	9.55 ft	300.00 ml/min
10/22/2024 4:11 PM	13:48	6.96 pH	16.22 °C	529.26 µS/cm	0.70 mg/L	1,140.1 NTU	-14.5 mV	9.55 ft	300.00 ml/min
10/22/2024 4:15 PM	17:15	6.96 pH	16.25 °C	529.86 µS/cm	0.59 mg/L	1,146.0 NTU	-14.0 mV	9.55 ft	300.00 ml/min
10/22/2024 4:18 PM	20:42	6.99 pH	16.21 °C	532.62 µS/cm	0.51 mg/L	1,033.4 NTU	-15.8 mV	9.55 ft	300.00 ml/min
10/22/2024 4:22 PM	24:09	6.95 pH	16.20 °C	537.59 µS/cm	0.75 mg/L	1,103.0 NTU	-14.3 mV	9.55 ft	300.00 ml/min
10/22/2024 4:25 PM	27:36	7.12 pH	16.68 °C	0.07 µS/cm	8.82 mg/L	0.00 NTU	0.1 mV	9.55 ft	300.00 ml/min
10/22/2024 4:29 PM	31:03	6.93 pH	14.99 °C	549.63 µS/cm	0.51 mg/L	808.54 NTU	-13.6 mV	9.55 ft	300.00 ml/min
10/22/2024 4:32 PM	34:30	6.92 pH	15.01 °C	555.71 µS/cm	0.28 mg/L	673.97 NTU	-20.9 mV	9.55 ft	300.00 ml/min
10/22/2024 4:36 PM	37:57	6.91 pH	14.99 °C	563.26 µS/cm	0.21 mg/L	800.68 NTU	-23.7 mV	9.55 ft	300.00 ml/min

10/22/2024 4:39 PM	41:24	6.90 pH	14.90 °C	569.69 µS/cm	0.17 mg/L	655.31 NTU	-22.6 mV	9.55 ft	300.00 ml/min
10/22/2024 4:42 PM	44:51	6.89 pH	15.02 °C	576.53 µS/cm	0.15 mg/L	567.19 NTU	-21.3 mV	9.55 ft	300.00 ml/min
10/22/2024 4:46 PM	48:18	6.88 pH	14.99 °C	583.46 µS/cm	0.13 mg/L	488.14 NTU	-18.3 mV	9.55 ft	300.00 ml/min
10/22/2024 4:49 PM	51:45	6.88 pH	14.88 °C	587.82 µS/cm	0.11 mg/L	415.47 NTU	-15.1 mV	9.55 ft	300.00 ml/min
10/22/2024 4:53 PM	55:12	6.88 pH	14.99 °C	591.46 µS/cm	0.11 mg/L	553.67 NTU	-12.3 mV	9.55 ft	300.00 ml/min
10/22/2024 4:56 PM	58:39	6.87 pH	14.94 °C	597.48 µS/cm	0.11 mg/L	453.07 NTU	-8.2 mV	9.55 ft	300.00 ml/min
10/22/2024 5:00 PM	01:02:06	6.87 pH	14.97 °C	602.44 µS/cm	0.10 mg/L	393.70 NTU	-4.7 mV	9.55 ft	300.00 ml/min
10/22/2024 5:03 PM	01:05:33	6.86 pH	14.86 °C	605.39 µS/cm	0.10 mg/L	342.55 NTU	-0.9 mV	9.55 ft	300.00 ml/min
10/22/2024 5:07 PM	01:09:00	6.87 pH	14.93 °C	610.39 µS/cm	0.09 mg/L	284.50 NTU	2.7 mV	9.55 ft	300.00 ml/min
10/22/2024 5:10 PM	01:12:27	6.86 pH	14.68 °C	612.43 µS/cm	0.08 mg/L	300.88 NTU	6.7 mV	9.55 ft	300.00 ml/min
10/22/2024 5:14 PM	01:15:54	6.86 pH	14.67 °C	616.74 µS/cm	0.08 mg/L	251.08 NTU	10.7 mV	9.55 ft	300.00 ml/min
10/22/2024 5:16 PM	01:18:15	6.85 pH	14.68 °C	619.16 µS/cm	0.09 mg/L	293.30 NTU	12.4 mV	9.55 ft	300.00 ml/min
10/22/2024 5:19 PM	01:21:42	6.85 pH	14.72 °C	622.47 µS/cm	0.07 mg/L	268.68 NTU	15.8 mV	9.55 ft	300.00 ml/min

## Samples

Sample ID:	Description:
MW-3	ST-1730



FORM FOR  
GROUNDWATER SAMPLING AND/OR  
GROUNDWATER ELEVATION MEASUREMENT

Site Name CIPCO Ash Disposal Landfill Permit No. 70-SDP-09-91P

Monitoring Well/Piezometer No. MW-4 Upgradient \_\_\_\_\_  
Downgradient X

Name Of person sampling Clint Oberbroeckling

A. MONITORING WELL/PIEZOMETER CONDITIONS

Well/piezometer Properly Capped? Yes Standing Water or Litter? No  
If no, explain \_\_\_\_\_ If yes, explain \_\_\_\_\_

B. GROUNDWATER ELEVATION MEASUREMENT (+/- 0.01 foot, MSL)

Elevation: Top of inner well casing 556.92 ft Ground Elevation 555.34 ft  
Depth of Well 10.45 ft Inside Casing Diameter (inches) 2.0 in  
Equipment Used Solinst Model 101 Water Level Probe

Groundwater Level (+/- 0.01 foot below top of inner casing, MSL):

	Date/Time	Depth to Groundwater	Groundwater Elevation
Before Purging	<u>10/22/2024</u>	<u>9.42 ft</u>	<u>547.50 ft</u>
* After Purging	_____	_____	_____
* Before Sampling	_____	_____	_____

\*C. WELL PURGING

Quantity of Water Removed from Well (gallons) \_\_\_\_\_ Water Level Only  
No. of Well Volumes (based on current water level) \_\_\_\_\_  
Was well pumped/bailed dry? \_\_\_\_\_

Equipment used:  
Bailer type \_\_\_\_\_ Dedicated Bailer \_\_\_\_\_  
Pump type \_\_\_\_\_ Dedicated Pump \_\_\_\_\_  
If not dedicated, method of cleaning \_\_\_\_\_

\*D. FIELD MEASUREMENT

Weather Conditions \_\_\_\_\_  
Field Measurements (after stabilization)  
Temperature \_\_\_\_\_ Units \_\_\_\_\_  
Equipment Used Aquatroll 500  
pH \_\_\_\_\_  
Equipment Used Aquatroll 500  
Specific Cond. \_\_\_\_\_ Units \_\_\_\_\_  
Equipment Used Aquatroll 500

Comments: No sample

Note: Attach Laboratory Report and 8-1/2" x 11" site plan showing locations of all surface and groundwater monitoring points. One map per sampling round.

\*Omit if only measuring groundwater elevations.

FORM FOR  
GROUNDWATER SAMPLING AND/OR  
GROUNDWATER ELEVATION MEASUREMENT

Site Name CIPCO Ash Disposal Landfill Permit No. 70-SDP-09-91P

Monitoring Well/Piezometer No. MW-5 Upgradient \_\_\_\_\_  
Downgradient X

Name Of person sampling Clint Oberbroeckling

A. MONITORING WELL/PIEZOMETER CONDITIONS

Well/piezometer Properly Capped? Yes Standing Water or Litter? No  
If no, explain \_\_\_\_\_ If yes, explain \_\_\_\_\_

B. GROUNDWATER ELEVATION MEASUREMENT (+/- 0.01 foot, MSL)

Elevation: Top of inner well casing 555.54 ft Ground Elevation 553.24 ft  
Depth of Well 28.50 ft Inside Casing Diameter (inches) 2.0 in  
Equipment Used Solinst Model 101 Water Level Probe

Groundwater Level (+/- 0.01 foot below top of inner casing, MSL):

	Date/Time	Depth to Groundwater	Groundwater Elevation
Before Purging	<u>10/22/2024 11:53</u>	<u>6.52 ft</u>	<u>549.02 ft</u>
* After Purging	<u>10/22/2024 12:20</u>	<u>7.20 ft</u>	<u>548.34 ft</u>
* Before Sampling	<u>10/22/2024 12:20</u>	<u>7.20 ft</u>	<u>548.34 ft</u>

\*C. WELL PURGING

Quantity of Water Removed from Well (gallons) 0.5 gallons  
No. of Well Volumes (based on current water level) 0.14 well volumes  
Was well pumped/bailed dry? No

Equipment used:  
Bailer type \_\_\_\_\_ Dedicated Bailer \_\_\_\_\_  
Pump type Pneumatic Bladder Dedicated Pump No  
If not dedicated, method of cleaning Replace bladder, rinse w/water, dedicated tubing

\*D. FIELD MEASUREMENT

Weather Conditions Sunny  
Field Measurements (after stabilization)  
Temperature 16.03 Units \_\_\_\_\_ °C  
Equipment Used Aquatroll 500  
pH 6.63  
Equipment Used Aquatroll 500  
Specific Cond. 929 Units \_\_\_\_\_ μS/cm  
Equipment Used Aquatroll 500

Comments: ORP: 131.2 DO: 0.34 Turb.: 0.91 Sample Time: 10/22/2024 12:20

Note: Attach Laboratory Report and 8-1/2" x 11" site plan showing locations of all surface and groundwater monitoring points. One map per sampling round.

\*Omit if only measuring groundwater elevations.

# Low-Flow Test Report:

Test Date / Time: 10/22/2024 12:07:20 PM

Project: CIPCO-MW-5 (2)

Operator Name: Clint Oberbroeckling

<b>Location Name: MW-5</b> <b>Well Diameter: 2 in</b> <b>Casing Type: PVC</b> <b>Screen Length: 10 ft</b> <b>Top of Screen: 18.5 ft</b> <b>Total Depth: 28.5 ft</b> <b>Initial Depth to Water: 6.52 ft</b>	<b>Pump Type: QED Sample PRO</b> <b>Tubing Type: Nylon- Double Bonded</b> <b>Tubing Inner Diameter: 0.25 in</b> <b>Tubing Length: 28.5 ft</b> <b>Pump Intake From TOC: 23.5 ft</b> <b>Estimated Total Volume Pumped: 1900 ml</b> <b>Flow Cell Volume: 130 ml</b> <b>Final Flow Rate: 200 ml/min</b> <b>Final Draw Down: 0.68 ft</b>	<b>Instrument Used: Aqua TROLL 500</b> <b>Serial Number: 745294</b>
--	---	--

## Test Notes:

## Weather Conditions:

65° sunny

## Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 0.3	+/- 10 %	+/- 10	+/- 1	
10/22/2024 12:07 PM	00:00	6.67 pH	16.74 °C	907.38 µS/cm	1.14 mg/L	5.66 NTU	148.2 mV	6.52 ft	200.00 ml/min
10/22/2024 12:10 PM	02:53	6.68 pH	16.58 °C	908.09 µS/cm	0.50 mg/L	0.94 NTU	136.4 mV	6.52 ft	200.00 ml/min
10/22/2024 12:13 PM	05:46	6.67 pH	16.22 °C	913.36 µS/cm	0.39 mg/L	0.00 NTU	132.5 mV	7.20 ft	200.00 ml/min
10/22/2024 12:13 PM	06:37	6.66 pH	16.23 °C	916.00 µS/cm	0.37 mg/L	2.47 NTU	132.2 mV	7.20 ft	200.00 ml/min
10/22/2024 12:16 PM	09:30	6.63 pH	16.03 °C	928.62 µS/cm	0.34 mg/L	0.91 NTU	131.2 mV	7.20 ft	200.00 ml/min

## Samples

Sample ID:	Description:
MW-5	ST-1220

FORM FOR  
GROUNDWATER SAMPLING AND/OR  
GROUNDWATER ELEVATION MEASUREMENT

Site Name CIPCO Ash Disposal Landfill Permit No. 70-SDP-09-91P

Monitoring Well/Piezometer No. MW-6 Upgradient \_\_\_\_\_  
Downgradient X

Name Of person sampling Clint Oberbroeckling

A. MONITORING WELL/PIEZOMETER CONDITIONS

Well/piezometer Properly Capped? Yes Standing Water or Litter? No  
If no, explain \_\_\_\_\_ If yes, explain \_\_\_\_\_

B. GROUNDWATER ELEVATION MEASUREMENT (+/- 0.01 foot, MSL)

Elevation: Top of inner well casing 555.88 ft Ground Elevation 553.47 ft  
Depth of Well 15.10 ft Inside Casing Diameter (inches) 2.0 in  
Equipment Used Solinst Model 101 Water Level Probe

Groundwater Level (+/- 0.01 foot below top of inner casing, MSL):

	Date/Time	Depth to Groundwater	Groundwater Elevation
Before Purging	<u>10/22/2024 11:54</u>	<u>7.68 ft</u>	<u>548.20 ft</u>
* After Purging	<u>10/22/2024 13:00</u>	<u>7.78 ft</u>	<u>548.10 ft</u>
* Before Sampling	<u>10/22/2024 13:00</u>	<u>7.78 ft</u>	<u>548.10 ft</u>

\*C. WELL PURGING

Quantity of Water Removed from Well (gallons) 0.52 gallons  
No. of Well Volumes (based on current water level) 0.43 well volumes  
Was well pumped/bailed dry? No

Equipment used:

Bailer type \_\_\_\_\_ Dedicated Bailer \_\_\_\_\_  
Pump type Pneumatic Bladder Dedicated Pump No  
If not dedicated, method of cleaning Replace bladder, rinse w/water, dedicated tubing

\*D. FIELD MEASUREMENT

Weather Conditions Sunny  
Field Measurements (after stabilization)  
Temperature 17.15 Units \_\_\_\_\_ °C  
Equipment Used Aquatroll 500  
pH 6.55  
Equipment Used Aquatroll 500  
Specific Cond. 903 Units \_\_\_\_\_ μS/cm  
Equipment Used Aquatroll 500

Comments: ORP: -87.6 DO: 0.09 Turb.: 2.33 Sample Time: 10/22/2024 13:00

Note: Attach Laboratory Report and 8-1/2" x 11" site plan showing locations of all surface and groundwater monitoring points. One map per sampling round.

\*Omit if only measuring groundwater elevations.

# Low-Flow Test Report:

Test Date / Time: 10/22/2024 12:40:30 PM

Project: CIPCO - MW-6 (2)

Operator Name: Clint Oberbroeckling

<b>Location Name: MW-6</b> <b>Well Diameter: 2 in</b> <b>Casing Type: PVC</b> <b>Screen Length: 10 ft</b> <b>Top of Screen: 5.08 ft</b> <b>Total Depth: 15.08 ft</b> <b>Initial Depth to Water: 7.68 ft</b>	<b>Pump Type: QED Sample PRO</b> <b>Tubing Type: Nylon- Double Bonded</b> <b>Tubing Inner Diameter: 0.25 in</b> <b>Tubing Length: 15.08 ft</b> <b>Pump Intake From TOC: 10.08 ft</b> <b>Estimated Total Volume Pumped: 1960 ml</b> <b>Flow Cell Volume: 130 ml</b> <b>Final Flow Rate: 200 ml/min</b> <b>Final Draw Down: 0.1 ft</b>	<b>Instrument Used: Aqua TROLL 500</b> <b>Serial Number: 745294</b>
---	--	--

## Test Notes:

## Weather Conditions:

65° sunny

## Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 0.3	+/- 10	+/- 10	+/- 1	
10/22/2024 12:40 PM	00:00	6.59 pH	17.27 °C	898.83 µS/cm	0.34 mg/L	7.02 NTU	-58.9 mV	7.68 ft	200.00 ml/min
10/22/2024 12:42 PM	02:27	6.54 pH	17.20 °C	903.04 µS/cm	0.22 mg/L	6.93 NTU	-70.4 mV	7.78 ft	200.00 ml/min
10/22/2024 12:45 PM	04:54	6.54 pH	17.13 °C	902.46 µS/cm	0.14 mg/L	2.28 NTU	-78.7 mV	7.78 ft	200.00 ml/min
10/22/2024 12:47 PM	07:21	6.54 pH	17.18 °C	899.01 µS/cm	0.10 mg/L	2.32 NTU	-84.1 mV	7.78 ft	200.00 ml/min
10/22/2024 12:50 PM	09:48	6.55 pH	17.15 °C	903.37 µS/cm	0.09 mg/L	2.33 NTU	-87.6 mV	7.78 ft	200.00 ml/min

## Samples

Sample ID:	Description:
MW-6	ST-1300

FORM FOR  
GROUNDWATER SAMPLING AND/OR  
GROUNDWATER ELEVATION MEASUREMENT

Site Name CIPCO Ash Disposal Landfill Permit No. 70-SDP-09-91P

Monitoring Well/Piezometer No. MW-7 Upgradient \_\_\_\_\_  
Downgradient X

Name Of person sampling Clint Oberbroeckling

A. MONITORING WELL/PIEZOMETER CONDITIONS

Well/piezometer Properly Capped? Yes Standing Water or Litter? No  
If no, explain \_\_\_\_\_ If yes, explain \_\_\_\_\_

B. GROUNDWATER ELEVATION MEASUREMENT (+/- 0.01 foot, MSL)

Elevation: Top of inner well casing 556.77 ft Ground Elevation 555.05 ft  
Depth of Well 18.19 ft Inside Casing Diameter (inches) 2.0 in  
Equipment Used Solinst Model 101 Water Level Probe

Groundwater Level (+/- 0.01 foot below top of inner casing, MSL):

	Date/Time	Depth to Groundwater	Groundwater Elevation
Before Purging	<u>10/22/2024</u>	<u>3.37 ft</u>	<u>553.40 ft</u>
* After Purging	_____	_____	_____
* Before Sampling	_____	_____	_____

\*C. WELL PURGING

Quantity of Water Removed from Well (gallons) \_\_\_\_\_ Water Level Only  
No. of Well Volumes (based on current water level) \_\_\_\_\_  
Was well pumped/bailed dry? \_\_\_\_\_

Equipment used:  
Bailer type \_\_\_\_\_ Dedicated Bailer \_\_\_\_\_  
Pump type \_\_\_\_\_ Dedicated Pump \_\_\_\_\_  
If not dedicated, method of cleaning \_\_\_\_\_

\*D. FIELD MEASUREMENT

Weather Conditions \_\_\_\_\_  
Field Measurements (after stabilization)  
Temperature \_\_\_\_\_ Units \_\_\_\_\_  
Equipment Used Aquatroll 500  
pH \_\_\_\_\_  
Equipment Used Aquatroll 500  
Specific Cond. \_\_\_\_\_ Units \_\_\_\_\_  
Equipment Used \_\_\_\_\_

Comments: No sample

Note: Attach Laboratory Report and 8-1/2" x 11" site plan showing locations of all surface and groundwater monitoring points. One map per sampling round.

\*Omit if only measuring groundwater elevations.

FORM FOR  
GROUNDWATER SAMPLING AND/OR  
GROUNDWATER ELEVATION MEASUREMENT

Site Name CIPCO Ash Disposal Landfill Permit No. 70-SDP-09-91P

Monitoring Well/Piezometer No. MW-9 Upgradient X  
Downgradient \_\_\_\_\_

Name Of person sampling Clint Oberbroeckling

A. MONITORING WELL/PIEZOMETER CONDITIONS

Well/piezometer Properly Capped? Yes Standing Water or Litter? No  
If no, explain \_\_\_\_\_ If yes, explain \_\_\_\_\_

B. GROUNDWATER ELEVATION MEASUREMENT (+/- 0.01 foot, MSL)

Elevation: Top of inner well casing 629.13 ft Ground Elevation 627.04 ft  
Depth of Well 118.67 ft Inside Casing Diameter (inches) 2.0 in  
Equipment Used Solinst Model 101 Water Level Probe

Groundwater Level (+/- 0.01 foot below top of inner casing, MSL):

	Date/Time	Depth to Groundwater	Groundwater Elevation
Before Purging	<u>10/22/2024 17:42</u>	<u>32.20 ft</u>	<u>596.93 ft</u>
* After Purging	<u>10/22/2024 18:00</u>	<u>32.20 ft</u>	<u>596.93 ft</u>
* Before Sampling	<u>10/22/2024 18:00</u>	<u>32.20 ft</u>	<u>596.93 ft</u>

\*C. WELL PURGING

Quantity of Water Removed from Well (gallons) not full purge  
No. of Well Volumes (based on current water level) \_\_\_\_\_  
Was well pumped/bailed dry? No

Equipment used:

Bailer type Disposable Polyethylene Dedicated Bailer Yes  
Pump type \_\_\_\_\_ Dedicated Pump \_\_\_\_\_  
If not dedicated, method of cleaning \_\_\_\_\_

\*D. FIELD MEASUREMENT

Weather Conditions Sunny

Field Measurements (after stabilization)

Temperature 14.84 Units °C  
Equipment Used Aquatroll 500  
pH 7.27  
Equipment Used Aquatroll 500  
Specific Cond. 689 Units µS/cm  
Equipment Used Aquatroll 500

Comments: ORP: 162.2 DO: 8.04 Turb.: 0.42 Sample Time: 10/22/2024 18:00

Note: Attach Laboratory Report and 8-1/2" x 11" site plan showing locations of all surface and groundwater monitoring points. One map per sampling round.

\*Omit if only measuring groundwater elevations.

# Low-Flow Test Report:

Test Date / Time: 10/22/2024 5:52:06 PM

Project: CIPCO-MW-9 (2)

Operator Name: Clint Oberbroeckling

<b>Location Name: MW-9</b> <b>Well Diameter: 2 in</b> <b>Casing Type: PVC</b> <b>Screen Length: 10 ft</b> <b>Top of Screen: 108.65 ft</b> <b>Total Depth: 118.65 ft</b> <b>Initial Depth to Water: 32.2 ft</b>	<b>Pump Type: QED Sample PRO</b> <b>Tubing Type: Nylon- Double Bonded</b> <b>Tubing Inner Diameter: 0.25 in</b> <b>Tubing Length: 118.65 ft</b> <b>Pump Intake From TOC: 113.65 ft</b> <b>Estimated Total Volume Pumped: 0 ml</b> <b>Flow Cell Volume: 130 ml</b> <b>Final Flow Rate: 300 ml/min</b> <b>Final Draw Down: 0 ft</b>	<b>Instrument Used: Aqua TROLL 500</b> <b>Serial Number: 745294</b>
--	---	--

## Test Notes:

## Weather Conditions:

75° sunny

## Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 0.3	+/- 10 %	+/- 10	+/- 5	
10/22/2024 5:52 PM	00:00	7.27 pH	14.84 °C	688.96 µS/cm	8.04 mg/L	0.42 NTU	162.2 mV	981.46 cm	300.00 ml/min

## Samples

Sample ID:	Description:
MW-9	ST-1800



FORM FOR  
GROUNDWATER SAMPLING AND/OR  
GROUNDWATER ELEVATION MEASUREMENT

Site Name CIPCO Ash Disposal Landfill Permit No. 70-SDP-09-91P

Monitoring Well/Piezometer No. MW-10 Upgradient X  
Downgradient \_\_\_\_\_

Name Of person sampling Clint Oberbroeckling

A. MONITORING WELL/PIEZOMETER CONDITIONS

Well/piezometer Properly Capped? Yes Standing Water or Litter? No  
If no, explain \_\_\_\_\_ If yes, explain \_\_\_\_\_

B. GROUNDWATER ELEVATION MEASUREMENT (+/- 0.01 foot, MSL)

Elevation: Top of inner well casing 629.39 ft Ground Elevation 627.21 ft  
Depth of Well 32.25 ft Inside Casing Diameter (inches) 2.0 in  
Equipment Used Solinst Model 101 Water Level Probe

Groundwater Level (+/- 0.01 foot below top of inner casing, MSL):

	Date/Time	Depth to Groundwater	Groundwater Elevation
Before Purging	<u>10/22/2024</u>	<u>22.21 ft</u>	<u>607.18 ft</u>
* After Purging	_____	_____	_____
* Before Sampling	_____	_____	_____

\*C. WELL PURGING

Quantity of Water Removed from Well (gallons) \_\_\_\_\_ Water Level Only  
No. of Well Volumes (based on current water level) \_\_\_\_\_  
Was well pumped/bailed dry? \_\_\_\_\_

Equipment used:  
Bailer type \_\_\_\_\_ Dedicated Bailer \_\_\_\_\_  
Pump type \_\_\_\_\_ Dedicated Pump \_\_\_\_\_  
If not dedicated, method of cleaning \_\_\_\_\_

\*D. FIELD MEASUREMENT

Weather Conditions \_\_\_\_\_  
Field Measurements (after stabilization)  
Temperature \_\_\_\_\_ Units \_\_\_\_\_  
Equipment Used Aquatroll 500  
pH \_\_\_\_\_  
Equipment Used Aquatroll 500  
Specific Cond. \_\_\_\_\_ Units \_\_\_\_\_  
Equipment Used \_\_\_\_\_

Comments: No sample

Note: Attach Laboratory Report and 8-1/2" x 11" site plan showing locations of all surface and groundwater monitoring points. One map per sampling round.

\*Omit if only measuring groundwater elevations.

FORM FOR  
GROUNDWATER SAMPLING AND/OR  
GROUNDWATER ELEVATION MEASUREMENT

Site Name CIPCO Ash Disposal Landfill Permit No. 70-SDP-09-91P

Monitoring Well/Piezometer No. MW-11 Upgradient X  
Downgradient \_\_\_\_\_

Name Of person sampling Clint Oberbroeckling

A. MONITORING WELL/PIEZOMETER CONDITIONS

Well/piezometer Properly Capped? Yes Standing Water or Litter? No  
If no, explain \_\_\_\_\_ If yes, explain \_\_\_\_\_

B. GROUNDWATER ELEVATION MEASUREMENT (+/- 0.01 foot, MSL)

Elevation: Top of inner well casing 587.99 ft Ground Elevation 586.18 ft  
Depth of Well 20.40 ft Inside Casing Diameter (inches) 2.0 in  
Equipment Used Solinst Model 101 Water Level Probe

Groundwater Level (+/- 0.01 foot below top of inner casing, MSL):

	Date/Time	Depth to Groundwater	Groundwater Elevation
Before Purging	<u>10/22/2024 8:10</u>	<u>6.71 ft</u>	<u>581.28 ft</u>
* After Purging	<u>10/22/2024 9:00</u>	<u>6.71 ft</u>	<u>581.28 ft</u>
* Before Sampling	<u>10/22/2024 9:00</u>	<u>6.71 ft</u>	<u>581.28 ft</u>

\*C. WELL PURGING

Quantity of Water Removed from Well (gallons) 1.08 gallons  
No. of Well Volumes (based on current water level) 0.48 well volumes  
Was well pumped/bailed dry? No

Equipment used:

Bailer type \_\_\_\_\_ Dedicated Bailer \_\_\_\_\_  
Pump type Pneumatic Bladder Dedicated Pump No  
If not dedicated, method of cleaning Replace bladder, rinse w/water, dedicated tubing

\*D. FIELD MEASUREMENT

Weather Conditions Overcast, light rain  
Field Measurements (after stabilization)  
Temperature 14.67 Units °C  
Equipment Used Aquatroll 500  
pH 6.55  
Equipment Used Aquatroll 500  
Specific Cond. 942 Units µS/cm  
Equipment Used Aquatroll 500

Comments: ORP: 201.1 DO: 0.97 Turb.: 7.38 Sample Time: 10/22/2024 9:00

Note: Attach Laboratory Report and 8-1/2" x 11" site plan showing locations of all surface and groundwater monitoring points. One map per sampling round.

\*Omit if only measuring groundwater elevations.

# Low-Flow Test Report:

Test Date / Time: 10/22/2024 8:38:03 AM

Project: CIPCO-MW-11 (2)

Operator Name: Clint Oberbroeckling

<b>Location Name: MW-11</b> <b>Well Diameter: 2 in</b> <b>Casing Type: PVC</b> <b>Screen Length: 10 ft</b> <b>Top of Screen: 10.4 ft</b> <b>Total Depth: 20.4 ft</b> <b>Initial Depth to Water: 6.71 ft</b>	<b>Pump Type: QED Sample PRO</b> <b>Tubing Type: Nylon- Double Bonded</b> <b>Tubing Inner Diameter: 0.25 in</b> <b>Tubing Length: 20.4 ft</b> <b>Pump Intake From TOC: 15.4 ft</b> <b>Estimated Total Volume Pumped: 4079.167 ml</b> <b>Flow Cell Volume: 130 ml</b> <b>Final Flow Rate: 250 ml/min</b> <b>Final Draw Down: 0 ft</b>	<b>Instrument Used: Aqua TROLL 500</b> <b>Serial Number: 745294</b>
---	--	--

## Test Notes:

## Weather Conditions:

55° overcast light rain

## Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 0.3	+/- 10	+/- 10	+/- 0.33	
10/22/2024 8:38 AM	00:00	6.49 pH	15.10 °C	956.05 µS/cm	2.49 mg/L	25.97 NTU	206.7 mV	6.71 ft	250.00 ml/min
10/22/2024 8:40 AM	02:37	6.53 pH	14.57 °C	949.23 µS/cm	1.20 mg/L	15.50 NTU	212.2 mV	6.71 ft	250.00 ml/min
10/22/2024 8:43 AM	05:14	6.56 pH	14.32 °C	947.21 µS/cm	0.97 mg/L	15.62 NTU	207.9 mV	6.71 ft	250.00 ml/min
10/22/2024 8:45 AM	07:51	6.57 pH	14.57 °C	945.98 µS/cm	0.86 mg/L	12.26 NTU	211.8 mV	6.71 ft	250.00 ml/min
10/22/2024 8:48 AM	10:28	6.54 pH	14.64 °C	944.54 µS/cm	0.87 mg/L	11.42 NTU	205.3 mV	6.71 ft	250.00 ml/min
10/22/2024 8:51 AM	13:05	6.57 pH	14.68 °C	943.80 µS/cm	0.87 mg/L	9.12 NTU	196.8 mV	6.71 ft	250.00 ml/min
10/22/2024 8:51 AM	13:42	6.53 pH	14.65 °C	942.82 µS/cm	0.88 mg/L	9.61 NTU	200.1 mV	6.71 ft	250.00 ml/min
10/22/2024 8:54 AM	16:19	6.55 pH	14.67 °C	942.12 µS/cm	0.97 mg/L	7.38 NTU	201.1 mV	6.71 ft	250.00 ml/min

## Samples

Sample ID:	Description:
------------	--------------

MW-11	ST-900
-------	--------

Created using VuSitu from In-Situ, Inc.

FORM FOR  
GROUNDWATER SAMPLING AND/OR  
GROUNDWATER ELEVATION MEASUREMENT

Site Name CIPCO Ash Disposal Landfill Permit No. 70-SDP-09-91P

Monitoring Well/Piezometer No. MW-15 Upgradient \_\_\_\_\_  
Downgradient X

Name Of person sampling Clint Oberbroeckling

A. MONITORING WELL/PIEZOMETER CONDITIONS

Well/piezometer Properly Capped? Yes Standing Water or Litter? No  
If no, explain \_\_\_\_\_ If yes, explain \_\_\_\_\_

B. GROUNDWATER ELEVATION MEASUREMENT (+/- 0.01 foot, MSL)

Elevation: Top of inner well casing 558.65 ft Ground Elevation 556.33 ft  
Depth of Well 29.20 ft Inside Casing Diameter (inches) 2.0 in  
Equipment Used Solinst Model 101 Water Level Probe

Groundwater Level (+/- 0.01 foot below top of inner casing, MSL):

	Date/Time	Depth to Groundwater	Groundwater Elevation
Before Purging	<u>10/22/2024 14:10</u>	<u>12.40 ft</u>	<u>546.25 ft</u>
* After Purging	<u>10/22/2024 15:10</u>	<u>12.62 ft</u>	<u>546.03 ft</u>
* Before Sampling	<u>10/22/2024 15:10</u>	<u>12.62 ft</u>	<u>546.03 ft</u>

\*C. WELL PURGING

Quantity of Water Removed from Well (gallons) 1.89 gallons  
No. of Well Volumes (based on current water level) 0.69 well volumes  
Was well pumped/bailed dry? No

Equipment used:

Bailer type \_\_\_\_\_ Dedicated Bailer \_\_\_\_\_  
Pump type Pneumatic Bladder Dedicated Pump No  
If not dedicated, method of cleaning Replace bladder, rinse w/water, dedicated tubing

\*D. FIELD MEASUREMENT

Weather Conditions Sunny  
Field Measurements (after stabilization)  
Temperature 20.72 Units \_\_\_\_\_ °C  
Equipment Used Aquatroll 500  
pH 6.65  
Equipment Used Aquatroll 500  
Specific Cond. 2,647 Units \_\_\_\_\_ μS/cm  
Equipment Used Aquatroll 500

Comments: ORP: 101.2 DO: 1.96 Turb.: 0.00 Sample Time: 10/22/2024 15:10

Note: Attach Laboratory Report and 8-1/2" x 11" site plan showing locations of all surface and groundwater monitoring points. One map per sampling round.

\*Omit if only measuring groundwater elevations.

# Low-Flow Test Report:

Test Date / Time: 10/22/2024 2:07:29 PM

Project: CIPCO-MW-15 (2)

Operator Name: Clint Oberbroeckling

<b>Location Name: MW-15</b> <b>Well Diameter: 2 in</b> <b>Casing Type: PVC</b> <b>Screen Length: 10 ft</b> <b>Top of Screen: 10.4 ft</b> <b>Total Depth: 29.15 ft</b> <b>Initial Depth to Water: 12.4 ft</b>	<b>Pump Type: QED Sample PRO</b> <b>Tubing Type: Nylon- Double Bonded</b> <b>Tubing Inner Diameter: 0.25 in</b> <b>Tubing Length: 29.15 ft</b> <b>Pump Intake From TOC: 19.15 ft</b> <b>Estimated Total Volume Pumped: 7143.333 ml</b> <b>Flow Cell Volume: 130 ml</b> <b>Final Flow Rate: 100 ml/min</b> <b>Final Draw Down: 0.22 ft</b>	<b>Instrument Used: Aqua TROLL 500</b> <b>Serial Number: 745294</b>
--	---	--

## Test Notes:

## Weather Conditions:

75° sunny

## Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 0.3	+/- 10	+/- 10	+/- 1	
10/22/2024 2:07 PM	00:00	6.71 pH	18.01 °C	2,635.0 µS/cm	2.38 mg/L	0.54 NTU	-73.7 mV	12.40 ft	200.00 ml/min
10/22/2024 2:10 PM	03:08	6.70 pH	18.44 °C	2,650.6 µS/cm	1.63 mg/L	0.54 NTU	-50.7 mV	12.50 ft	200.00 ml/min
10/22/2024 2:17 PM	09:37	6.69 pH	18.65 °C	2,656.0 µS/cm	1.37 mg/L	0.00 NTU	-25.0 mV	12.72 ft	200.00 ml/min
10/22/2024 2:20 PM	12:31	6.69 pH	19.74 °C	2,655.8 µS/cm	1.44 mg/L	0.00 NTU	-14.8 mV	12.65 ft	150.00 ml/min
10/22/2024 2:22 PM	15:25	6.67 pH	20.84 °C	2,655.5 µS/cm	1.48 mg/L	0.21 NTU	-7.7 mV	12.65 ft	150.00 ml/min
10/22/2024 2:25 PM	18:19	6.67 pH	21.23 °C	2,655.7 µS/cm	1.54 mg/L	0.00 NTU	0.0 mV	12.62 ft	100.00 ml/min
10/22/2024 2:28 PM	21:13	6.67 pH	21.12 °C	2,656.4 µS/cm	1.62 mg/L	0.00 NTU	10.2 mV	12.62 ft	100.00 ml/min
10/22/2024 2:31 PM	24:07	6.67 pH	21.13 °C	2,657.9 µS/cm	1.68 mg/L	0.00 NTU	22.1 mV	12.62 ft	100.00 ml/min
10/22/2024 2:34 PM	27:01	6.67 pH	21.47 °C	2,659.4 µS/cm	1.70 mg/L	0.00 NTU	33.6 mV	12.62 ft	100.00 ml/min
10/22/2024 2:37 PM	29:55	6.66 pH	22.10 °C	2,658.3 µS/cm	1.72 mg/L	0.45 NTU	42.4 mV	12.62 ft	100.00 ml/min
10/22/2024 2:40 PM	32:49	6.66 pH	22.52 °C	2,655.9 µS/cm	1.72 mg/L	0.00 NTU	53.0 mV	12.62 ft	100.00 ml/min
10/22/2024 2:43 PM	35:43	6.66 pH	22.99 °C	2,658.1 µS/cm	1.73 mg/L	0.03 NTU	62.3 mV	12.62 ft	100.00 ml/min

10/22/2024 2:46 PM	38:37	6.66 pH	22.39 °C	2,654.3 µS/cm	1.76 mg/L	0.08 NTU	65.2 mV	12.62 ft	100.00 ml/min
10/22/2024 2:49 PM	41:31	6.64 pH	21.59 °C	2,653.9 µS/cm	1.80 mg/L	0.14 NTU	73.1 mV	12.62 ft	100.00 ml/min
10/22/2024 2:51 PM	44:25	6.64 pH	21.24 °C	2,657.1 µS/cm	1.85 mg/L	0.02 NTU	80.1 mV	12.62 ft	100.00 ml/min
10/22/2024 2:54 PM	47:19	6.65 pH	21.16 °C	2,660.0 µS/cm	1.88 mg/L	0.02 NTU	85.7 mV	12.62 ft	100.00 ml/min
10/22/2024 2:57 PM	50:13	6.65 pH	21.14 °C	2,652.7 µS/cm	1.91 mg/L	0.03 NTU	91.7 mV	12.62 ft	100.00 ml/min
10/22/2024 3:00 PM	53:07	6.65 pH	20.91 °C	2,646.7 µS/cm	1.93 mg/L	0.16 NTU	97.0 mV	12.62 ft	100.00 ml/min
10/22/2024 3:03 PM	56:01	6.65 pH	20.72 °C	2,647.0 µS/cm	1.96 mg/L	0.00 NTU	101.2 mV	12.62 ft	100.00 ml/min

## Samples

Sample ID:	Description:
MW-15	ST-1510

FORM FOR  
GROUNDWATER SAMPLING AND/OR  
GROUNDWATER ELEVATION MEASUREMENT

Site Name CIPCO Ash Disposal Landfill Permit No. 70-SDP-09-91P

Monitoring Well/Piezometer No. MW-17 Upgradient \_\_\_\_\_  
Downgradient X

Name Of person sampling Clint Oberbroeckling

A. MONITORING WELL/PIEZOMETER CONDITIONS

Well/piezometer Properly Capped? Yes Standing Water or Litter? No  
If no, explain \_\_\_\_\_ If yes, explain \_\_\_\_\_

B. GROUNDWATER ELEVATION MEASUREMENT (+/- 0.01 foot, MSL)

Elevation: Top of inner well casing 557.32 ft Ground Elevation 554.53 ft  
Depth of Well 20.35 ft Inside Casing Diameter (inches) 2.0 in  
Equipment Used Solinst Model 101 Water Level Probe

Groundwater Level (+/- 0.01 foot below top of inner casing, MSL):

	Date/Time	Depth to Groundwater	Groundwater Elevation
Before Purging	<u>10/22/2024 13:15</u>	<u>12.24 ft</u>	<u>545.08 ft</u>
* After Purging	<u>10/22/2024 13:50</u>	<u>12.43 ft</u>	<u>544.89 ft</u>
* Before Sampling	<u>10/22/2024 13:50</u>	<u>12.43 ft</u>	<u>544.89 ft</u>

\*C. WELL PURGING

Quantity of Water Removed from Well (gallons) 1.38 gallons  
No. of Well Volumes (based on current water level) 1.04 well volumes  
Was well pumped/bailed dry? No

Equipment used:

Bailer type \_\_\_\_\_ Dedicated Bailer \_\_\_\_\_  
Pump type Pneumatic Bladder Dedicated Pump No  
If not dedicated, method of cleaning Replace bladder, rinse w/water, dedicated tubing

\*D. FIELD MEASUREMENT

Weather Conditions Sunny  
Field Measurements (after stabilization)  
Temperature 15.44 Units \_\_\_\_\_ °C  
Equipment Used Aquatroll 500  
pH 6.69  
Equipment Used Aquatroll 500  
Specific Cond. 2,567 Units \_\_\_\_\_ μS/cm  
Equipment Used Aquatroll 500

Comments: ORP: -112.7 DO: 0.25 Turb.: 0.00 Sample Time: 10/22/2024 13:50

Note: Attach Laboratory Report and 8-1/2" x 11" site plan showing locations of all surface and groundwater monitoring points. One map per sampling round.

\*Omit if only measuring groundwater elevations.



# Low-Flow Test Report:

Test Date / Time: 10/22/2024 1:17:18 PM

Project: CIPCO-MW-17 (2)

Operator Name: Clint Oberbroeckling

<b>Location Name: MW-17</b> <b>Well Diameter: 2 in</b> <b>Casing Type: PVC</b> <b>Screen Length: 10 ft</b> <b>Top of Screen: 10.35 ft</b> <b>Total Depth: 20.35 ft</b> <b>Initial Depth to Water: 12.24 ft</b>	<b>Pump Type: QED Sample PRO</b> <b>Tubing Type: Nylon- Double Bonded</b> <b>Tubing Inner Diameter: 0.25 in</b> <b>Tubing Length: 20.35 ft</b> <b>Pump Intake From TOC: 15.35 ft</b> <b>Estimated Total Volume Pumped: 5233.333 ml</b> <b>Flow Cell Volume: 130 ml</b> <b>Final Flow Rate: 200 ml/min</b> <b>Final Draw Down: 0.19 ft</b>	<b>Instrument Used: Aqua TROLL 500</b> <b>Serial Number: 745294</b>
--	---	--

## Test Notes:

## Weather Conditions:

72° sunny

## Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 0.3	+/- 10	+/- 10	+/- 0.33	
10/22/2024 1:17 PM	00:00	6.68 pH	17.48 °C	2,741.2 µS/cm	1.75 mg/L	27.36 NTU	-67.6 mV	12.24 ft	200.00 ml/min
10/22/2024 1:19 PM	02:37	6.70 pH	16.44 °C	2,924.1 µS/cm	0.94 mg/L	17.84 NTU	-66.1 mV	12.43 ft	200.00 ml/min
10/22/2024 1:22 PM	05:14	6.71 pH	16.24 °C	2,954.8 µS/cm	0.59 mg/L	11.43 NTU	-72.0 mV	12.43 ft	200.00 ml/min
10/22/2024 1:25 PM	07:51	6.70 pH	15.85 °C	2,943.0 µS/cm	0.41 mg/L	11.24 NTU	-77.9 mV	12.43 ft	200.00 ml/min
10/22/2024 1:27 PM	10:28	6.70 pH	15.66 °C	2,884.4 µS/cm	0.29 mg/L	7.94 NTU	-87.0 mV	12.43 ft	200.00 ml/min
10/22/2024 1:30 PM	13:05	6.69 pH	15.48 °C	2,816.6 µS/cm	0.25 mg/L	5.00 NTU	-94.2 mV	12.43 ft	200.00 ml/min
10/22/2024 1:33 PM	15:42	6.69 pH	15.47 °C	2,735.3 µS/cm	0.21 mg/L	3.38 NTU	-101.2 mV	12.43 ft	200.00 ml/min
10/22/2024 1:35 PM	18:19	6.68 pH	15.40 °C	2,679.1 µS/cm	0.18 mg/L	0.45 NTU	-105.7 mV	12.43 ft	200.00 ml/min
10/22/2024 1:38 PM	20:56	6.68 pH	15.38 °C	2,620.6 µS/cm	0.18 mg/L	0.50 NTU	-109.4 mV	12.43 ft	200.00 ml/min
10/22/2024 1:40 PM	23:33	6.69 pH	15.45 °C	2,595.8 µS/cm	0.26 mg/L	0.03 NTU	-110.9 mV	12.43 ft	200.00 ml/min
10/22/2024 1:43 PM	26:10	6.69 pH	15.44 °C	2,567.3 µS/cm	0.25 mg/L	0.00 NTU	-112.7 mV	12.43 ft	200.00 ml/min

**Samples**

Sample ID:	Description:
MW-17	ST-1315

FORM FOR  
GROUNDWATER SAMPLING AND/OR  
GROUNDWATER ELEVATION MEASUREMENT

Site Name CIPCO Ash Disposal Landfill Permit No. 70-SDP-09-91P

Monitoring Well/Piezometer No. MW-20 Upgradient \_\_\_\_\_  
Downgradient X

Name Of person sampling Clint Oberbroeckling

A. MONITORING WELL/PIEZOMETER CONDITIONS

Well/piezometer Properly Capped? Yes Standing Water or Litter? No  
If no, explain \_\_\_\_\_ If yes, explain \_\_\_\_\_

B. GROUNDWATER ELEVATION MEASUREMENT (+/- 0.01 foot, MSL)

Elevation: Top of inner well casing 558.92 ft Ground Elevation 555.95 ft  
Depth of Well 44.39 ft Inside Casing Diameter (inches) 2.0 in  
Equipment Used Solinst Model 101 Water Level Probe

Groundwater Level (+/- 0.01 foot below top of inner casing, MSL):

	Date/Time	Depth to Groundwater	Groundwater Elevation
Before Purging	<u>10/22/2024 10:58</u>	<u>5.50 ft</u>	<u>553.42 ft</u>
* After Purging	<u>10/22/2024 11:40</u>	<u>6.40 ft</u>	<u>552.52 ft</u>
* Before Sampling	<u>10/22/2024 11:40</u>	<u>6.40 ft</u>	<u>552.52 ft</u>

\*C. WELL PURGING

Quantity of Water Removed from Well (gallons) 0.24 gallons  
No. of Well Volumes (based on current water level) 0.04 well volumes  
Was well pumped/bailed dry? No

Equipment used:

Bailer type \_\_\_\_\_ Dedicated Bailer \_\_\_\_\_  
Pump type Pneumatic Bladder Dedicated Pump No  
If not dedicated, method of cleaning Replace bladder, rinse w/water, dedicated tubing

\*D. FIELD MEASUREMENT

Weather Conditions Sunny  
Field Measurements (after stabilization)  
Temperature 15.88 Units \_\_\_\_\_ °C  
Equipment Used Aquatroll 500  
pH 7.10  
Equipment Used Aquatroll 500  
Specific Cond. 701 Units \_\_\_\_\_ μS/cm  
Equipment Used Aquatroll 500

Comments: ORP: 50.3 DO: 0.72 Turb.: 5.88 Sample Time: 10/22/2024 11:40

Note: Attach Laboratory Report and 8-1/2" x 11" site plan showing locations of all surface and groundwater monitoring points. One map per sampling round.

\*Omit if only measuring groundwater elevations.

# Low-Flow Test Report:

Test Date / Time: 10/22/2024 11:17:39 AM

Project: CIPCO-MW-20 (2)

Operator Name: Clint Oberbroeckling

<b>Location Name: MW-20</b> <b>Well Diameter: 2 in</b> <b>Casing Type: PVC</b> <b>Screen Length: 10 ft</b> <b>Top of Screen: 34.4 ft</b> <b>Total Depth: 44.4 ft</b> <b>Initial Depth to Water: 5.5 ft</b>	<b>Pump Type: QED Sample PRO</b> <b>Tubing Type: Nylon- Double Bonded</b> <b>Tubing Inner Diameter: 0.25 in</b> <b>Tubing Length: 44.4 ft</b> <b>Pump Intake From TOC: 39.4 ft</b> <b>Estimated Total Volume Pumped: 907.5 ml</b> <b>Flow Cell Volume: 130 ml</b> <b>Final Flow Rate: 50 ml/min</b> <b>Final Draw Down: 0.9 ft</b>	<b>Instrument Used: Aqua TROLL 500</b> <b>Serial Number: 745294</b>
--	--	--

## Test Notes:

## Weather Conditions:

60° sunny

## Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 0.3	+/- 10	+/- 10	+/- 1	
10/22/2024 11:17 AM	00:00	7.25 pH	16.03 °C	700.06 µS/cm	4.77 mg/L	1.88 NTU	-27.5 mV	5.50 ft	50.00 ml/min
10/22/2024 11:21 AM	03:23	7.12 pH	15.49 °C	697.95 µS/cm	2.45 mg/L	6.63 NTU	-0.5 mV	5.50 ft	50.00 ml/min
10/22/2024 11:24 AM	06:46	7.10 pH	15.45 °C	696.12 µS/cm	1.56 mg/L	7.42 NTU	22.8 mV	6.10 ft	50.00 ml/min
10/22/2024 11:27 AM	10:09	7.10 pH	15.36 °C	701.01 µS/cm	1.18 mg/L	6.59 NTU	32.8 mV	6.10 ft	50.00 ml/min
10/22/2024 11:31 AM	13:32	7.09 pH	15.49 °C	700.70 µS/cm	0.94 mg/L	8.49 NTU	44.6 mV	6.10 ft	50.00 ml/min
10/22/2024 11:32 AM	14:46	7.09 pH	15.49 °C	700.88 µS/cm	0.89 mg/L	11.08 NTU	45.0 mV	6.40 ft	50.00 ml/min
10/22/2024 11:35 AM	18:09	7.10 pH	15.88 °C	701.47 µS/cm	0.72 mg/L	5.88 NTU	50.3 mV	6.40 ft	50.00 ml/min

## Samples

Sample ID:	Description:
MW-20	ST-1140

# **Appendix B**

**Laboratory Analytical Reports**

 **ANALYTICAL REPORT****PREPARED FOR**

Attn: Clint Oberbroeckling  
GHD Services Inc.  
11228 Aurora Avenue  
Des Moines, Iowa 50322-7905

Generated 11/13/2024 9:13:43 AM

**JOB DESCRIPTION**

CIPCO Ash Landfill Project

**JOB NUMBER**

310-293513-1

# Eurofins Cedar Falls

## Job Notes

This report may not be reproduced except in full, and with written approval from the laboratory. The results relate only to the samples tested. For questions please contact the Project Manager at the e-mail address or telephone number listed on this page.

The test results in this report relate only to the samples as received by the laboratory and will meet all requirements of the methodology, with any exceptions noted. This report shall not be reproduced except in full, without the express written approval of the laboratory. All questions should be directed to the Eurofins Environment Testing North Central, LLC Project Manager.

## Authorization



Generated  
11/13/2024 9:13:43 AM

Authorized for release by  
Zach Bindert, Senior Project Manager  
[Zach.Bindert@et.eurofinsus.com](mailto:Zach.Bindert@et.eurofinsus.com)  
(319)595-2016



# Table of Contents

Cover Page . . . . .	1
Table of Contents . . . . .	3
Case Narrative . . . . .	4
Sample Summary . . . . .	5
Detection Summary . . . . .	6
Client Sample Results . . . . .	9
Definitions . . . . .	19
QC Sample Results . . . . .	20
QC Association . . . . .	23
Chronicle . . . . .	25
Certification Summary . . . . .	28
Method Summary . . . . .	29
Chain of Custody . . . . .	30
Receipt Checklists . . . . .	32



# Case Narrative

Client: GHD Services Inc.  
Project: CIPCO Ash Landfill Project

Job ID: 310-293513-1

**Job ID: 310-293513-1**

**Eurofins Cedar Falls**

## Job Narrative 310-293513-1

Analytical test results meet all requirements of the associated regulatory program listed on the Accreditation/Certification Summary Page unless otherwise noted under the individual analysis. Data qualifiers and/or narrative comments are included to explain any exceptions, if applicable.

- Matrix QC may not be reported if insufficient sample is provided or site-specific QC samples were not submitted. In these situations, to demonstrate precision and accuracy at a batch level, a LCS/LCSD may be performed, unless otherwise specified in the method.
- Surrogate and/or isotope dilution analyte recoveries (if applicable) which are outside of the QC window are confirmed unless attributed to a dilution or otherwise noted in the narrative.

Regulated compliance samples (e.g. SDWA, NPDES) must comply with the associated agency requirements/permits.

### Receipt

The samples were received on 10/23/2024 4:25 PM. Unless otherwise noted below, the samples arrived in good condition, and, where required, properly preserved and on ice. The temperature of the cooler at receipt time was 2.4°C.

### Metals

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

### General Chemistry

No additional analytical or quality issues were noted, other than those described above or in the Definitions/ Glossary page.

Eurofins Cedar Falls

# Sample Summary

Client: GHD Services Inc.  
Project/Site: CIPCO Ash Landfill Project

Job ID: 310-293513-1

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
310-293513-1	MW-1	Water	10/22/24 10:35	10/23/24 16:25
310-293513-2	MW-2	Water	10/22/24 15:55	10/23/24 16:25
310-293513-3	MW-3	Water	10/22/24 17:30	10/23/24 16:25
310-293513-4	MW-5	Water	10/22/24 12:20	10/23/24 16:25
310-293513-5	MW-6	Water	10/22/24 13:00	10/23/24 16:25
310-293513-6	MW-9	Water	10/22/24 18:00	10/23/24 16:25
310-293513-7	MW-11	Water	10/22/24 09:00	10/23/24 16:25
310-293513-8	MW-15	Water	10/22/24 15:10	10/23/24 16:25
310-293513-9	MW-17	Water	10/22/24 13:50	10/23/24 16:25
310-293513-10	MW-20	Water	10/22/24 11:40	10/23/24 16:25

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

# Detection Summary

Client: GHD Services Inc.  
Project/Site: CIPCO Ash Landfill Project

Job ID: 310-293513-1

## Client Sample ID: MW-1

## Lab Sample ID: 310-293513-1

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Boron	0.291		0.100		mg/L	1		6020B	Total/NA
Cobalt	0.00121		0.000500		mg/L	1		6020B	Total/NA
Iron	1.92		0.100		mg/L	1		6020B	Total/NA
Lithium	0.0643		0.0100		mg/L	1		6020B	Total/NA
Magnesium	72.5		0.500		mg/L	1		6020B	Total/NA
Manganese	0.299		0.0100		mg/L	1		6020B	Total/NA
Sodium	11.4		1.00		mg/L	1		6020B	Total/NA
Strontium	0.790		0.00100		mg/L	1		6020B	Total/NA
Sulfate	244		125		mg/L	25		D516-16	Total/NA
Chloride	7.30		2.00		mg/L	1		SM 4500 Cl- E	Total/NA

## Client Sample ID: MW-2

## Lab Sample ID: 310-293513-2

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Boron	6.11		0.400		mg/L	4		6020B	Total/NA
Lithium	0.0333		0.0100		mg/L	1		6020B	Total/NA
Magnesium	27.5		0.500		mg/L	1		6020B	Total/NA
Manganese	0.0923		0.0100		mg/L	1		6020B	Total/NA
Sodium	15.4		1.00		mg/L	1		6020B	Total/NA
Strontium	0.313		0.00100		mg/L	1		6020B	Total/NA
Sulfate	177		25.0		mg/L	5		D516-16	Total/NA
Chloride	9.96		2.00		mg/L	1		SM 4500 Cl- E	Total/NA

## Client Sample ID: MW-3

## Lab Sample ID: 310-293513-3

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Boron	1.52		0.100		mg/L	1		6020B	Total/NA
Cobalt	0.00483		0.000500		mg/L	1		6020B	Total/NA
Iron	0.673		0.100		mg/L	1		6020B	Total/NA
Lithium	0.0348		0.0100		mg/L	1		6020B	Total/NA
Magnesium	18.5		0.500		mg/L	1		6020B	Total/NA
Manganese	1.71		0.0100		mg/L	1		6020B	Total/NA
Sodium	21.2		1.00		mg/L	1		6020B	Total/NA
Strontium	0.880		0.00100		mg/L	1		6020B	Total/NA
Sulfate	37.1		5.00		mg/L	1		D516-16	Total/NA
Chloride	2.36		2.00		mg/L	1		SM 4500 Cl- E	Total/NA

## Client Sample ID: MW-5

## Lab Sample ID: 310-293513-4

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Boron	6.56		0.400		mg/L	4		6020B	Total/NA
Cobalt	0.00192		0.000500		mg/L	1		6020B	Total/NA
Iron	0.738		0.100		mg/L	1		6020B	Total/NA
Lithium	0.0195		0.0100		mg/L	1		6020B	Total/NA
Magnesium	34.1		0.500		mg/L	1		6020B	Total/NA
Manganese	0.247		0.0100		mg/L	1		6020B	Total/NA
Sodium	18.3		1.00		mg/L	1		6020B	Total/NA
Strontium	0.368		0.00100		mg/L	1		6020B	Total/NA
Sulfate	81.5		25.0		mg/L	5		D516-16	Total/NA
Chloride	18.8		2.00		mg/L	1		SM 4500 Cl- E	Total/NA

This Detection Summary does not include radiochemical test results.

Eurofins Cedar Falls

# Detection Summary

Client: GHD Services Inc.  
Project/Site: CIPCO Ash Landfill Project

Job ID: 310-293513-1

## Client Sample ID: MW-6

## Lab Sample ID: 310-293513-5

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Arsenic	0.00207		0.00200		mg/L	1		6020B	Total/NA
Boron	7.67		0.400		mg/L	4		6020B	Total/NA
Cobalt	0.00344		0.000500		mg/L	1		6020B	Total/NA
Iron	0.977		0.100		mg/L	1		6020B	Total/NA
Magnesium	30.8		0.500		mg/L	1		6020B	Total/NA
Manganese	5.16		0.0100		mg/L	1		6020B	Total/NA
Molybdenum	0.0448		0.00200		mg/L	1		6020B	Total/NA
Sodium	16.9		1.00		mg/L	1		6020B	Total/NA
Strontium	0.249		0.00100		mg/L	1		6020B	Total/NA
Sulfate	89.9		25.0		mg/L	5		D516-16	Total/NA
Chloride	18.6		2.00		mg/L	1		SM 4500 Cl- E	Total/NA

## Client Sample ID: MW-9

## Lab Sample ID: 310-293513-6

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Boron	0.336		0.100		mg/L	1		6020B	Total/NA
Cobalt	0.00108		0.000500		mg/L	1		6020B	Total/NA
Lithium	0.0445		0.0100		mg/L	1		6020B	Total/NA
Magnesium	30.5		0.500		mg/L	1		6020B	Total/NA
Sodium	12.5		1.00		mg/L	1		6020B	Total/NA
Strontium	0.706		0.00100		mg/L	1		6020B	Total/NA
Sulfate	31.1		5.00		mg/L	1		D516-16	Total/NA
Chloride	3.45		2.00		mg/L	1		SM 4500 Cl- E	Total/NA

## Client Sample ID: MW-11

## Lab Sample ID: 310-293513-7

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Iron	0.260		0.100		mg/L	1		6020B	Total/NA
Magnesium	45.7		0.500		mg/L	1		6020B	Total/NA
Manganese	0.244		0.0100		mg/L	1		6020B	Total/NA
Sodium	12.8		1.00		mg/L	1		6020B	Total/NA
Strontium	0.132		0.00100		mg/L	1		6020B	Total/NA
Sulfate	89.0		25.0		mg/L	5		D516-16	Total/NA
Chloride	12.4		2.00		mg/L	1		SM 4500 Cl- E	Total/NA

## Client Sample ID: MW-15

## Lab Sample ID: 310-293513-8

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Boron	39.3		1.00		mg/L	10		6020B	Total/NA
Iron	0.123		0.100		mg/L	1		6020B	Total/NA
Lithium	0.154		0.0100		mg/L	1		6020B	Total/NA
Magnesium	126		5.00		mg/L	10		6020B	Total/NA
Manganese	0.0741		0.0100		mg/L	1		6020B	Total/NA
Molybdenum	0.259		0.00200		mg/L	1		6020B	Total/NA
Sodium	87.2		1.00		mg/L	1		6020B	Total/NA
Strontium	0.717		0.00100		mg/L	1		6020B	Total/NA
Sulfate	1260		625		mg/L	125		D516-16	Total/NA
Chloride	20.4		2.00		mg/L	1		SM 4500 Cl- E	Total/NA

## Client Sample ID: MW-17

## Lab Sample ID: 310-293513-9

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Boron	33.2		1.00		mg/L	10		6020B	Total/NA

This Detection Summary does not include radiochemical test results.

Eurofins Cedar Falls

# Detection Summary

Client: GHD Services Inc.  
 Project/Site: CIPCO Ash Landfill Project

Job ID: 310-293513-1

## Client Sample ID: MW-17 (Continued)

Lab Sample ID: 310-293513-9

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Iron	1.43		0.100		mg/L	1		6020B	Total/NA
Lithium	0.293		0.0100		mg/L	1		6020B	Total/NA
Magnesium	214		5.00		mg/L	10		6020B	Total/NA
Manganese	0.257		0.0100		mg/L	1		6020B	Total/NA
Molybdenum	0.0770		0.00200		mg/L	1		6020B	Total/NA
Sodium	82.4		1.00		mg/L	1		6020B	Total/NA
Strontium	0.580		0.00100		mg/L	1		6020B	Total/NA
Sulfate	1190		625		mg/L	125		D516-16	Total/NA
Chloride	19.0		2.00		mg/L	1		SM 4500 Cl- E	Total/NA

## Client Sample ID: MW-20

Lab Sample ID: 310-293513-10

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Boron	1.47		0.100		mg/L	1		6020B	Total/NA
Iron	0.162		0.100		mg/L	1		6020B	Total/NA
Lithium	0.0219		0.0100		mg/L	1		6020B	Total/NA
Magnesium	15.3		0.500		mg/L	1		6020B	Total/NA
Manganese	0.0267		0.0100		mg/L	1		6020B	Total/NA
Sodium	84.0		1.00		mg/L	1		6020B	Total/NA
Strontium	0.616		0.00100		mg/L	1		6020B	Total/NA
Sulfate	36.5		5.00		mg/L	1		D516-16	Total/NA
Chloride	3.71		2.00		mg/L	1		SM 4500 Cl- E	Total/NA

This Detection Summary does not include radiochemical test results.

Eurofins Cedar Falls

# Client Sample Results

Client: GHD Services Inc.  
 Project/Site: CIPCO Ash Landfill Project

Job ID: 310-293513-1

**Client Sample ID: MW-1**

**Lab Sample ID: 310-293513-1**

Date Collected: 10/22/24 10:35

Matrix: Water

Date Received: 10/23/24 16:25

**Method: SW846 6020B - Metals (ICP/MS)**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Arsenic	<0.00200		0.00200		mg/L		10/29/24 09:30	11/04/24 23:35	1
<b>Boron</b>	<b>0.291</b>		0.100		mg/L		10/29/24 09:30	11/04/24 23:35	1
<b>Cobalt</b>	<b>0.00121</b>		0.000500		mg/L		10/29/24 09:30	11/04/24 23:35	1
<b>Iron</b>	<b>1.92</b>		0.100		mg/L		10/29/24 09:30	11/04/24 23:35	1
<b>Lithium</b>	<b>0.0643</b>		0.0100		mg/L		10/29/24 09:30	11/04/24 23:35	1
<b>Magnesium</b>	<b>72.5</b>		0.500		mg/L		10/29/24 09:30	11/04/24 23:35	1
<b>Manganese</b>	<b>0.299</b>		0.0100		mg/L		10/29/24 09:30	11/04/24 23:35	1
Molybdenum	<0.00200		0.00200		mg/L		10/29/24 09:30	11/04/24 23:35	1
<b>Sodium</b>	<b>11.4</b>		1.00		mg/L		10/29/24 09:30	11/04/24 23:35	1
<b>Strontium</b>	<b>0.790</b>		0.00100		mg/L		10/29/24 09:30	11/04/24 23:35	1

**General Chemistry**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
<b>Sulfate (ASTM D516-16)</b>	<b>244</b>		125		mg/L			11/01/24 15:17	25
<b>Chloride (SM 4500 Cl- E)</b>	<b>7.30</b>		2.00		mg/L			10/30/24 14:40	1



# Client Sample Results

Client: GHD Services Inc.  
 Project/Site: CIPCO Ash Landfill Project

Job ID: 310-293513-1

**Client Sample ID: MW-2**

**Lab Sample ID: 310-293513-2**

Date Collected: 10/22/24 15:55

Matrix: Water

Date Received: 10/23/24 16:25

**Method: SW846 6020B - Metals (ICP/MS)**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Arsenic	<0.00200		0.00200		mg/L		10/29/24 09:30	11/04/24 23:38	1
<b>Boron</b>	<b>6.11</b>		0.400		mg/L		10/29/24 09:30	11/05/24 14:47	4
Cobalt	<0.000500		0.000500		mg/L		10/29/24 09:30	11/04/24 23:38	1
Iron	<0.100		0.100		mg/L		10/29/24 09:30	11/04/24 23:38	1
<b>Lithium</b>	<b>0.0333</b>		0.0100		mg/L		10/29/24 09:30	11/04/24 23:38	1
<b>Magnesium</b>	<b>27.5</b>		0.500		mg/L		10/29/24 09:30	11/04/24 23:38	1
<b>Manganese</b>	<b>0.0923</b>		0.0100		mg/L		10/29/24 09:30	11/04/24 23:38	1
Molybdenum	<0.00200		0.00200		mg/L		10/29/24 09:30	11/04/24 23:38	1
<b>Sodium</b>	<b>15.4</b>		1.00		mg/L		10/29/24 09:30	11/04/24 23:38	1
<b>Strontium</b>	<b>0.313</b>		0.00100		mg/L		10/29/24 09:30	11/04/24 23:38	1

**General Chemistry**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
<b>Sulfate (ASTM D516-16)</b>	<b>177</b>		25.0		mg/L			10/31/24 16:37	5
<b>Chloride (SM 4500 Cl- E)</b>	<b>9.96</b>		2.00		mg/L			10/30/24 14:40	1

# Client Sample Results

Client: GHD Services Inc.  
 Project/Site: CIPCO Ash Landfill Project

Job ID: 310-293513-1

**Client Sample ID: MW-3**

**Lab Sample ID: 310-293513-3**

Date Collected: 10/22/24 17:30

Matrix: Water

Date Received: 10/23/24 16:25

**Method: SW846 6020B - Metals (ICP/MS)**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Arsenic	<0.00200		0.00200		mg/L		10/29/24 09:30	11/04/24 23:40	1
<b>Boron</b>	<b>1.52</b>		0.100		mg/L		10/29/24 09:30	11/04/24 23:40	1
<b>Cobalt</b>	<b>0.00483</b>		0.000500		mg/L		10/29/24 09:30	11/04/24 23:40	1
<b>Iron</b>	<b>0.673</b>		0.100		mg/L		10/29/24 09:30	11/04/24 23:40	1
<b>Lithium</b>	<b>0.0348</b>		0.0100		mg/L		10/29/24 09:30	11/04/24 23:40	1
<b>Magnesium</b>	<b>18.5</b>		0.500		mg/L		10/29/24 09:30	11/04/24 23:40	1
<b>Manganese</b>	<b>1.71</b>		0.0100		mg/L		10/29/24 09:30	11/04/24 23:40	1
Molybdenum	<0.00200		0.00200		mg/L		10/29/24 09:30	11/04/24 23:40	1
<b>Sodium</b>	<b>21.2</b>		1.00		mg/L		10/29/24 09:30	11/04/24 23:40	1
<b>Strontium</b>	<b>0.880</b>		0.00100		mg/L		10/29/24 09:30	11/04/24 23:40	1

**General Chemistry**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
<b>Sulfate (ASTM D516-16)</b>	<b>37.1</b>		5.00		mg/L			10/31/24 16:21	1
<b>Chloride (SM 4500 Cl- E)</b>	<b>2.36</b>		2.00		mg/L			10/30/24 14:41	1

# Client Sample Results

Client: GHD Services Inc.  
Project/Site: CIPCO Ash Landfill Project

Job ID: 310-293513-1

**Client Sample ID: MW-5**

**Lab Sample ID: 310-293513-4**

Date Collected: 10/22/24 12:20

Matrix: Water

Date Received: 10/23/24 16:25

**Method: SW846 6020B - Metals (ICP/MS)**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Arsenic	<0.00200		0.00200		mg/L		10/29/24 09:30	11/04/24 23:43	1
<b>Boron</b>	<b>6.56</b>		0.400		mg/L		10/29/24 09:30	11/05/24 14:50	4
<b>Cobalt</b>	<b>0.00192</b>		0.000500		mg/L		10/29/24 09:30	11/04/24 23:43	1
<b>Iron</b>	<b>0.738</b>		0.100		mg/L		10/29/24 09:30	11/04/24 23:43	1
<b>Lithium</b>	<b>0.0195</b>		0.0100		mg/L		10/29/24 09:30	11/04/24 23:43	1
<b>Magnesium</b>	<b>34.1</b>		0.500		mg/L		10/29/24 09:30	11/04/24 23:43	1
<b>Manganese</b>	<b>0.247</b>		0.0100		mg/L		10/29/24 09:30	11/04/24 23:43	1
Molybdenum	<0.00200		0.00200		mg/L		10/29/24 09:30	11/04/24 23:43	1
<b>Sodium</b>	<b>18.3</b>		1.00		mg/L		10/29/24 09:30	11/04/24 23:43	1
<b>Strontium</b>	<b>0.368</b>		0.00100		mg/L		10/29/24 09:30	11/04/24 23:43	1

**General Chemistry**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
<b>Sulfate (ASTM D516-16)</b>	<b>81.5</b>		25.0		mg/L			10/31/24 16:38	5
<b>Chloride (SM 4500 Cl- E)</b>	<b>18.8</b>		2.00		mg/L			10/30/24 14:41	1

# Client Sample Results

Client: GHD Services Inc.  
 Project/Site: CIPCO Ash Landfill Project

Job ID: 310-293513-1

**Client Sample ID: MW-6**

**Lab Sample ID: 310-293513-5**

Date Collected: 10/22/24 13:00

Matrix: Water

Date Received: 10/23/24 16:25

**Method: SW846 6020B - Metals (ICP/MS)**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Arsenic	0.00207		0.00200		mg/L		10/29/24 09:30	11/04/24 23:46	1
Boron	7.67		0.400		mg/L		10/29/24 09:30	11/05/24 14:53	4
Cobalt	0.00344		0.000500		mg/L		10/29/24 09:30	11/04/24 23:46	1
Iron	0.977		0.100		mg/L		10/29/24 09:30	11/04/24 23:46	1
Lithium	<0.0100		0.0100		mg/L		10/29/24 09:30	11/04/24 23:46	1
Magnesium	30.8		0.500		mg/L		10/29/24 09:30	11/04/24 23:46	1
Manganese	5.16		0.0100		mg/L		10/29/24 09:30	11/04/24 23:46	1
Molybdenum	0.0448		0.00200		mg/L		10/29/24 09:30	11/04/24 23:46	1
Sodium	16.9		1.00		mg/L		10/29/24 09:30	11/04/24 23:46	1
Strontium	0.249		0.00100		mg/L		10/29/24 09:30	11/04/24 23:46	1

**General Chemistry**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Sulfate (ASTM D516-16)	89.9		25.0		mg/L			11/01/24 15:19	5
Chloride (SM 4500 Cl- E)	18.6		2.00		mg/L			10/30/24 14:41	1

# Client Sample Results

Client: GHD Services Inc.  
 Project/Site: CIPCO Ash Landfill Project

Job ID: 310-293513-1

**Client Sample ID: MW-9**

**Lab Sample ID: 310-293513-6**

Date Collected: 10/22/24 18:00

Matrix: Water

Date Received: 10/23/24 16:25

**Method: SW846 6020B - Metals (ICP/MS)**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Arsenic	<0.00200		0.00200		mg/L		10/29/24 09:30	11/04/24 23:49	1
<b>Boron</b>	<b>0.336</b>		0.100		mg/L		10/29/24 09:30	11/04/24 23:49	1
<b>Cobalt</b>	<b>0.00108</b>		0.000500		mg/L		10/29/24 09:30	11/04/24 23:49	1
Iron	<0.100		0.100		mg/L		10/29/24 09:30	11/04/24 23:49	1
<b>Lithium</b>	<b>0.0445</b>		0.0100		mg/L		10/29/24 09:30	11/04/24 23:49	1
<b>Magnesium</b>	<b>30.5</b>		0.500		mg/L		10/29/24 09:30	11/04/24 23:49	1
Manganese	<0.0100		0.0100		mg/L		10/29/24 09:30	11/04/24 23:49	1
Molybdenum	<0.00200		0.00200		mg/L		10/29/24 09:30	11/04/24 23:49	1
<b>Sodium</b>	<b>12.5</b>		1.00		mg/L		10/29/24 09:30	11/04/24 23:49	1
<b>Strontium</b>	<b>0.706</b>		0.00100		mg/L		10/29/24 09:30	11/04/24 23:49	1

**General Chemistry**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
<b>Sulfate (ASTM D516-16)</b>	<b>31.1</b>		5.00		mg/L			10/31/24 16:24	1
<b>Chloride (SM 4500 Cl- E)</b>	<b>3.45</b>		2.00		mg/L			10/30/24 14:42	1



# Client Sample Results

Client: GHD Services Inc.  
Project/Site: CIPCO Ash Landfill Project

Job ID: 310-293513-1

**Client Sample ID: MW-11**

**Lab Sample ID: 310-293513-7**

Date Collected: 10/22/24 09:00

Matrix: Water

Date Received: 10/23/24 16:25

**Method: SW846 6020B - Metals (ICP/MS)**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Arsenic	<0.00200		0.00200		mg/L		10/29/24 09:30	11/04/24 23:52	1
Boron	<0.100		0.100		mg/L		10/29/24 09:30	11/04/24 23:52	1
Cobalt	<0.000500		0.000500		mg/L		10/29/24 09:30	11/04/24 23:52	1
<b>Iron</b>	<b>0.260</b>		0.100		mg/L		10/29/24 09:30	11/04/24 23:52	1
Lithium	<0.0100		0.0100		mg/L		10/29/24 09:30	11/04/24 23:52	1
<b>Magnesium</b>	<b>45.7</b>		0.500		mg/L		10/29/24 09:30	11/04/24 23:52	1
<b>Manganese</b>	<b>0.244</b>		0.0100		mg/L		10/29/24 09:30	11/04/24 23:52	1
Molybdenum	<0.00200		0.00200		mg/L		10/29/24 09:30	11/04/24 23:52	1
<b>Sodium</b>	<b>12.8</b>		1.00		mg/L		10/29/24 09:30	11/04/24 23:52	1
<b>Strontium</b>	<b>0.132</b>		0.00100		mg/L		10/29/24 09:30	11/04/24 23:52	1

**General Chemistry**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
<b>Sulfate (ASTM D516-16)</b>	<b>89.0</b>		25.0		mg/L			10/31/24 16:39	5
<b>Chloride (SM 4500 Cl- E)</b>	<b>12.4</b>		2.00		mg/L			10/30/24 14:42	1

# Client Sample Results

Client: GHD Services Inc.  
 Project/Site: CIPCO Ash Landfill Project

Job ID: 310-293513-1

**Client Sample ID: MW-15**

**Lab Sample ID: 310-293513-8**

Date Collected: 10/22/24 15:10

Matrix: Water

Date Received: 10/23/24 16:25

**Method: SW846 6020B - Metals (ICP/MS)**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Arsenic	<0.00200		0.00200		mg/L		10/29/24 09:30	11/05/24 00:06	1
<b>Boron</b>	<b>39.3</b>		1.00		mg/L		10/29/24 09:30	11/05/24 14:56	10
Cobalt	<0.000500		0.000500		mg/L		10/29/24 09:30	11/05/24 00:06	1
<b>Iron</b>	<b>0.123</b>		0.100		mg/L		10/29/24 09:30	11/05/24 00:06	1
<b>Lithium</b>	<b>0.154</b>		0.0100		mg/L		10/29/24 09:30	11/05/24 00:06	1
<b>Magnesium</b>	<b>126</b>		5.00		mg/L		10/29/24 09:30	11/05/24 14:56	10
<b>Manganese</b>	<b>0.0741</b>		0.0100		mg/L		10/29/24 09:30	11/05/24 00:06	1
<b>Molybdenum</b>	<b>0.259</b>		0.00200		mg/L		10/29/24 09:30	11/05/24 00:06	1
<b>Sodium</b>	<b>87.2</b>		1.00		mg/L		10/29/24 09:30	11/05/24 00:06	1
<b>Strontium</b>	<b>0.717</b>		0.00100		mg/L		10/29/24 09:30	11/05/24 00:06	1

**General Chemistry**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
<b>Sulfate (ASTM D516-16)</b>	<b>1260</b>		625		mg/L			11/01/24 16:12	125
<b>Chloride (SM 4500 Cl- E)</b>	<b>20.4</b>		2.00		mg/L			10/30/24 14:43	1

# Client Sample Results

Client: GHD Services Inc.  
Project/Site: CIPCO Ash Landfill Project

Job ID: 310-293513-1

**Client Sample ID: MW-17**

**Lab Sample ID: 310-293513-9**

Date Collected: 10/22/24 13:50

Matrix: Water

Date Received: 10/23/24 16:25

**Method: SW846 6020B - Metals (ICP/MS)**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Arsenic	<0.00200		0.00200		mg/L		10/29/24 09:30	11/05/24 00:12	1
<b>Boron</b>	<b>33.2</b>		1.00		mg/L		10/29/24 09:30	11/12/24 14:08	10
Cobalt	<0.000500		0.000500		mg/L		10/29/24 09:30	11/05/24 00:12	1
<b>Iron</b>	<b>1.43</b>		0.100		mg/L		10/29/24 09:30	11/05/24 00:12	1
<b>Lithium</b>	<b>0.293</b>		0.0100		mg/L		10/29/24 09:30	11/05/24 00:12	1
<b>Magnesium</b>	<b>214</b>		5.00		mg/L		10/29/24 09:30	11/12/24 14:08	10
<b>Manganese</b>	<b>0.257</b>		0.0100		mg/L		10/29/24 09:30	11/05/24 00:12	1
<b>Molybdenum</b>	<b>0.0770</b>		0.00200		mg/L		10/29/24 09:30	11/05/24 00:12	1
<b>Sodium</b>	<b>82.4</b>		1.00		mg/L		10/29/24 09:30	11/05/24 00:12	1
<b>Strontium</b>	<b>0.580</b>		0.00100		mg/L		10/29/24 09:30	11/05/24 00:12	1

**General Chemistry**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
<b>Sulfate (ASTM D516-16)</b>	<b>1190</b>		625		mg/L			11/01/24 16:13	125
<b>Chloride (SM 4500 Cl- E)</b>	<b>19.0</b>		2.00		mg/L			10/30/24 16:00	1

# Client Sample Results

Client: GHD Services Inc.  
 Project/Site: CIPCO Ash Landfill Project

Job ID: 310-293513-1

**Client Sample ID: MW-20**

**Lab Sample ID: 310-293513-10**

Date Collected: 10/22/24 11:40

Matrix: Water

Date Received: 10/23/24 16:25

**Method: SW846 6020B - Metals (ICP/MS)**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Arsenic	<0.00200		0.00200		mg/L		10/29/24 09:30	11/05/24 00:14	1
<b>Boron</b>	<b>1.47</b>		0.100		mg/L		10/29/24 09:30	11/05/24 15:02	1
Cobalt	<0.000500		0.000500		mg/L		10/29/24 09:30	11/05/24 00:14	1
<b>Iron</b>	<b>0.162</b>		0.100		mg/L		10/29/24 09:30	11/05/24 00:14	1
<b>Lithium</b>	<b>0.0219</b>		0.0100		mg/L		10/29/24 09:30	11/05/24 00:14	1
<b>Magnesium</b>	<b>15.3</b>		0.500		mg/L		10/29/24 09:30	11/05/24 00:14	1
<b>Manganese</b>	<b>0.0267</b>		0.0100		mg/L		10/29/24 09:30	11/05/24 00:14	1
Molybdenum	<0.00200		0.00200		mg/L		10/29/24 09:30	11/05/24 00:14	1
<b>Sodium</b>	<b>84.0</b>		1.00		mg/L		10/29/24 09:30	11/05/24 00:14	1
<b>Strontium</b>	<b>0.616</b>		0.00100		mg/L		10/29/24 09:30	11/05/24 00:14	1

**General Chemistry**

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
<b>Sulfate (ASTM D516-16)</b>	<b>36.5</b>		5.00		mg/L			10/31/24 16:25	1
<b>Chloride (SM 4500 Cl- E)</b>	<b>3.71</b>		2.00		mg/L			10/30/24 16:00	1

# Definitions/Glossary

Client: GHD Services Inc.  
Project/Site: CIPCO Ash Landfill Project

Job ID: 310-293513-1

## Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
☼	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CFU	Colony Forming Unit
CNF	Contains No Free Liquid
DER	Duplicate Error Ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL	Detection Limit (DoD/DOE)
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision Level Concentration (Radiochemistry)
EDL	Estimated Detection Limit (Dioxin)
LOD	Limit of Detection (DoD/DOE)
LOQ	Limit of Quantitation (DoD/DOE)
MCL	EPA recommended "Maximum Contaminant Level"
MDA	Minimum Detectable Activity (Radiochemistry)
MDC	Minimum Detectable Concentration (Radiochemistry)
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
MPN	Most Probable Number
MQL	Method Quantitation Limit
NC	Not Calculated
ND	Not Detected at the reporting limit (or MDL or EDL if shown)
NEG	Negative / Absent
POS	Positive / Present
PQL	Practical Quantitation Limit
PRES	Presumptive
QC	Quality Control
RER	Relative Error Ratio (Radiochemistry)
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)
TNTC	Too Numerous To Count



# QC Sample Results

Client: GHD Services Inc.  
Project/Site: CIPCO Ash Landfill Project

Job ID: 310-293513-1

## Method: 6020B - Metals (ICP/MS)

**Lab Sample ID: MB 310-437478/1-A**  
**Matrix: Water**  
**Analysis Batch: 438683**

**Client Sample ID: Method Blank**  
**Prep Type: Total/NA**  
**Prep Batch: 437478**

Analyte	MB	MB	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier							
Arsenic	<0.00200		0.00200		mg/L		10/29/24 09:30	11/04/24 22:58	1
Boron	<0.100		0.100		mg/L		10/29/24 09:30	11/04/24 22:58	1
Cobalt	<0.000500		0.000500		mg/L		10/29/24 09:30	11/04/24 22:58	1
Iron	<0.100		0.100		mg/L		10/29/24 09:30	11/04/24 22:58	1
Lithium	<0.0100		0.0100		mg/L		10/29/24 09:30	11/04/24 22:58	1
Magnesium	<0.500		0.500		mg/L		10/29/24 09:30	11/04/24 22:58	1
Manganese	<0.0100		0.0100		mg/L		10/29/24 09:30	11/04/24 22:58	1
Molybdenum	<0.00200		0.00200		mg/L		10/29/24 09:30	11/04/24 22:58	1
Sodium	<1.00		1.00		mg/L		10/29/24 09:30	11/04/24 22:58	1
Strontium	<0.00100		0.00100		mg/L		10/29/24 09:30	11/04/24 22:58	1

**Lab Sample ID: LCS 310-437478/2-A**  
**Matrix: Water**  
**Analysis Batch: 438683**

**Client Sample ID: Lab Control Sample**  
**Prep Type: Total/NA**  
**Prep Batch: 437478**

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Boron	0.200	0.1999		mg/L		100	80 - 120
Cobalt	0.100	0.1043		mg/L		104	80 - 120
Iron	0.200	0.1844		mg/L		92	80 - 120
Lithium	0.200	0.2041		mg/L		102	80 - 120
Magnesium	2.00	1.801		mg/L		90	80 - 120
Manganese	0.100	0.09238		mg/L		92	80 - 120
Molybdenum	0.200	0.1924		mg/L		96	80 - 120
Sodium	2.00	2.008		mg/L		100	80 - 120
Strontium	0.200	0.1942		mg/L		97	80 - 120

**Lab Sample ID: 310-293513-8 DU**  
**Matrix: Water**  
**Analysis Batch: 438683**

**Client Sample ID: MW-15**  
**Prep Type: Total/NA**  
**Prep Batch: 437478**

Analyte	Sample	Sample	DU	DU	Unit	D	RPD	Limit
	Result	Qualifier	Result	Qualifier				
Arsenic	<0.00200		<0.00200		mg/L		NC	20
Cobalt	<0.000500		<0.000500		mg/L		NC	20
Iron	0.123		0.1275		mg/L		4	20
Lithium	0.154		0.1606		mg/L		4	20
Manganese	0.0741		0.07676		mg/L		4	20
Molybdenum	0.259		0.2749		mg/L		6	20
Sodium	87.2		89.34		mg/L		2	20
Strontium	0.717		0.7447		mg/L		4	20

**Lab Sample ID: 310-293513-8 DU**  
**Matrix: Water**  
**Analysis Batch: 438759**

**Client Sample ID: MW-15**  
**Prep Type: Total/NA**  
**Prep Batch: 437478**

Analyte	Sample	Sample	DU	DU	Unit	D	RPD	Limit
	Result	Qualifier	Result	Qualifier				
Boron	39.3		41.42		mg/L		5	20
Magnesium	126		130.5		mg/L		4	20

Eurofins Cedar Falls

# QC Sample Results

Client: GHD Services Inc.  
Project/Site: CIPCO Ash Landfill Project

Job ID: 310-293513-1

## Method: D516-16 - Sulfate

**Lab Sample ID: MB 310-438284/16**  
**Matrix: Water**  
**Analysis Batch: 438284**

**Client Sample ID: Method Blank**  
**Prep Type: Total/NA**

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Sulfate	<5.00		5.00		mg/L			10/31/24 16:14	1

**Lab Sample ID: LCS 310-438284/17**  
**Matrix: Water**  
**Analysis Batch: 438284**

**Client Sample ID: Lab Control Sample**  
**Prep Type: Total/NA**

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Sulfate	10.0	10.02		mg/L		100	85 - 115

**Lab Sample ID: MB 310-438458/16**  
**Matrix: Water**  
**Analysis Batch: 438458**

**Client Sample ID: Method Blank**  
**Prep Type: Total/NA**

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Sulfate	<5.00		5.00		mg/L			11/01/24 15:16	1

**Lab Sample ID: MB 310-438458/28**  
**Matrix: Water**  
**Analysis Batch: 438458**

**Client Sample ID: Method Blank**  
**Prep Type: Total/NA**

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Sulfate	<5.00		5.00		mg/L			11/01/24 15:21	1

**Lab Sample ID: LCS 310-438458/17**  
**Matrix: Water**  
**Analysis Batch: 438458**

**Client Sample ID: Lab Control Sample**  
**Prep Type: Total/NA**

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Sulfate	10.0	9.153		mg/L		92	85 - 115

**Lab Sample ID: LCS 310-438458/29**  
**Matrix: Water**  
**Analysis Batch: 438458**

**Client Sample ID: Lab Control Sample**  
**Prep Type: Total/NA**

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Sulfate	10.0	9.081		mg/L		91	85 - 115

**Lab Sample ID: 310-293513-1 MS**  
**Matrix: Water**  
**Analysis Batch: 438458**

**Client Sample ID: MW-1**  
**Prep Type: Total/NA**

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits
Sulfate	244		250	445.3		mg/L		81	70 - 130

**Lab Sample ID: 310-293513-1 MSD**  
**Matrix: Water**  
**Analysis Batch: 438458**

**Client Sample ID: MW-1**  
**Prep Type: Total/NA**

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
Sulfate	244		250	483.4		mg/L		96	70 - 130	8	20

Eurofins Cedar Falls

# QC Sample Results

Client: GHD Services Inc.  
Project/Site: CIPCO Ash Landfill Project

Job ID: 310-293513-1

## Method: SM 4500 Cl- E - Chloride, Total

**Lab Sample ID: MB 310-438123/118**  
**Matrix: Water**  
**Analysis Batch: 438123**

**Client Sample ID: Method Blank**  
**Prep Type: Total/NA**

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	<2.00		2.00		mg/L			10/30/24 15:48	1

**Lab Sample ID: MB 310-438123/16**  
**Matrix: Water**  
**Analysis Batch: 438123**

**Client Sample ID: Method Blank**  
**Prep Type: Total/NA**

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	<2.00		2.00		mg/L			10/30/24 13:24	1

**Lab Sample ID: MB 310-438123/95**  
**Matrix: Water**  
**Analysis Batch: 438123**

**Client Sample ID: Method Blank**  
**Prep Type: Total/NA**

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	<2.00		2.00		mg/L			10/30/24 14:36	1

**Lab Sample ID: LCS 310-438123/119**  
**Matrix: Water**  
**Analysis Batch: 438123**

**Client Sample ID: Lab Control Sample**  
**Prep Type: Total/NA**

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Chloride	10.0	10.53		mg/L		105	90 - 110

**Lab Sample ID: LCS 310-438123/14**  
**Matrix: Water**  
**Analysis Batch: 438123**

**Client Sample ID: Lab Control Sample**  
**Prep Type: Total/NA**

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Chloride	10.0	10.44		mg/L		104	90 - 110

**Lab Sample ID: LCS 310-438123/96**  
**Matrix: Water**  
**Analysis Batch: 438123**

**Client Sample ID: Lab Control Sample**  
**Prep Type: Total/NA**

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Chloride	10.0	10.97		mg/L		110	90 - 110

# QC Association Summary

Client: GHD Services Inc.  
Project/Site: CIPCO Ash Landfill Project

Job ID: 310-293513-1

## Metals

### Prep Batch: 437478

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
310-293513-1	MW-1	Total/NA	Water	3005A	
310-293513-2	MW-2	Total/NA	Water	3005A	
310-293513-3	MW-3	Total/NA	Water	3005A	
310-293513-4	MW-5	Total/NA	Water	3005A	
310-293513-5	MW-6	Total/NA	Water	3005A	
310-293513-6	MW-9	Total/NA	Water	3005A	
310-293513-7	MW-11	Total/NA	Water	3005A	
310-293513-8	MW-15	Total/NA	Water	3005A	
310-293513-9	MW-17	Total/NA	Water	3005A	
310-293513-10	MW-20	Total/NA	Water	3005A	
MB 310-437478/1-A	Method Blank	Total/NA	Water	3005A	
LCS 310-437478/2-A	Lab Control Sample	Total/NA	Water	3005A	
310-293513-8 DU	MW-15	Total/NA	Water	3005A	

### Analysis Batch: 438683

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
310-293513-1	MW-1	Total/NA	Water	6020B	437478
310-293513-2	MW-2	Total/NA	Water	6020B	437478
310-293513-3	MW-3	Total/NA	Water	6020B	437478
310-293513-4	MW-5	Total/NA	Water	6020B	437478
310-293513-5	MW-6	Total/NA	Water	6020B	437478
310-293513-6	MW-9	Total/NA	Water	6020B	437478
310-293513-7	MW-11	Total/NA	Water	6020B	437478
310-293513-8	MW-15	Total/NA	Water	6020B	437478
310-293513-9	MW-17	Total/NA	Water	6020B	437478
310-293513-10	MW-20	Total/NA	Water	6020B	437478
MB 310-437478/1-A	Method Blank	Total/NA	Water	6020B	437478
LCS 310-437478/2-A	Lab Control Sample	Total/NA	Water	6020B	437478
310-293513-8 DU	MW-15	Total/NA	Water	6020B	437478

### Analysis Batch: 438759

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
310-293513-2	MW-2	Total/NA	Water	6020B	437478
310-293513-4	MW-5	Total/NA	Water	6020B	437478
310-293513-5	MW-6	Total/NA	Water	6020B	437478
310-293513-8	MW-15	Total/NA	Water	6020B	437478
310-293513-10	MW-20	Total/NA	Water	6020B	437478
310-293513-8 DU	MW-15	Total/NA	Water	6020B	437478

### Analysis Batch: 439509

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
310-293513-9	MW-17	Total/NA	Water	6020B	437478

## General Chemistry

### Analysis Batch: 438123

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
310-293513-1	MW-1	Total/NA	Water	SM 4500 CI- E	
310-293513-2	MW-2	Total/NA	Water	SM 4500 CI- E	
310-293513-3	MW-3	Total/NA	Water	SM 4500 CI- E	
310-293513-4	MW-5	Total/NA	Water	SM 4500 CI- E	

Eurofins Cedar Falls

# QC Association Summary

Client: GHD Services Inc.  
 Project/Site: CIPCO Ash Landfill Project

Job ID: 310-293513-1

## General Chemistry (Continued)

### Analysis Batch: 438123 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
310-293513-5	MW-6	Total/NA	Water	SM 4500 CI- E	
310-293513-6	MW-9	Total/NA	Water	SM 4500 CI- E	
310-293513-7	MW-11	Total/NA	Water	SM 4500 CI- E	
310-293513-8	MW-15	Total/NA	Water	SM 4500 CI- E	
310-293513-9	MW-17	Total/NA	Water	SM 4500 CI- E	
310-293513-10	MW-20	Total/NA	Water	SM 4500 CI- E	
MB 310-438123/118	Method Blank	Total/NA	Water	SM 4500 CI- E	
MB 310-438123/16	Method Blank	Total/NA	Water	SM 4500 CI- E	
MB 310-438123/95	Method Blank	Total/NA	Water	SM 4500 CI- E	
LCS 310-438123/119	Lab Control Sample	Total/NA	Water	SM 4500 CI- E	
LCS 310-438123/14	Lab Control Sample	Total/NA	Water	SM 4500 CI- E	
LCS 310-438123/96	Lab Control Sample	Total/NA	Water	SM 4500 CI- E	

### Analysis Batch: 438284

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
310-293513-2	MW-2	Total/NA	Water	D516-16	
310-293513-3	MW-3	Total/NA	Water	D516-16	
310-293513-4	MW-5	Total/NA	Water	D516-16	
310-293513-6	MW-9	Total/NA	Water	D516-16	
310-293513-7	MW-11	Total/NA	Water	D516-16	
310-293513-10	MW-20	Total/NA	Water	D516-16	
MB 310-438284/16	Method Blank	Total/NA	Water	D516-16	
LCS 310-438284/17	Lab Control Sample	Total/NA	Water	D516-16	

### Analysis Batch: 438458

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
310-293513-1	MW-1	Total/NA	Water	D516-16	
310-293513-5	MW-6	Total/NA	Water	D516-16	
310-293513-8	MW-15	Total/NA	Water	D516-16	
310-293513-9	MW-17	Total/NA	Water	D516-16	
MB 310-438458/16	Method Blank	Total/NA	Water	D516-16	
MB 310-438458/28	Method Blank	Total/NA	Water	D516-16	
LCS 310-438458/17	Lab Control Sample	Total/NA	Water	D516-16	
LCS 310-438458/29	Lab Control Sample	Total/NA	Water	D516-16	
310-293513-1 MS	MW-1	Total/NA	Water	D516-16	
310-293513-1 MSD	MW-1	Total/NA	Water	D516-16	



# Lab Chronicle

Client: GHD Services Inc.  
Project/Site: CIPCO Ash Landfill Project

Job ID: 310-293513-1

**Client Sample ID: MW-1**

**Lab Sample ID: 310-293513-1**

Date Collected: 10/22/24 10:35

Matrix: Water

Date Received: 10/23/24 16:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	3005A			437478	F5MW	EET CF	10/29/24 09:30
Total/NA	Analysis	6020B		1	438683	A6US	EET CF	11/04/24 23:35
Total/NA	Analysis	D516-16		25	438458	ENB7	EET CF	11/01/24 15:17
Total/NA	Analysis	SM 4500 CI- E		1	438123	ENB7	EET CF	10/30/24 14:40

**Client Sample ID: MW-2**

**Lab Sample ID: 310-293513-2**

Date Collected: 10/22/24 15:55

Matrix: Water

Date Received: 10/23/24 16:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	3005A			437478	F5MW	EET CF	10/29/24 09:30
Total/NA	Analysis	6020B		1	438683	A6US	EET CF	11/04/24 23:38
Total/NA	Prep	3005A			437478	F5MW	EET CF	10/29/24 09:30
Total/NA	Analysis	6020B		4	438759	A6US	EET CF	11/05/24 14:47
Total/NA	Analysis	D516-16		5	438284	ENB7	EET CF	10/31/24 16:37
Total/NA	Analysis	SM 4500 CI- E		1	438123	ENB7	EET CF	10/30/24 14:40

**Client Sample ID: MW-3**

**Lab Sample ID: 310-293513-3**

Date Collected: 10/22/24 17:30

Matrix: Water

Date Received: 10/23/24 16:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	3005A			437478	F5MW	EET CF	10/29/24 09:30
Total/NA	Analysis	6020B		1	438683	A6US	EET CF	11/04/24 23:40
Total/NA	Analysis	D516-16		1	438284	ENB7	EET CF	10/31/24 16:21
Total/NA	Analysis	SM 4500 CI- E		1	438123	ENB7	EET CF	10/30/24 14:41

**Client Sample ID: MW-5**

**Lab Sample ID: 310-293513-4**

Date Collected: 10/22/24 12:20

Matrix: Water

Date Received: 10/23/24 16:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	3005A			437478	F5MW	EET CF	10/29/24 09:30
Total/NA	Analysis	6020B		1	438683	A6US	EET CF	11/04/24 23:43
Total/NA	Prep	3005A			437478	F5MW	EET CF	10/29/24 09:30
Total/NA	Analysis	6020B		4	438759	A6US	EET CF	11/05/24 14:50
Total/NA	Analysis	D516-16		5	438284	ENB7	EET CF	10/31/24 16:38
Total/NA	Analysis	SM 4500 CI- E		1	438123	ENB7	EET CF	10/30/24 14:41

# Lab Chronicle

Client: GHD Services Inc.  
Project/Site: CIPCO Ash Landfill Project

Job ID: 310-293513-1

**Client Sample ID: MW-6**  
Date Collected: 10/22/24 13:00  
Date Received: 10/23/24 16:25

**Lab Sample ID: 310-293513-5**  
Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	3005A			437478	F5MW	EET CF	10/29/24 09:30
Total/NA	Analysis	6020B		1	438683	A6US	EET CF	11/04/24 23:46
Total/NA	Prep	3005A			437478	F5MW	EET CF	10/29/24 09:30
Total/NA	Analysis	6020B		4	438759	A6US	EET CF	11/05/24 14:53
Total/NA	Analysis	D516-16		5	438458	ENB7	EET CF	11/01/24 15:19
Total/NA	Analysis	SM 4500 Cl- E		1	438123	ENB7	EET CF	10/30/24 14:41

**Client Sample ID: MW-9**  
Date Collected: 10/22/24 18:00  
Date Received: 10/23/24 16:25

**Lab Sample ID: 310-293513-6**  
Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	3005A			437478	F5MW	EET CF	10/29/24 09:30
Total/NA	Analysis	6020B		1	438683	A6US	EET CF	11/04/24 23:49
Total/NA	Analysis	D516-16		1	438284	ENB7	EET CF	10/31/24 16:24
Total/NA	Analysis	SM 4500 Cl- E		1	438123	ENB7	EET CF	10/30/24 14:42

**Client Sample ID: MW-11**  
Date Collected: 10/22/24 09:00  
Date Received: 10/23/24 16:25

**Lab Sample ID: 310-293513-7**  
Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	3005A			437478	F5MW	EET CF	10/29/24 09:30
Total/NA	Analysis	6020B		1	438683	A6US	EET CF	11/04/24 23:52
Total/NA	Analysis	D516-16		5	438284	ENB7	EET CF	10/31/24 16:39
Total/NA	Analysis	SM 4500 Cl- E		1	438123	ENB7	EET CF	10/30/24 14:42

**Client Sample ID: MW-15**  
Date Collected: 10/22/24 15:10  
Date Received: 10/23/24 16:25

**Lab Sample ID: 310-293513-8**  
Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	3005A			437478	F5MW	EET CF	10/29/24 09:30
Total/NA	Analysis	6020B		1	438683	A6US	EET CF	11/05/24 00:06
Total/NA	Prep	3005A			437478	F5MW	EET CF	10/29/24 09:30
Total/NA	Analysis	6020B		10	438759	A6US	EET CF	11/05/24 14:56
Total/NA	Analysis	D516-16		125	438458	ENB7	EET CF	11/01/24 16:12
Total/NA	Analysis	SM 4500 Cl- E		1	438123	ENB7	EET CF	10/30/24 14:43

# Lab Chronicle

Client: GHD Services Inc.  
 Project/Site: CIPCO Ash Landfill Project

Job ID: 310-293513-1

**Client Sample ID: MW-17**

**Lab Sample ID: 310-293513-9**

Date Collected: 10/22/24 13:50

Matrix: Water

Date Received: 10/23/24 16:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	3005A			437478	F5MW	EET CF	10/29/24 09:30
Total/NA	Analysis	6020B		10	439509	NFT2	EET CF	11/12/24 14:08
Total/NA	Prep	3005A			437478	F5MW	EET CF	10/29/24 09:30
Total/NA	Analysis	6020B		1	438683	A6US	EET CF	11/05/24 00:12
Total/NA	Analysis	D516-16		125	438458	ENB7	EET CF	11/01/24 16:13
Total/NA	Analysis	SM 4500 CI- E		1	438123	ENB7	EET CF	10/30/24 16:00

**Client Sample ID: MW-20**

**Lab Sample ID: 310-293513-10**

Date Collected: 10/22/24 11:40

Matrix: Water

Date Received: 10/23/24 16:25

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Batch Analyst	Lab	Prepared or Analyzed
Total/NA	Prep	3005A			437478	F5MW	EET CF	10/29/24 09:30
Total/NA	Analysis	6020B		1	438683	A6US	EET CF	11/05/24 00:14
Total/NA	Prep	3005A			437478	F5MW	EET CF	10/29/24 09:30
Total/NA	Analysis	6020B		1	438759	A6US	EET CF	11/05/24 15:02
Total/NA	Analysis	D516-16		1	438284	ENB7	EET CF	10/31/24 16:25
Total/NA	Analysis	SM 4500 CI- E		1	438123	ENB7	EET CF	10/30/24 16:00

**Laboratory References:**

EET CF = Eurofins Cedar Falls, 3019 Venture Way, Cedar Falls, IA 50613, TEL (319)277-2401

# Accreditation/Certification Summary

Client: GHD Services Inc.  
Project/Site: CIPCO Ash Landfill Project

Job ID: 310-293513-1

## Laboratory: Eurofins Cedar Falls

Unless otherwise noted, all analytes for this laboratory were covered under each accreditation/certification below.

Authority	Program	Identification Number	Expiration Date
Iowa	State	007	12-01-25

The following analytes are included in this report, but the laboratory is not certified by the governing authority. This list may include analytes for which the agency does not offer certification.

Analysis Method	Prep Method	Matrix	Analyte
6020B	3005A	Water	Lithium

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14

# Method Summary

Client: GHD Services Inc.  
Project/Site: CIPCO Ash Landfill Project

Job ID: 310-293513-1

Method	Method Description	Protocol	Laboratory
6020B	Metals (ICP/MS)	SW846	EET CF
D516-16	Sulfate	ASTM	EET CF
SM 4500 Cl- E	Chloride, Total	SM	EET CF
3005A	Preparation, Total Metals	SW846	EET CF

**Protocol References:**

ASTM = ASTM International

SM = "Standard Methods For The Examination Of Water And Wastewater"

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

**Laboratory References:**

EET CF = Eurofins Cedar Falls, 3019 Venture Way, Cedar Falls, IA 50613, TEL (319)277-2401







Environment Testing  
America



310-293513 Chain of Custody

**Cooler/Sample Receipt and Temperature Log Form**

<b>Client Information</b>			
Client <u>GHD Services</u>			
City/State:	CITY	STATE	Project:
<b>Receipt Information</b>			
Date/Time Received:	DATE	TIME	Received By:
	<u>10.23.24</u>	<u>1625</u>	<u>CGC</u>
Delivery Type: <input type="checkbox"/> UPS <input type="checkbox"/> FedEx <input type="checkbox"/> FedEx Ground <input type="checkbox"/> US Mail <input type="checkbox"/> Spee-Dee			
<input checked="" type="checkbox"/> Lab Courier <input type="checkbox"/> Lab Field Services <input type="checkbox"/> Client Drop-off <input type="checkbox"/> Other: _____			
<b>Condition of Cooler/Containers</b>			
Sample(s) received in Cooler?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	If yes: Cooler ID: _____	
Multiple Coolers?	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	If yes: Cooler # _____ of _____	
Cooler Custody Seals Present?	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	If yes: Cooler custody seals intact? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
Sample Custody Seals Present?	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	If yes: Sample custody seals intact? <input type="checkbox"/> Yes <input type="checkbox"/> No	
Trip Blank Present?	<input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	If yes: Which VOA samples are in cooler? ↓	
<b>Temperature Record</b>			
Coolant:	<input checked="" type="checkbox"/> Wet ice <input type="checkbox"/> Blue ice <input type="checkbox"/> Dry ice <input type="checkbox"/> Other: _____ <input type="checkbox"/> NONE		
Thermometer ID:	<u>P</u>	Correction Factor (°C):	<u>0</u>
• <b>Temp Blank Temperature</b> – If no temp blank, or temp blank temperature above criteria, proceed to Sample Container Temperature			
Uncorrected Temp (°C):	<u>2.4</u>	Corrected Temp (°C):	<u>2.4</u>
• <b>Sample Container Temperature</b>			
Container(s) used	<u>CONTAINER 1</u>	<u>CONTAINER 2</u>	
Uncorrected Temp (°C):			
Corrected Temp (°C):			
<b>Exceptions Noted</b>			
1) If temperature exceeds criteria, was sample(s) received same day of sampling? <input type="checkbox"/> Yes <input type="checkbox"/> No			
a) If yes: Is there evidence that the chilling process began? <input type="checkbox"/> Yes <input type="checkbox"/> No			
2) If temperature is <0°C, are there obvious signs that the integrity of sample containers is compromised? (e.g., bulging septa, broken/cracked bottles, frozen solid?) <input type="checkbox"/> Yes <input type="checkbox"/> No			
NOTE: If yes, contact PM before proceeding. If no, proceed with login			
<b>Additional Comments</b>			



# Chain of Custody Record

<b>Client Information</b>		Sampler: <u>CWO</u>		Lab PM: Bindert, Zach T		Carrier Tracking No(s): 310-99464-26950 1	
Client Contact: Clint Oberbroeckling		Phone: <u>515 210.4299</u>		E-Mail: Zach.Bindert@et.eurofinsus.com		Page: Page 1 of 1	
Company: GHD Services Inc.		PWSID:		Analysis Requested		Job #: <u>12560436</u>	
Address: 11228 Aurora Avenue		Due Date Requested: <u>Std</u>		Perform MS/MSD (Yes or No)		Preservation Codes	
City: Des Moines		TAT Requested (days): <u>14 cal Day 5</u>		Field Filtered Sample (Yes or No)		N - None D - HNO3	
State, Zip: IA, 50322-7905		Compliance Project: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No		9066A_ORGFM_28D - Chloride and Sulfate		Other:	
Phone: 515-414-3944(Tel)		PO #:		9020B - (MOD) Total Select IC/PMS Metals		Total Number of Containers	
Email: clint.oberbroeckling@ghd.com		WO #: 12560436-004		N		Special Instructions/Note:	
Project Name: CIPCO Ash Landfill Project		Project #: 31018156		D			
Site:		SSOW#:					
Sample Identification	Sample Date	Sample Time	Sample Type (C=comp, G=grab)	Matrix (W=water, S=solid, O=wastewater, B=BT-THRU, A=air)	Field Filtered Sample (Yes or No) <th>9066A_ORGFM_28D - Chloride and Sulfate <th>9020B - (MOD) Total Select IC/PMS Metals </th></th>	9066A_ORGFM_28D - Chloride and Sulfate <th>9020B - (MOD) Total Select IC/PMS Metals </th>	9020B - (MOD) Total Select IC/PMS Metals
MW-1	10/22/24	1035	G	Water	X	X	X
MW-2		1555		Water			
MW-3		1730		Water			
MW-5		1320		Water			
MW-6		1300		Water			
MW-9		1900		Water			
MW-10 11		900		Water			
MW-15		1510		Water			
MW-17		1350		Water			
MW-20		1140		Water			
<b>Possible Hazard Identification</b>		<input checked="" type="checkbox"/> Non-Hazard <input type="checkbox"/> Flammable <input type="checkbox"/> Skin Irritant <input type="checkbox"/> Poison B <input type="checkbox"/> Unknown <input type="checkbox"/> Radiological		Sample Disposal (A fee may be assessed if samples are retained longer than 1 month)		Return To Client <input checked="" type="checkbox"/> Disposal By Lab <input type="checkbox"/> Archive For _____ Months	
Deliverable Requested I, II, III, IV, Other (specify)		Empty Kit Relinquished by: <u>Front Desk</u>		Date: 10/23/24		Method of Shipment:	
Relinquished by: <u>Front Desk</u>		Company: <u>GHD</u>		Received by: <u>Front Desk</u>		Date/Time: 10/23/24 1200	
Relinquished by: <u>Front Desk</u>		Company: <u>GHD</u>		Received by: <u>Beal Mary</u>		Date/Time: 10/23/24 1351	
Relinquished by: <u>Front Desk</u>		Company: <u>GHD</u>		Received by: <u>CCG</u>		Date/Time: 10-23-24 1625	
Custody Seals Intact: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No		Custody Seal No		Cooler Temperature(s) °C and Other Remarks:			



## Login Sample Receipt Checklist

Client: GHD Services Inc.

Job Number: 310-293513-1

**Login Number: 293513**

**List Source: Eurofins Cedar Falls**

**List Number: 1**

**Creator: Hirsch, Preston**



Question	Answer	Comment
Radioactivity wasn't checked or is </= background as measured by a survey meter.	N/A	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	N/A	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time (excluding tests with immediate HTs)	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is <6mm (1/4").	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	



# **Appendix C**



**Graphs of Analytical and Monitoring  
Results**

# ARSENIC

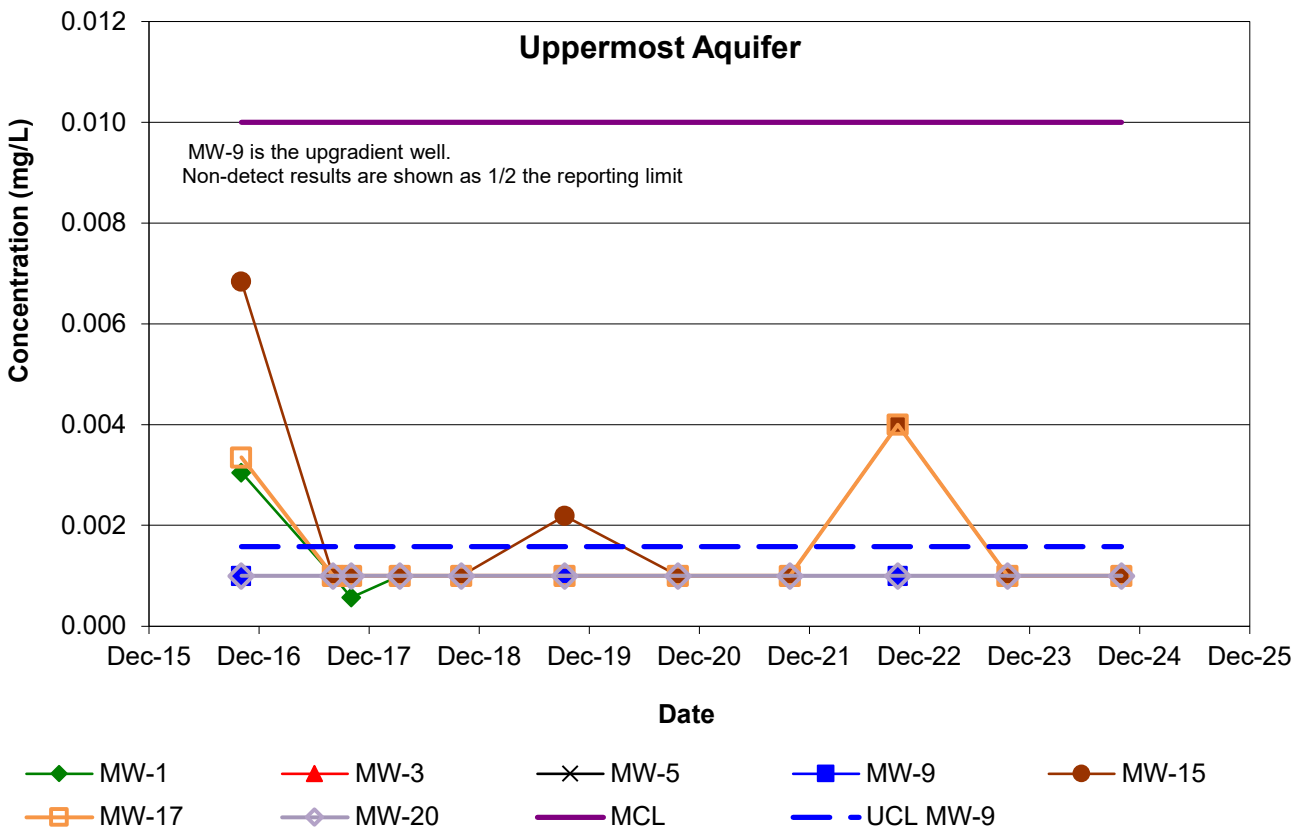
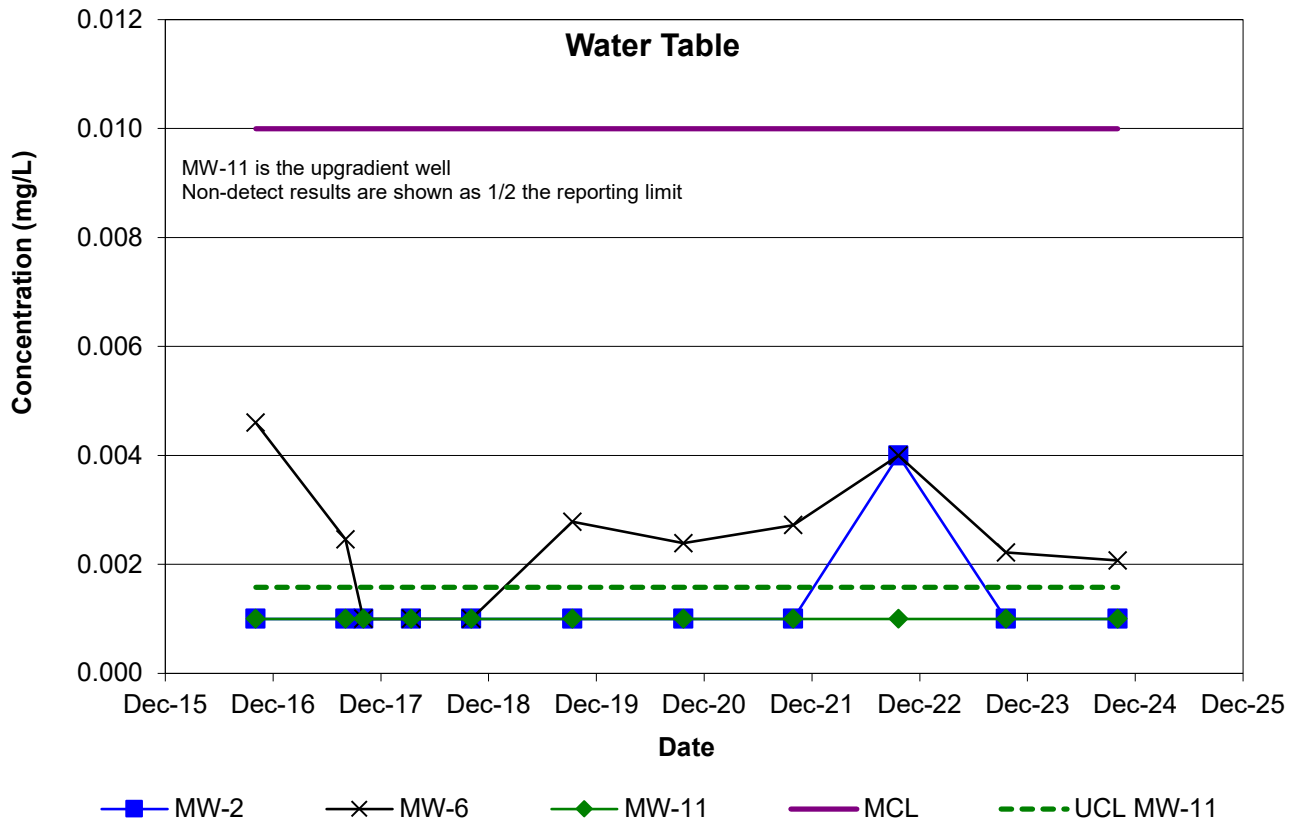






# BORON

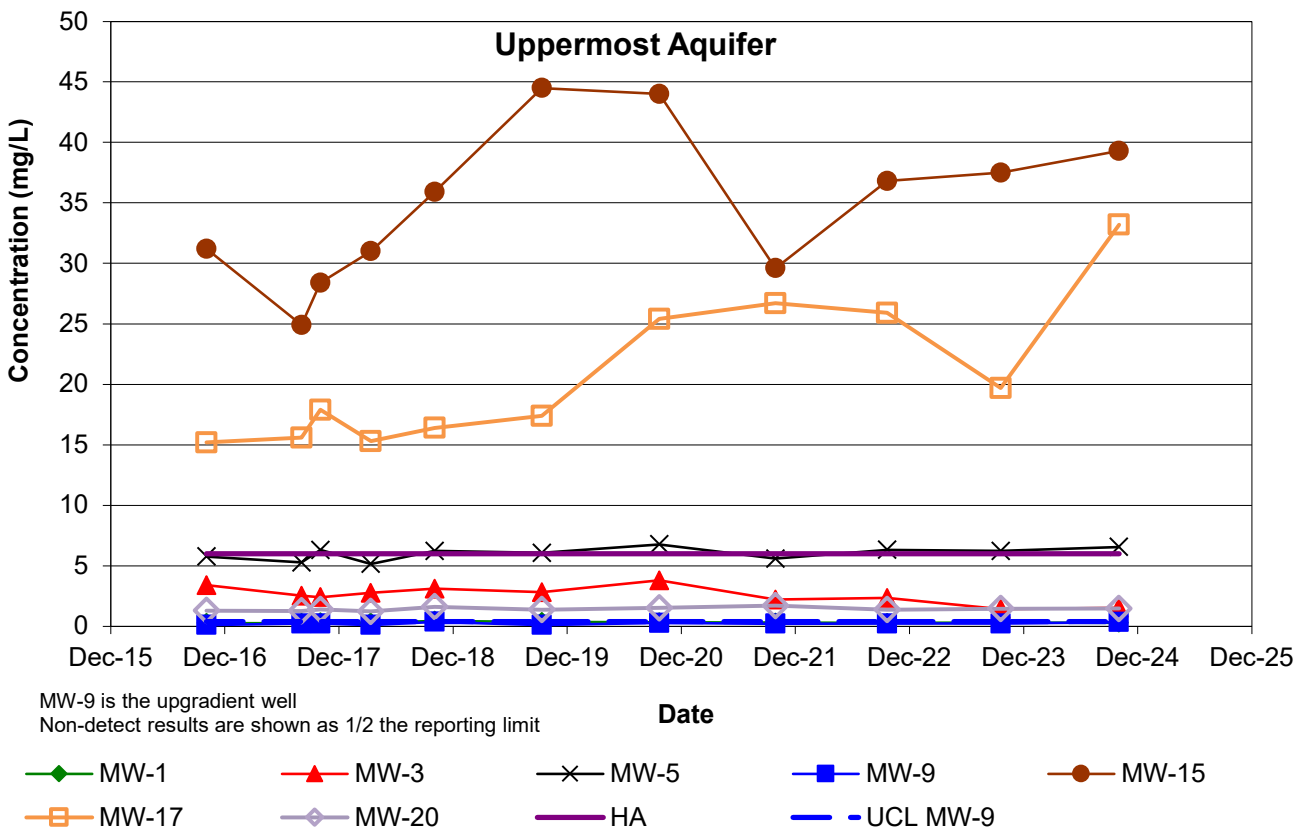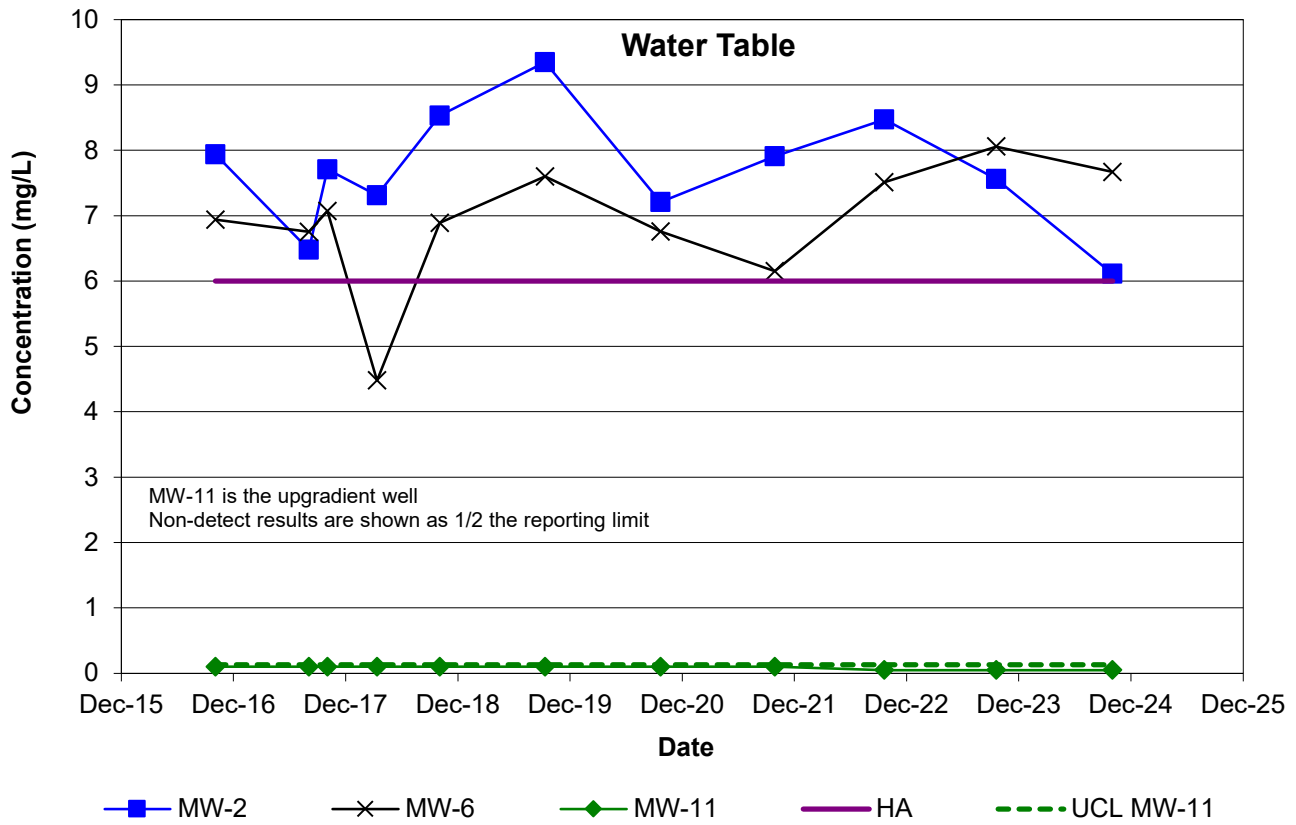



# CHLORIDE

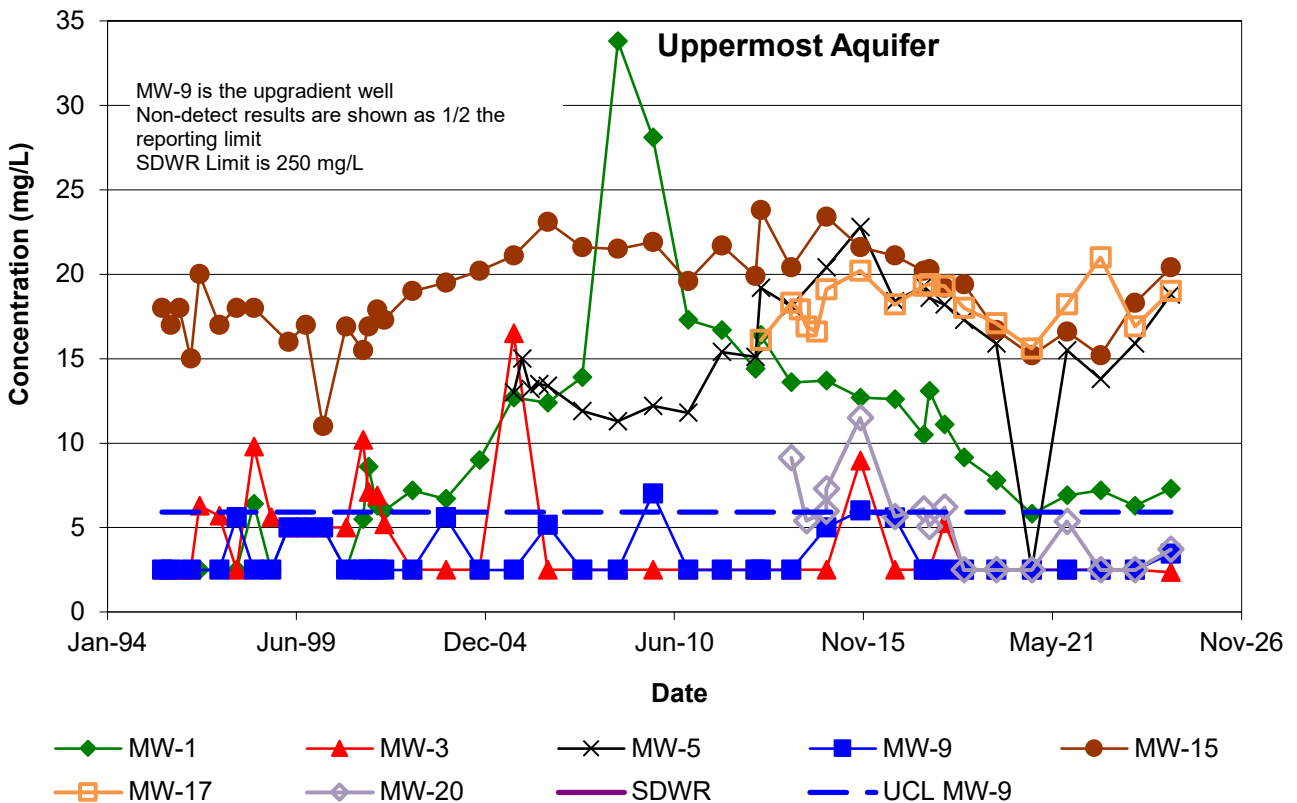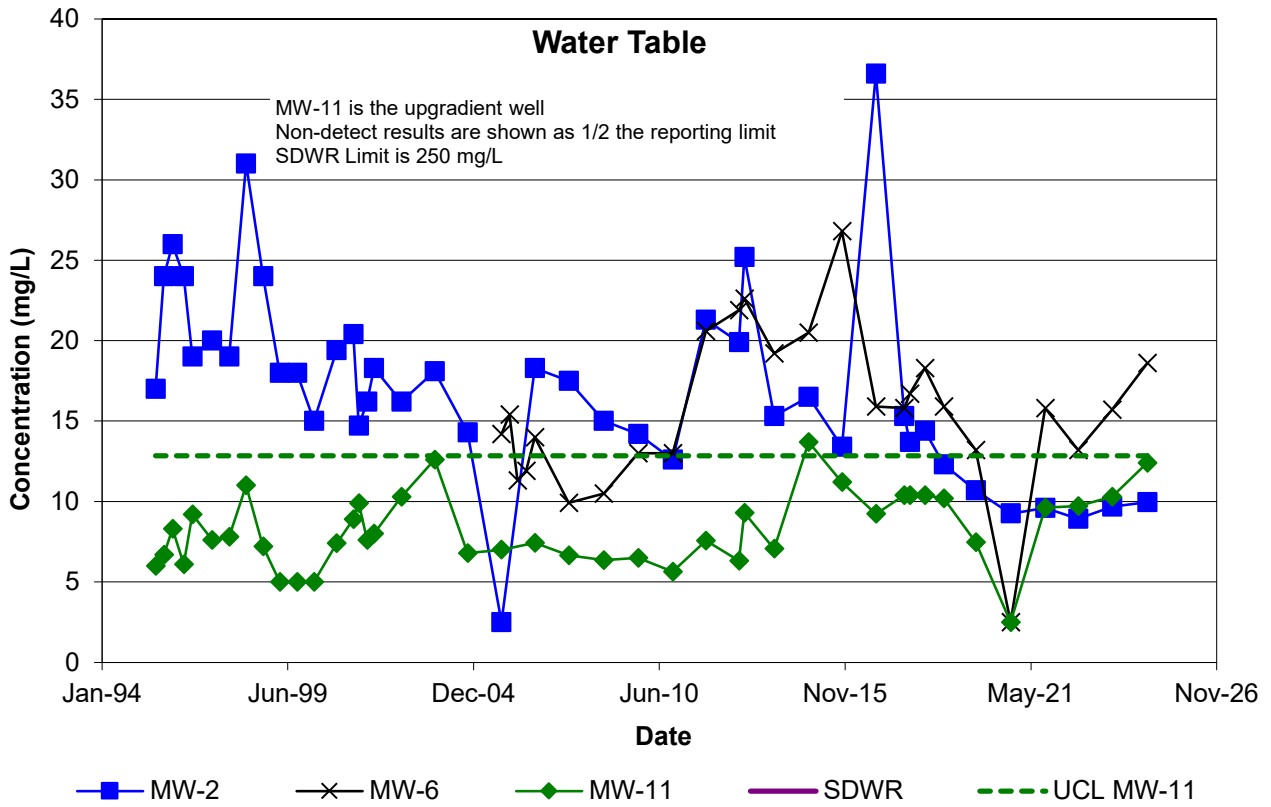



# COBALT

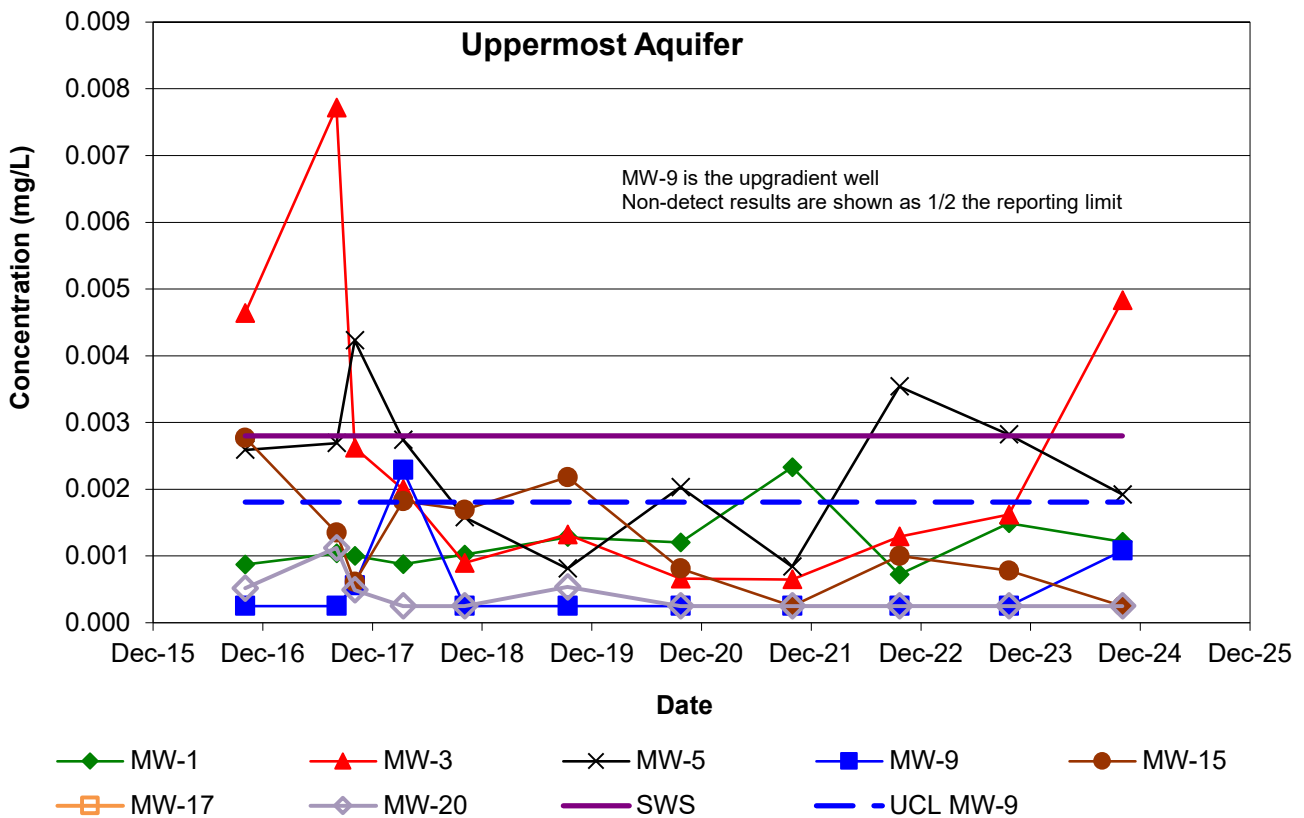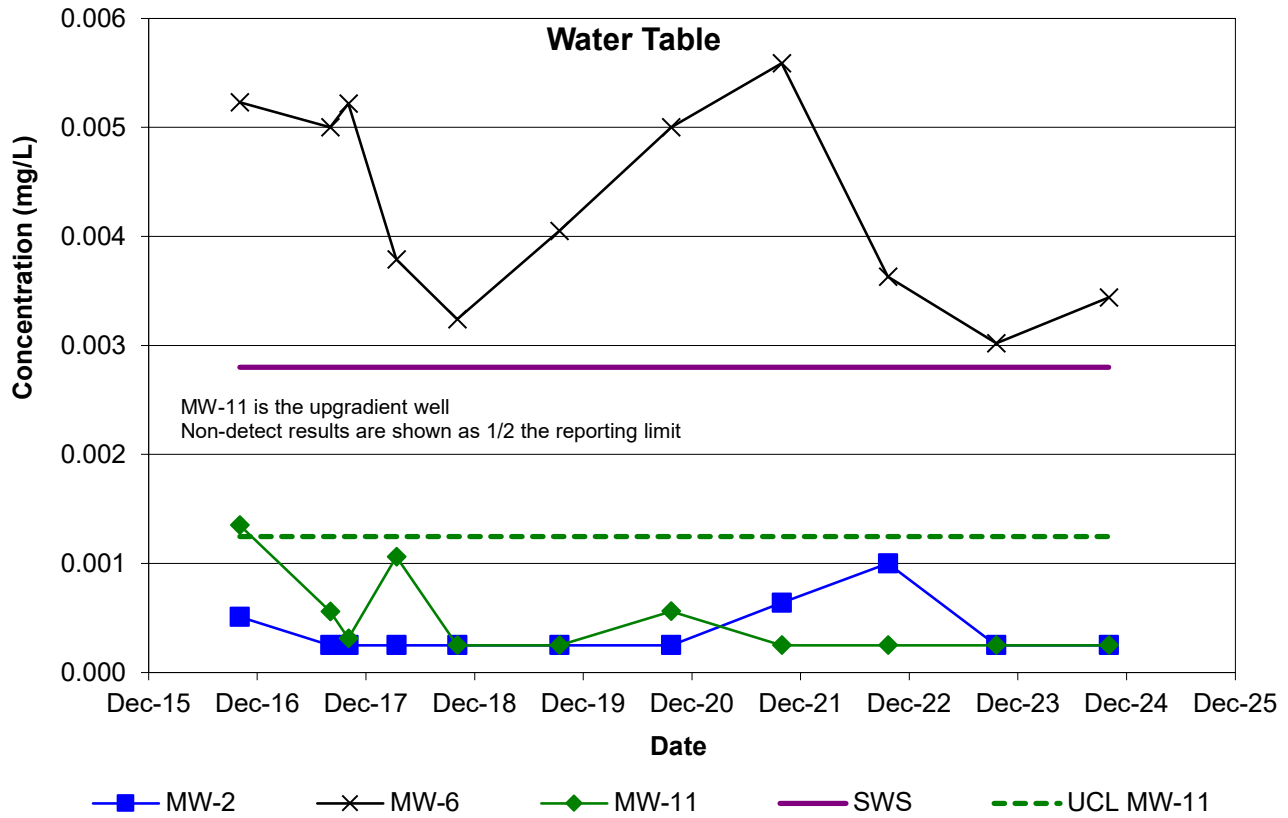

# IRON

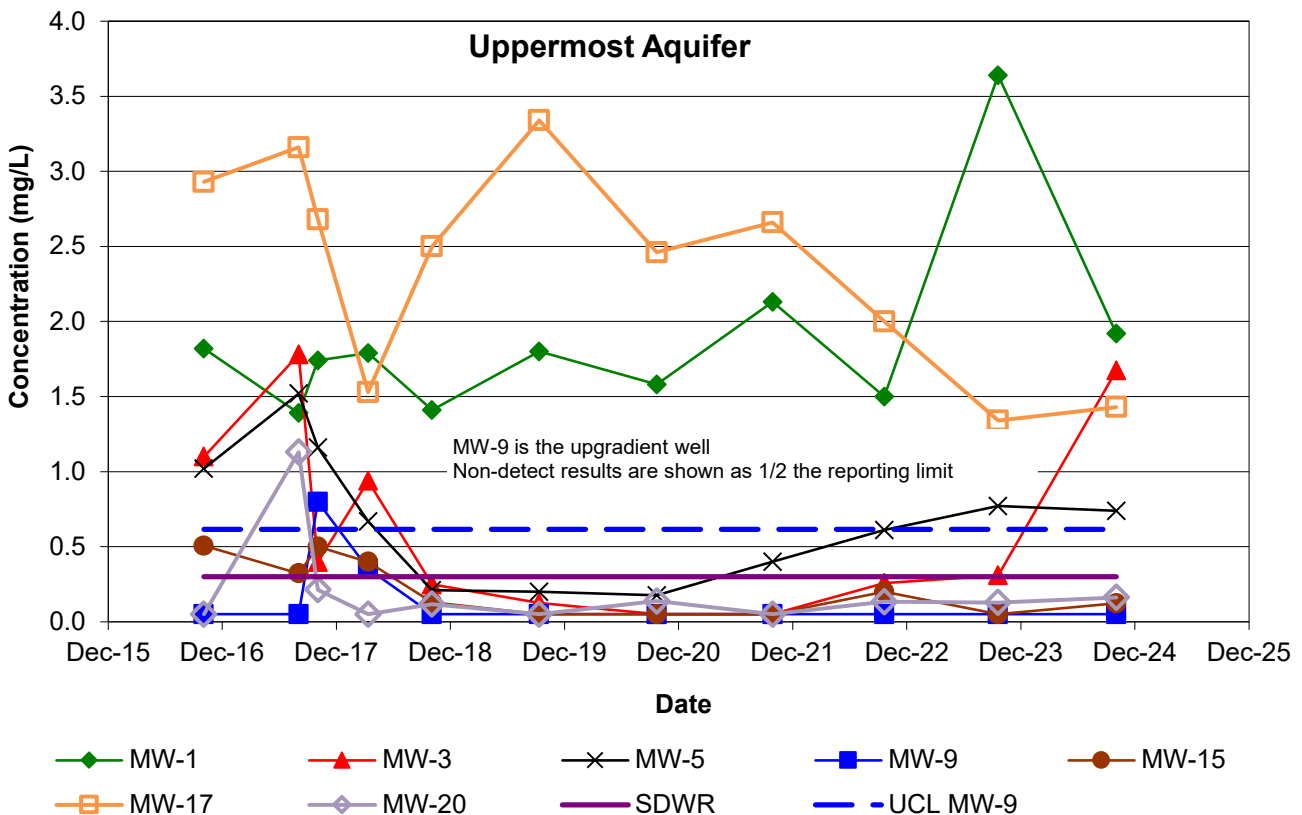
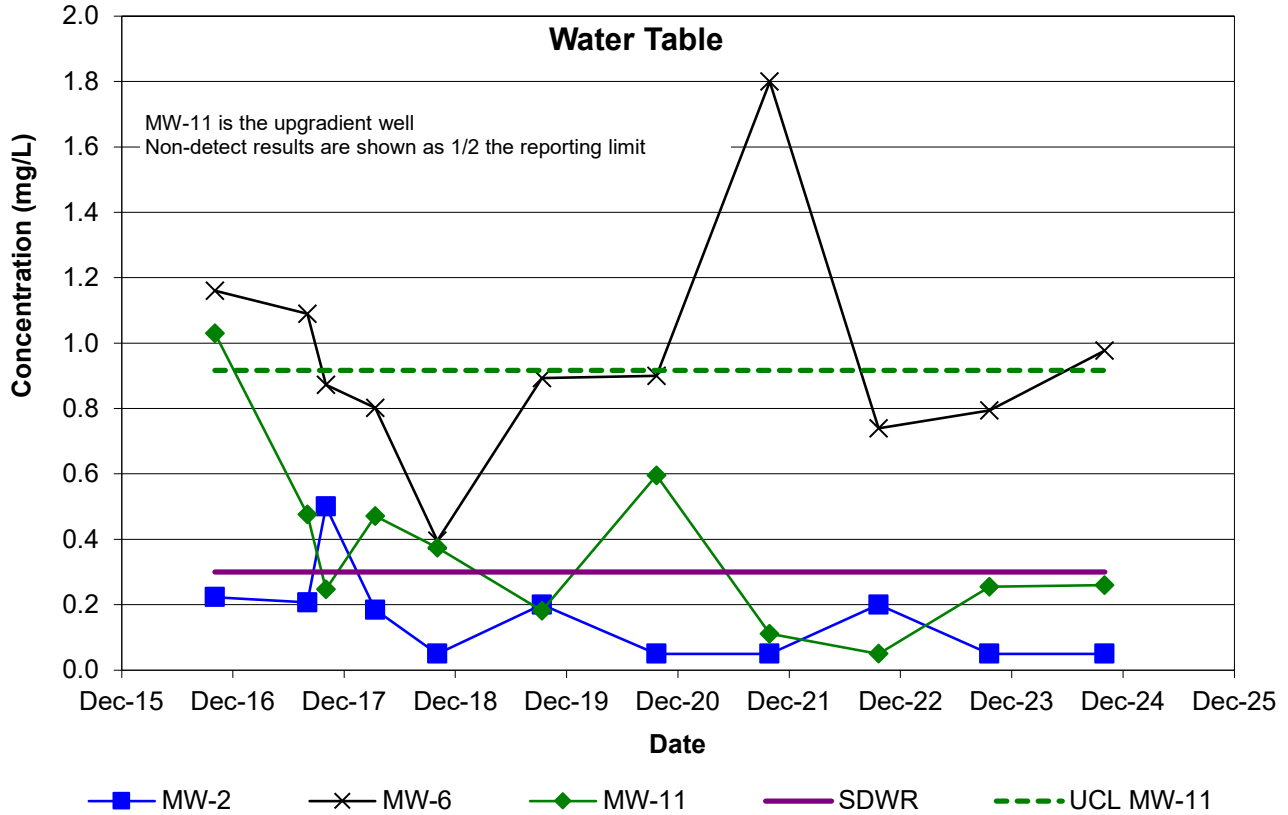


# LITHIUM

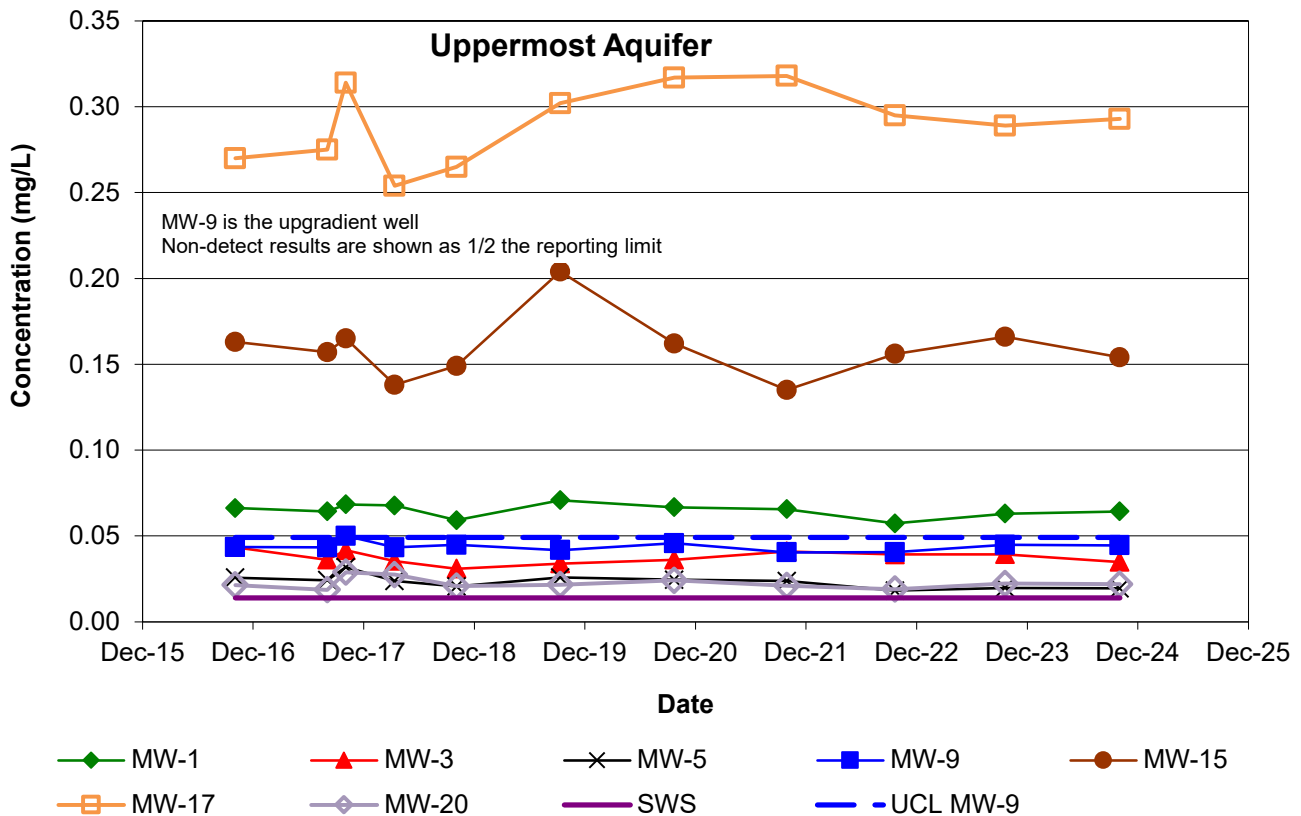
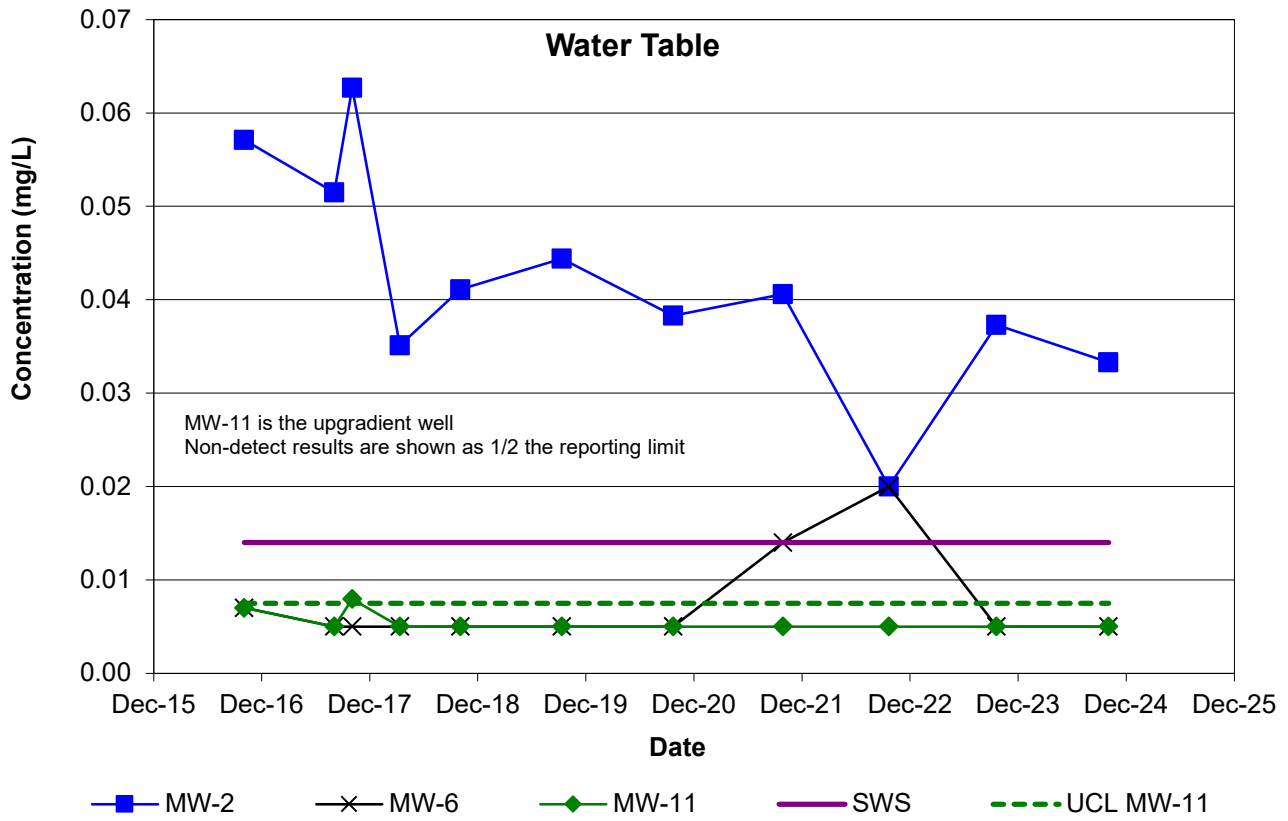






# MAGNESIUM

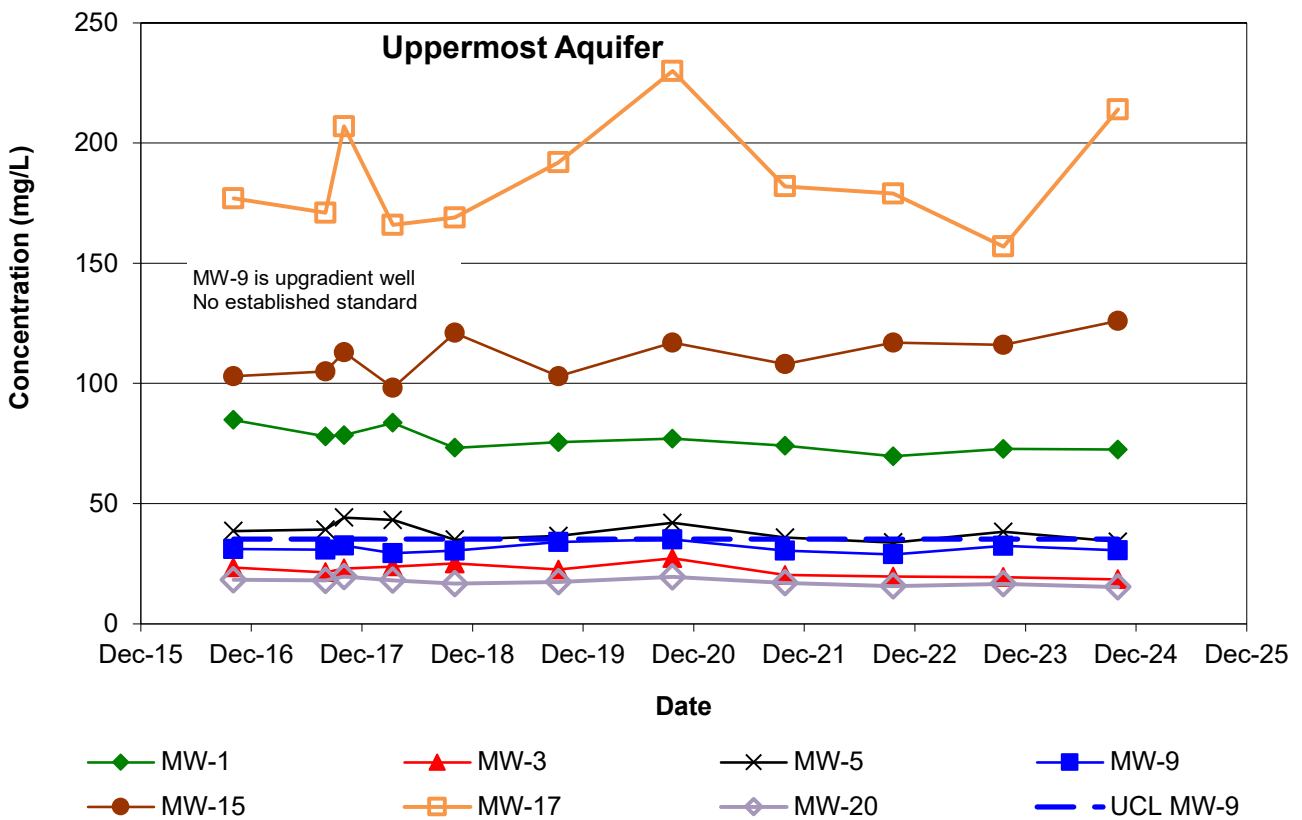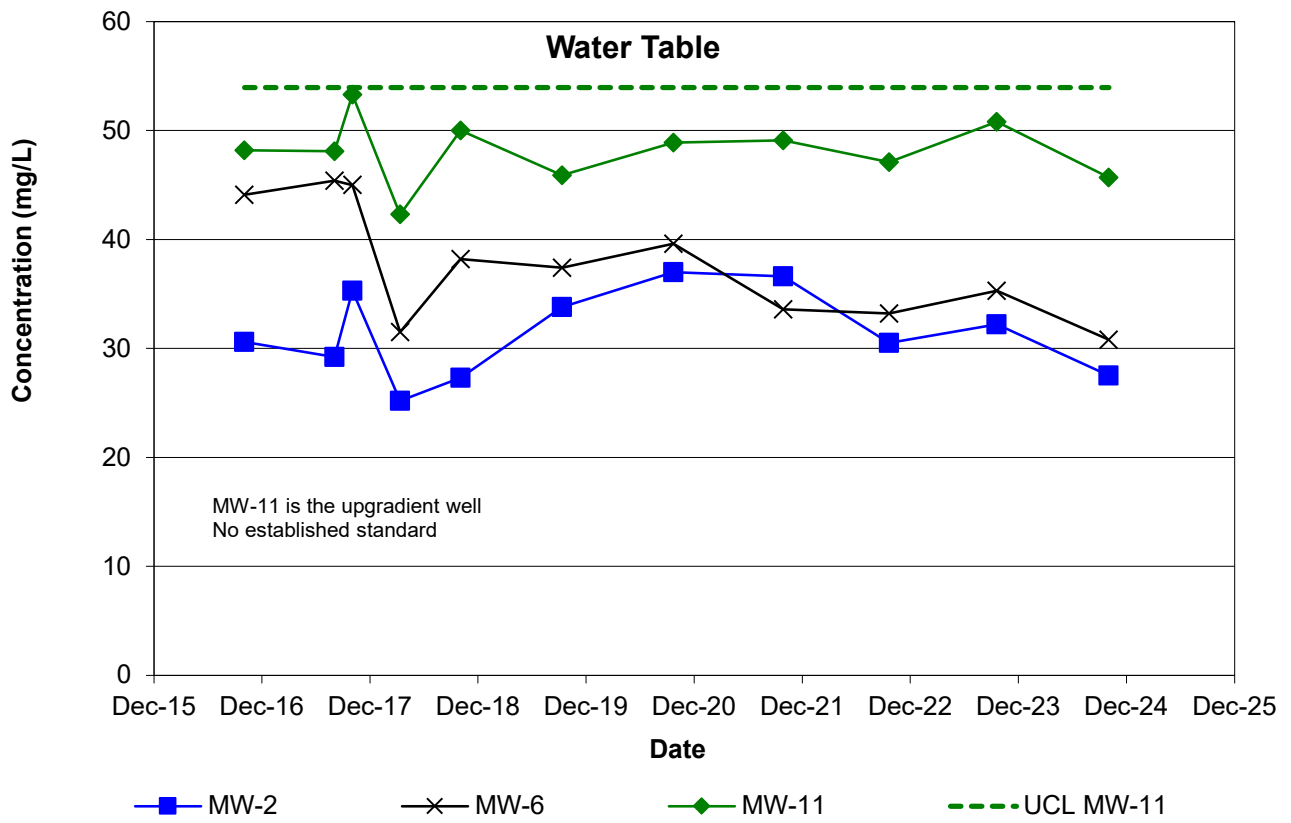



# MANGANESE

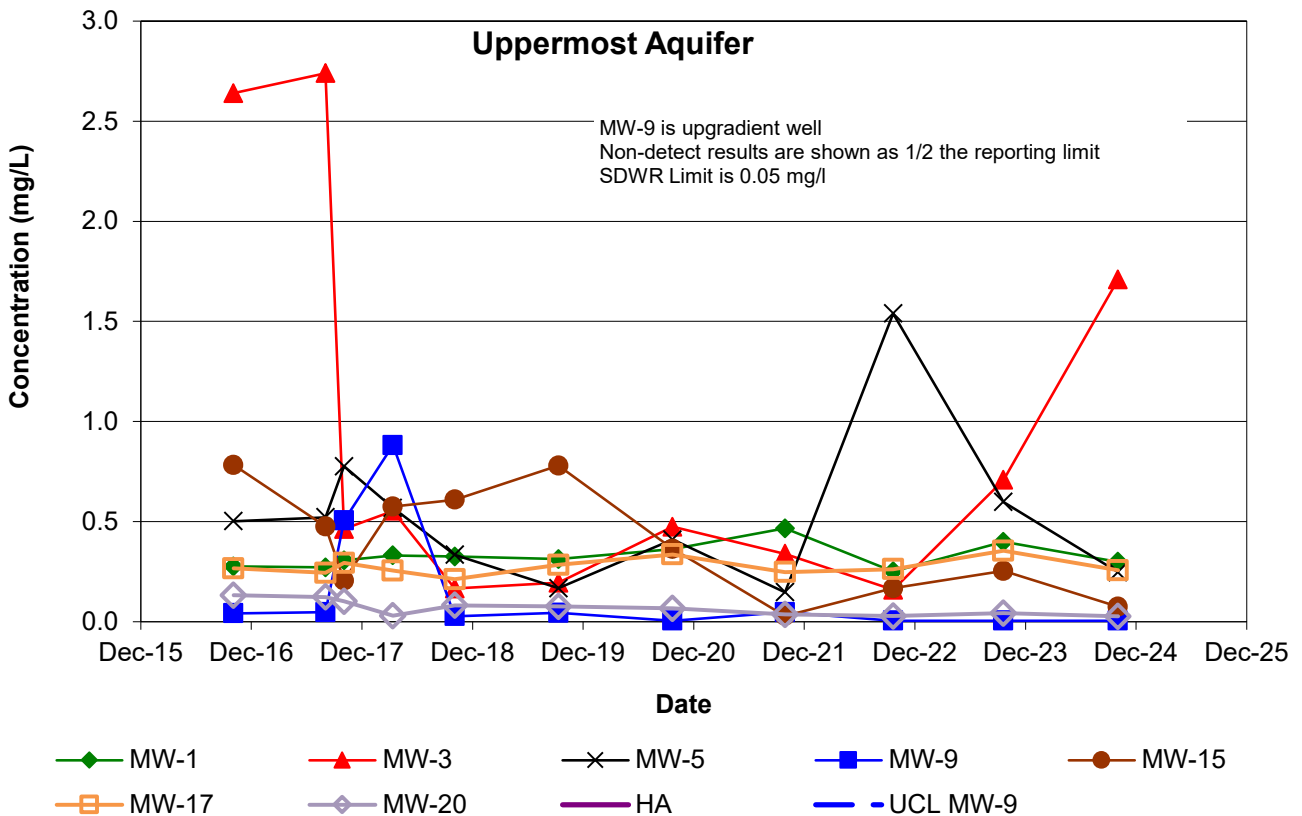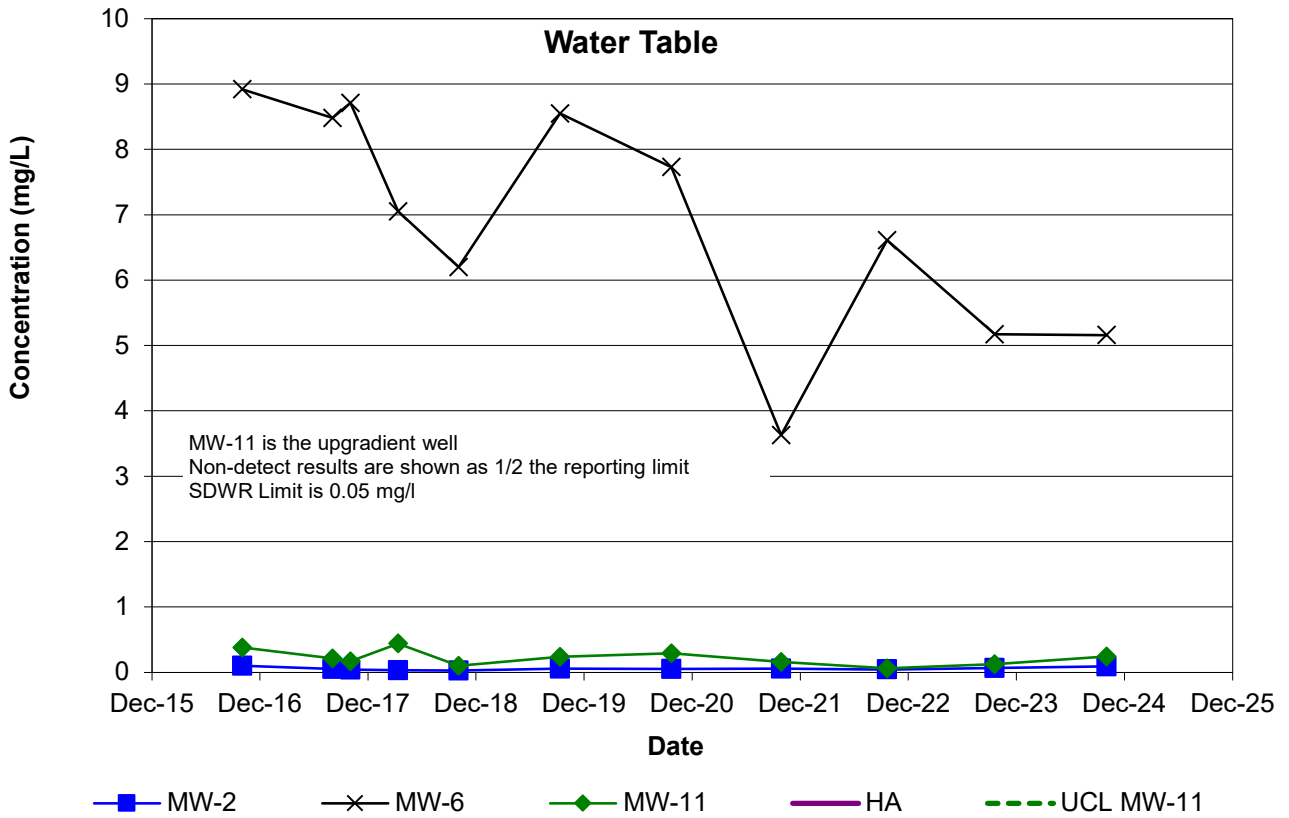



# MOLYBDENUM

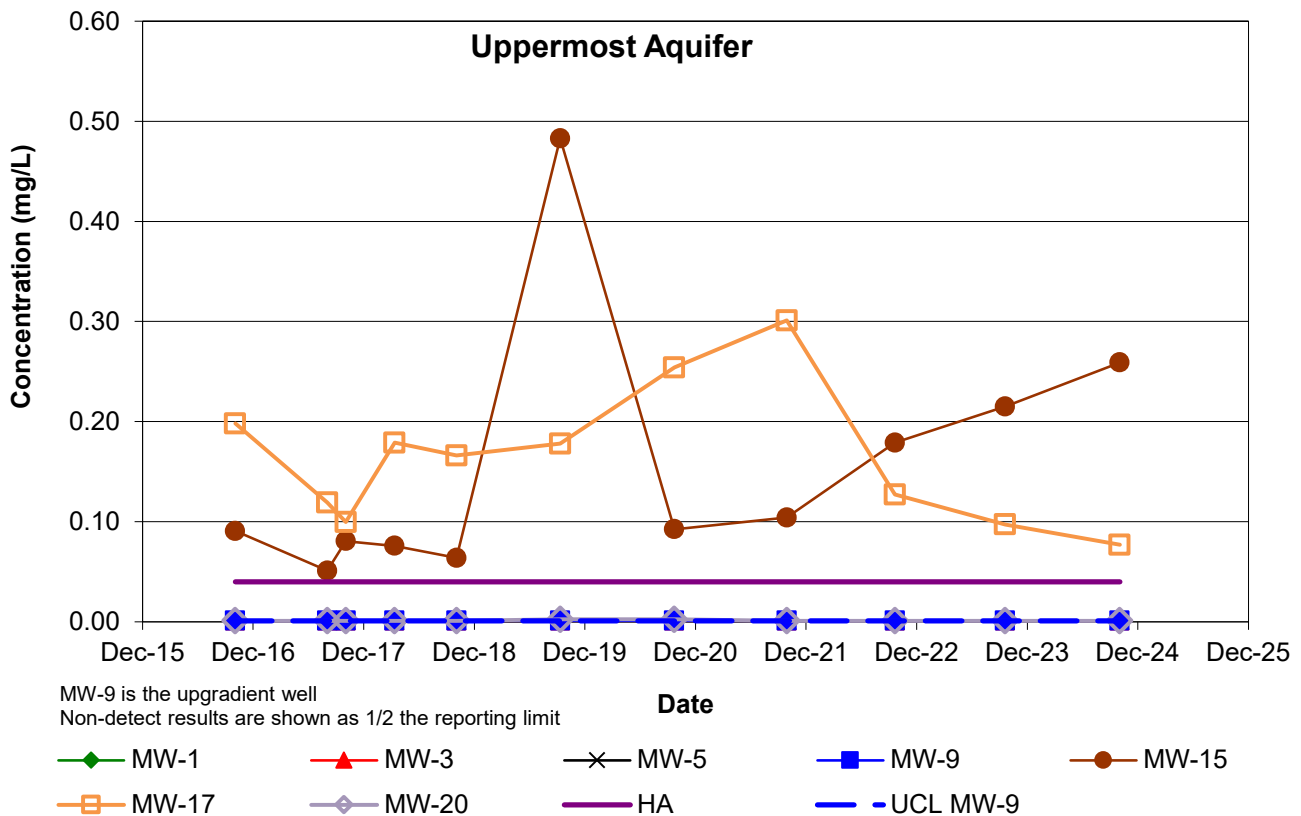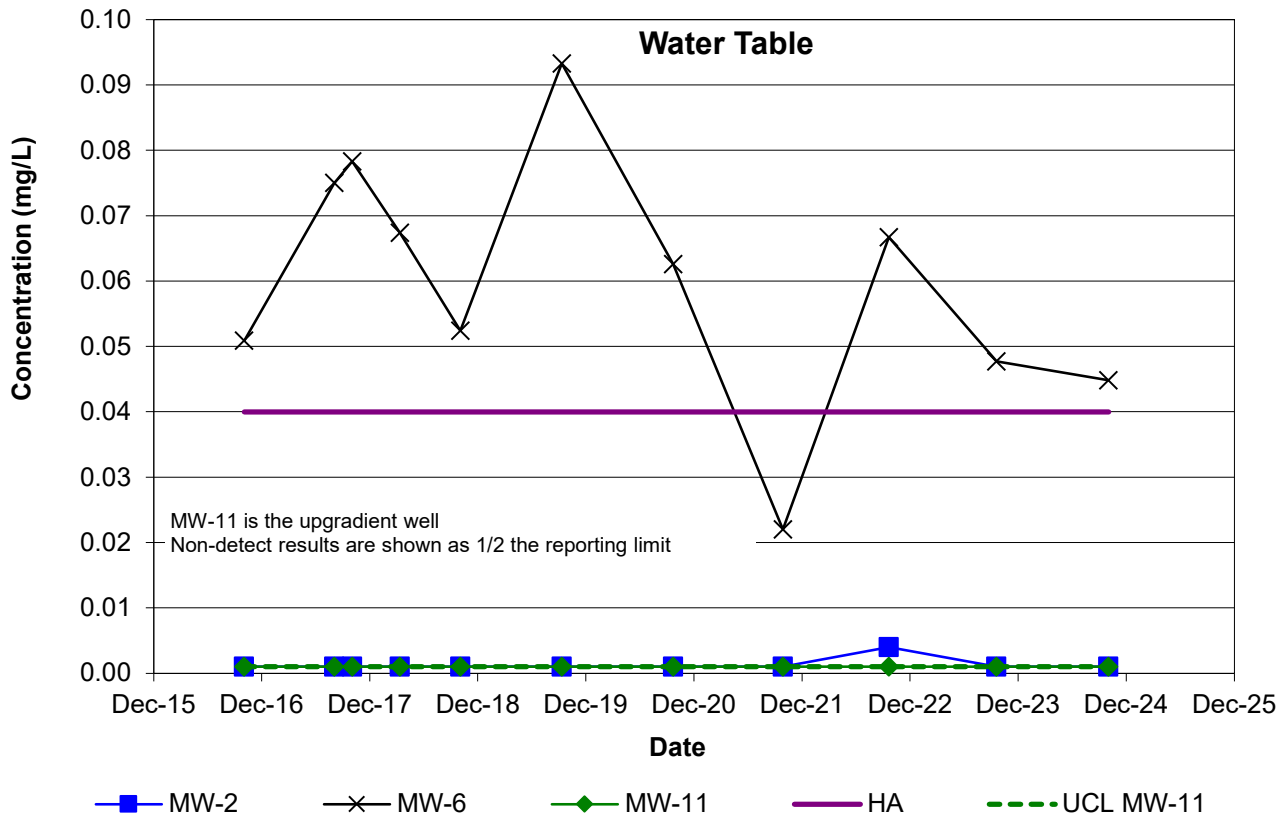

# SODIUM

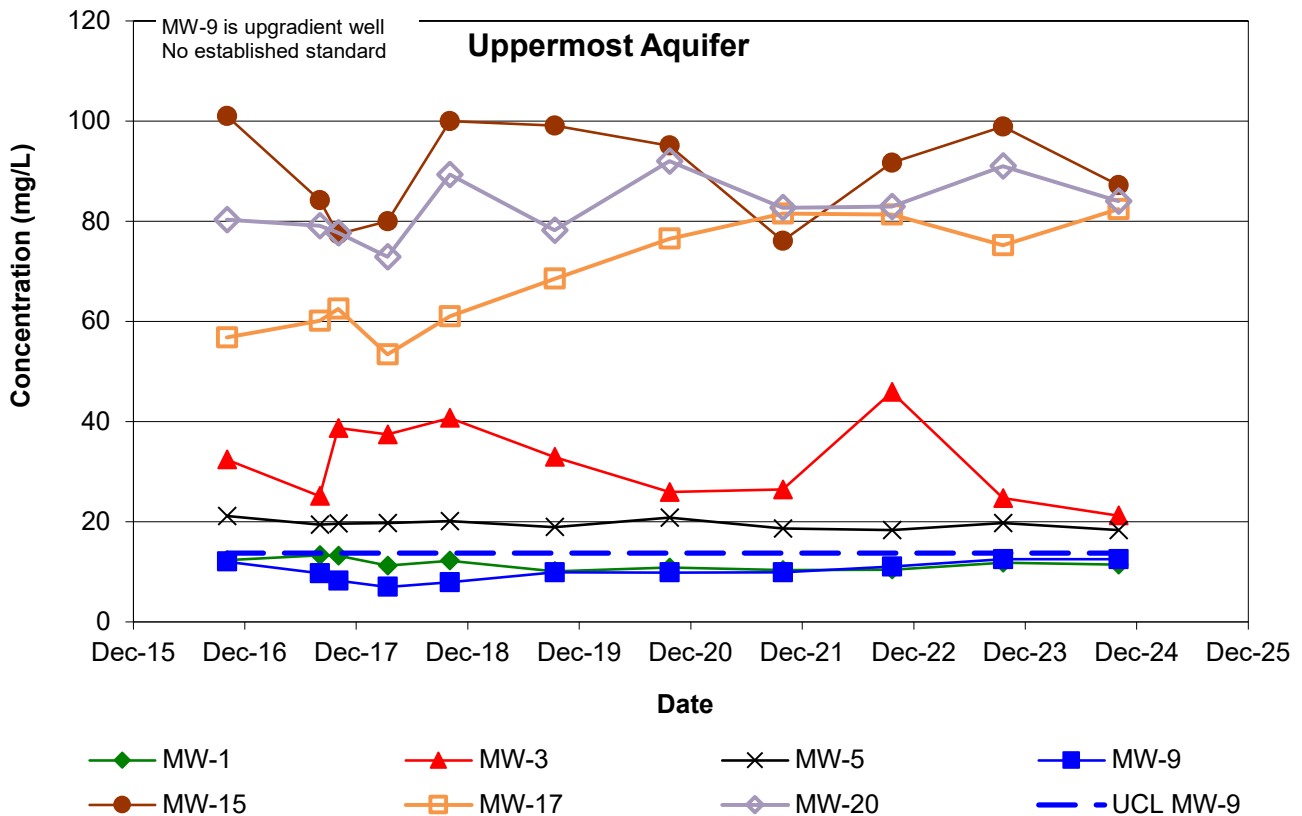
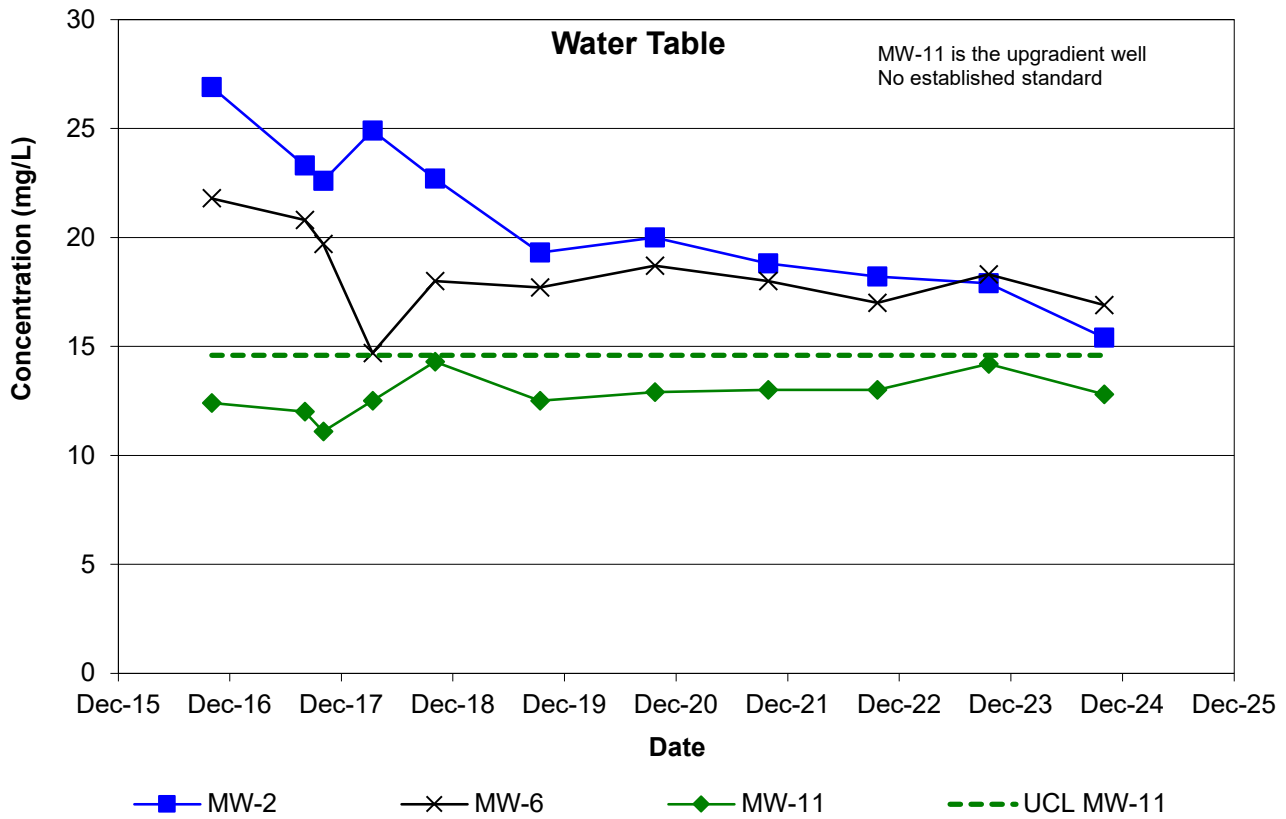


# STRONTIUM

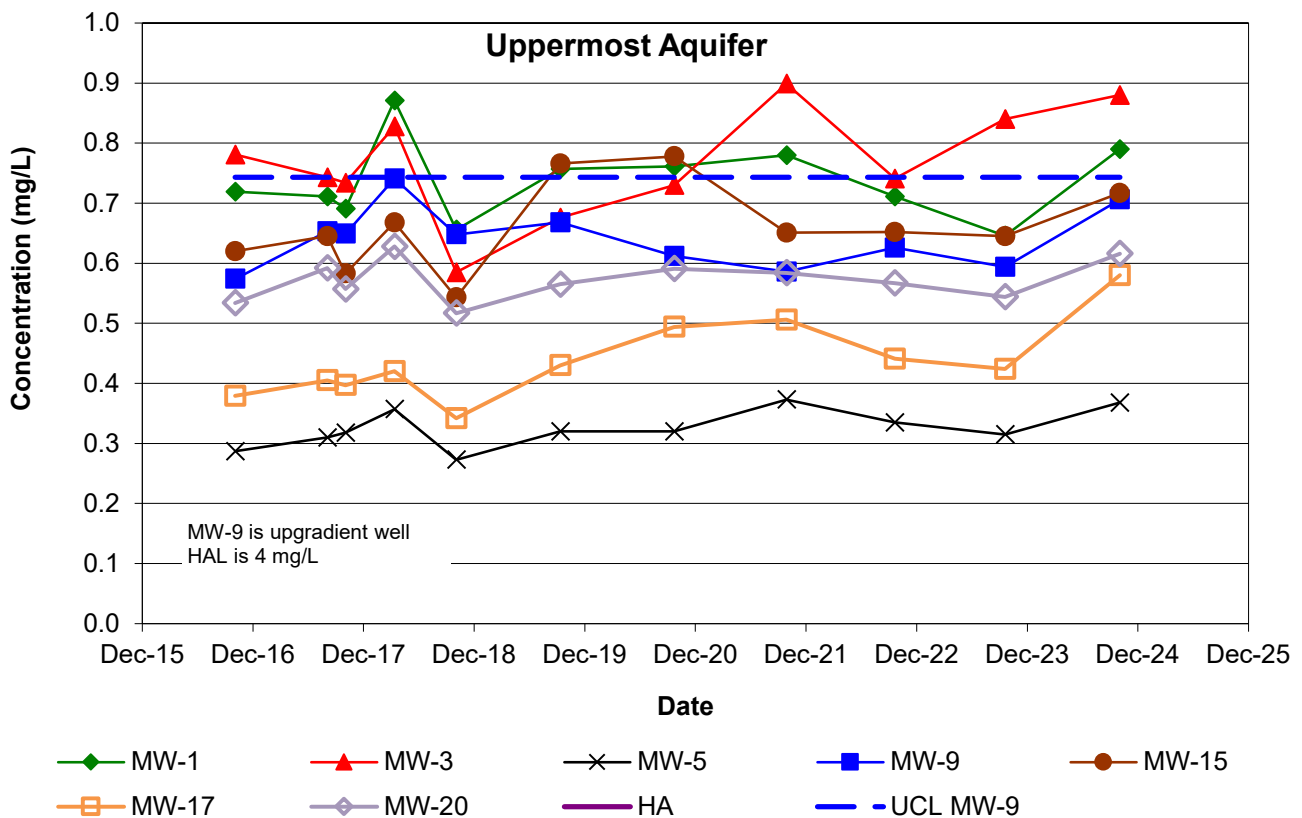
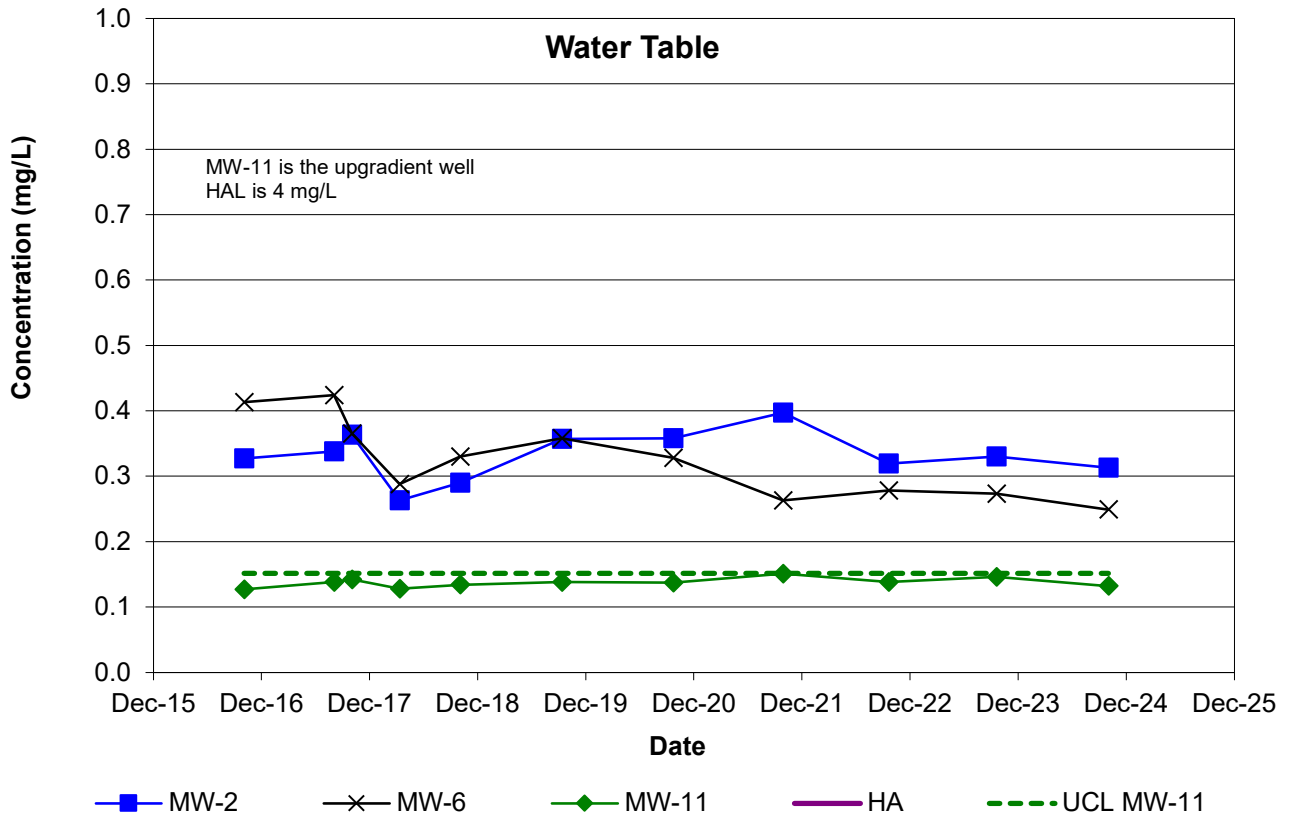






# SULFATE

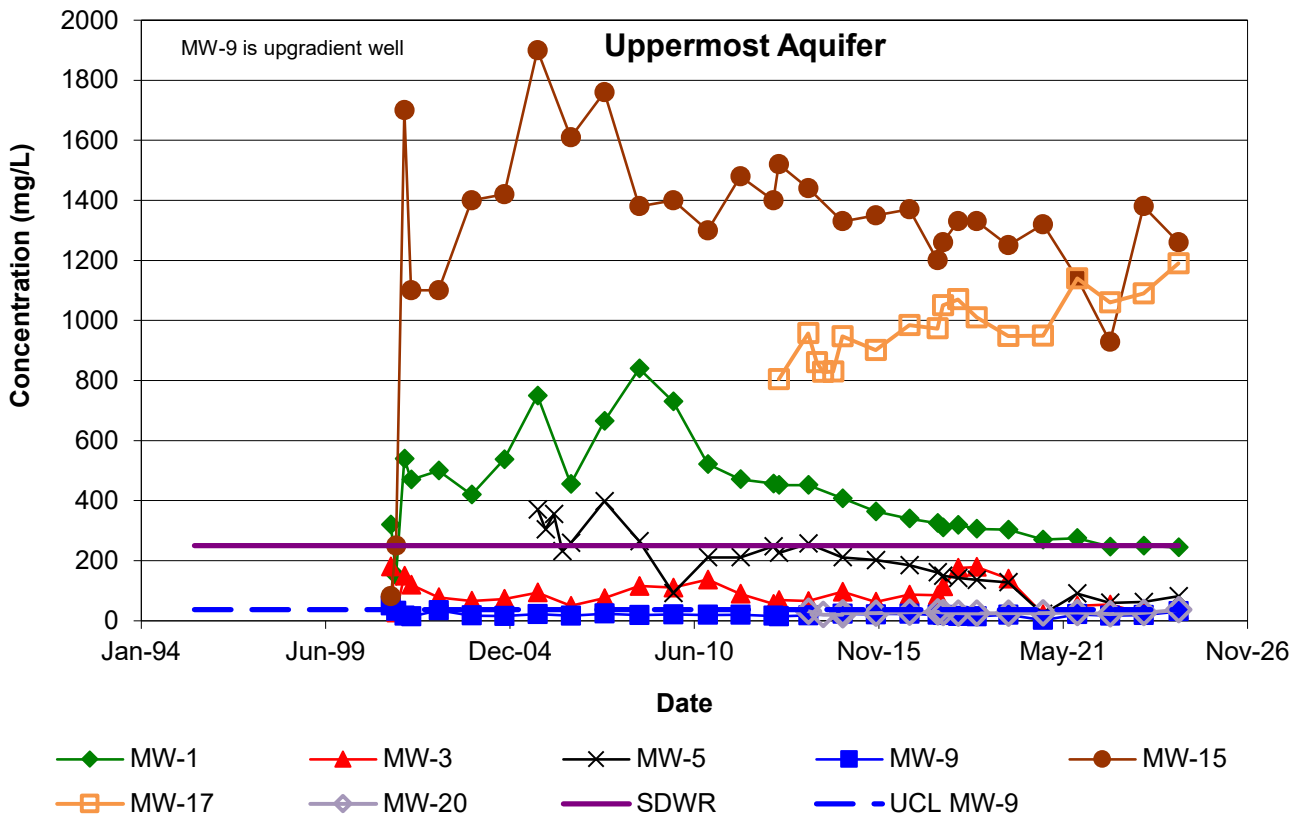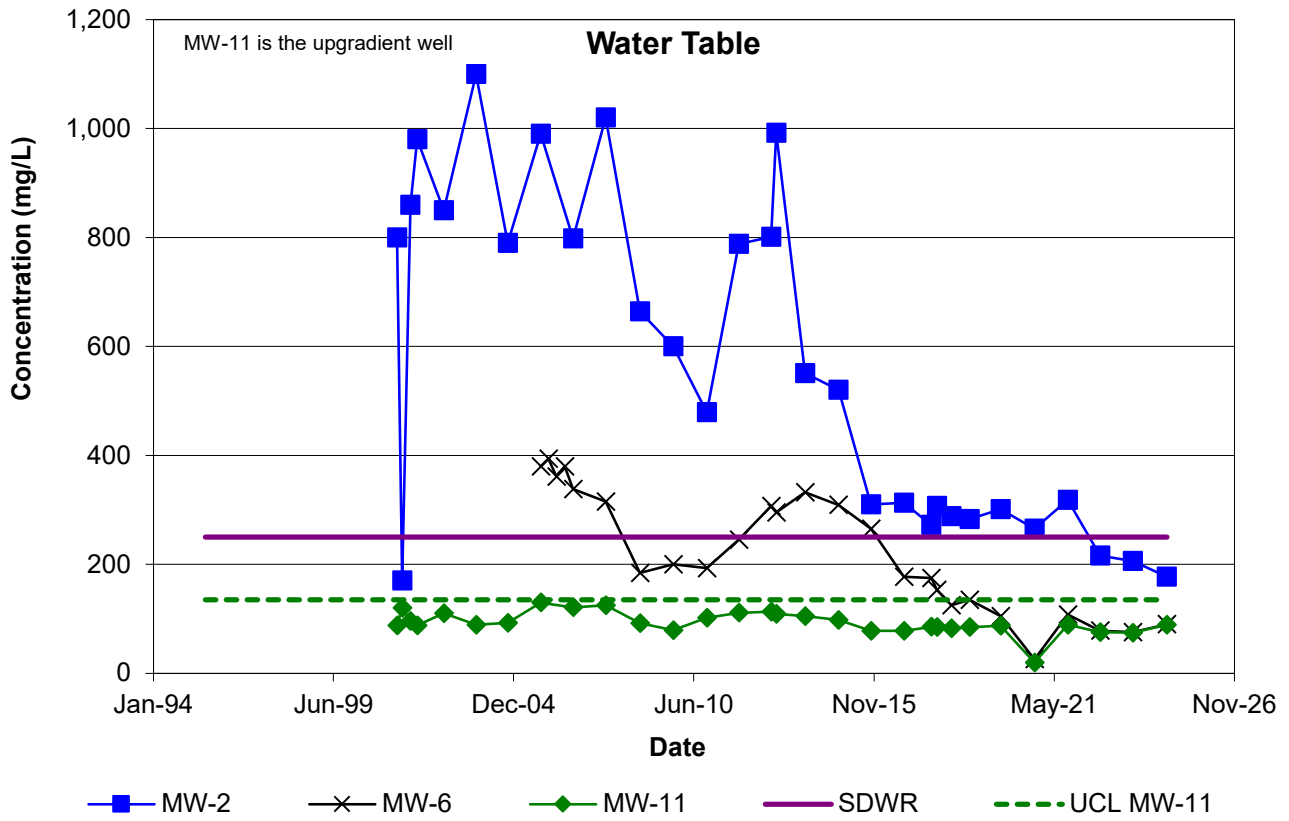



# pH

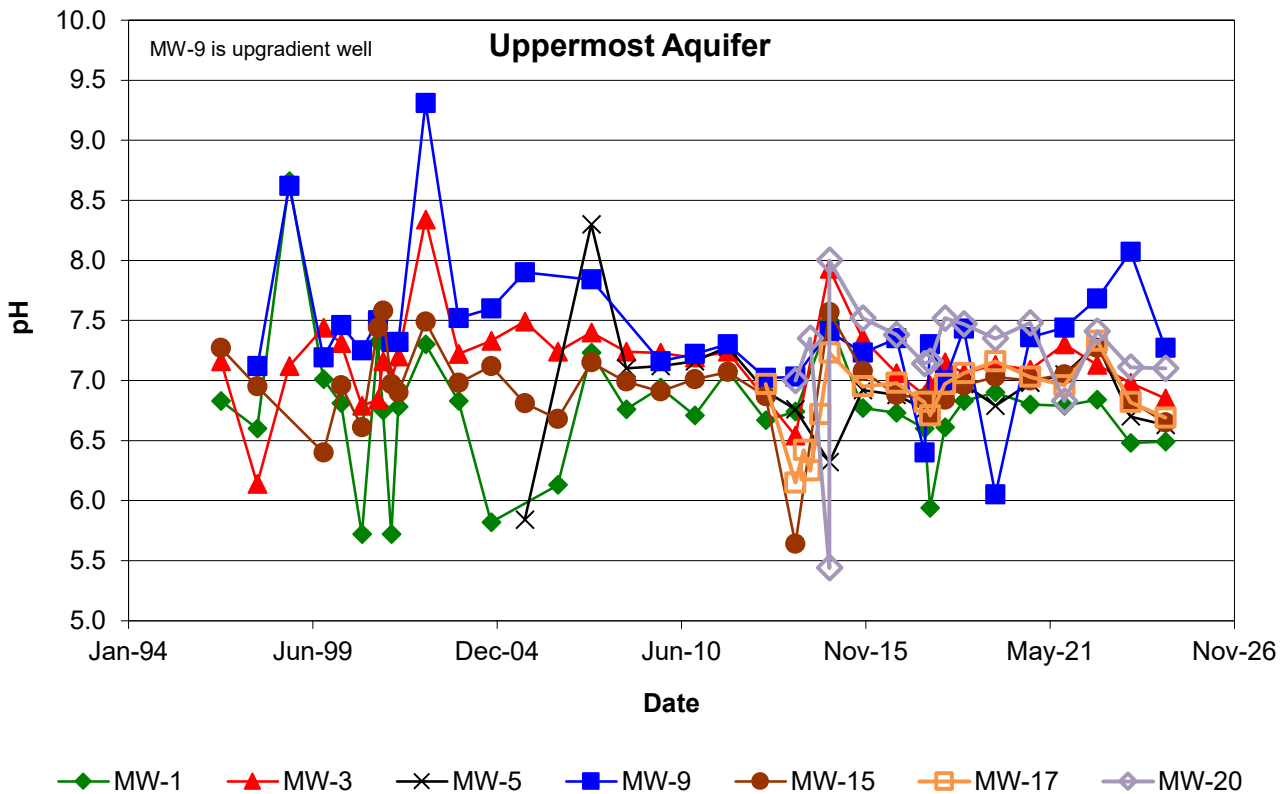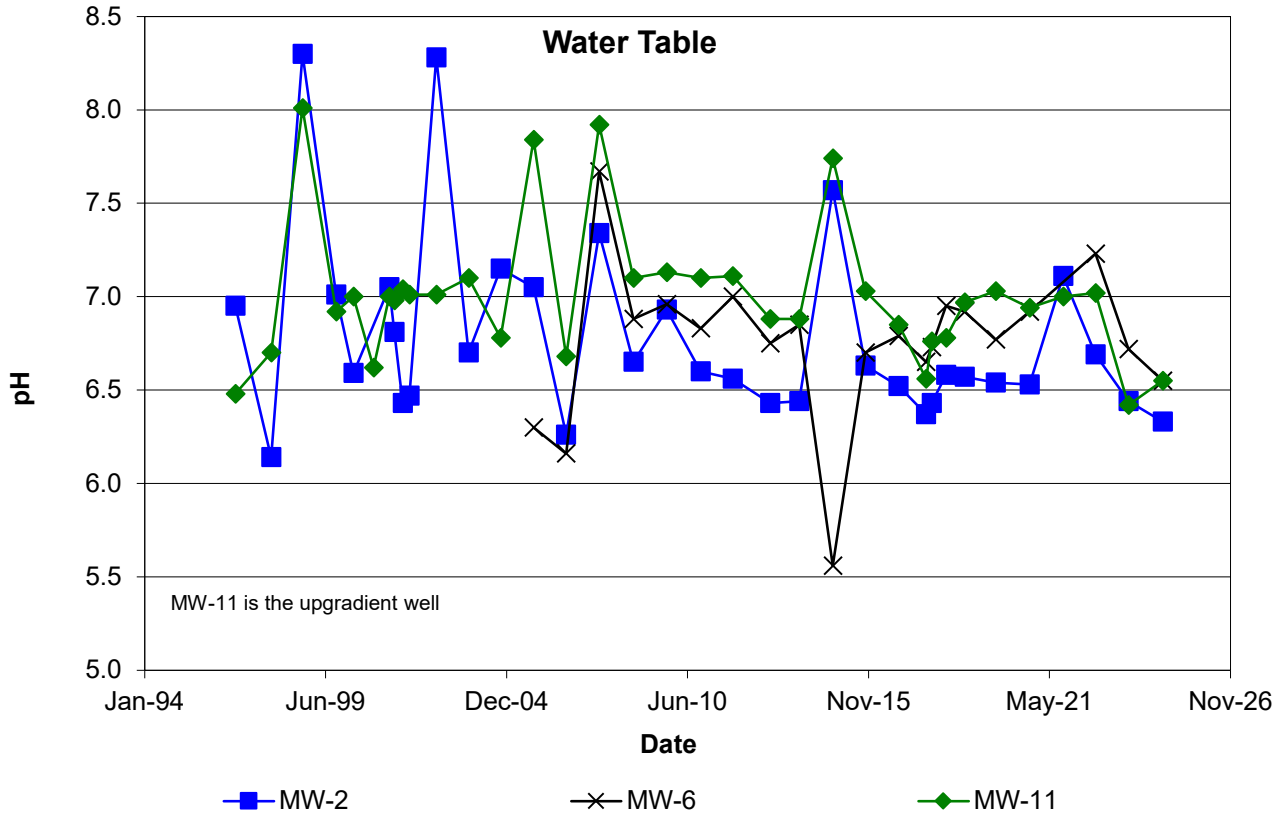

# CONDUCTIVITY

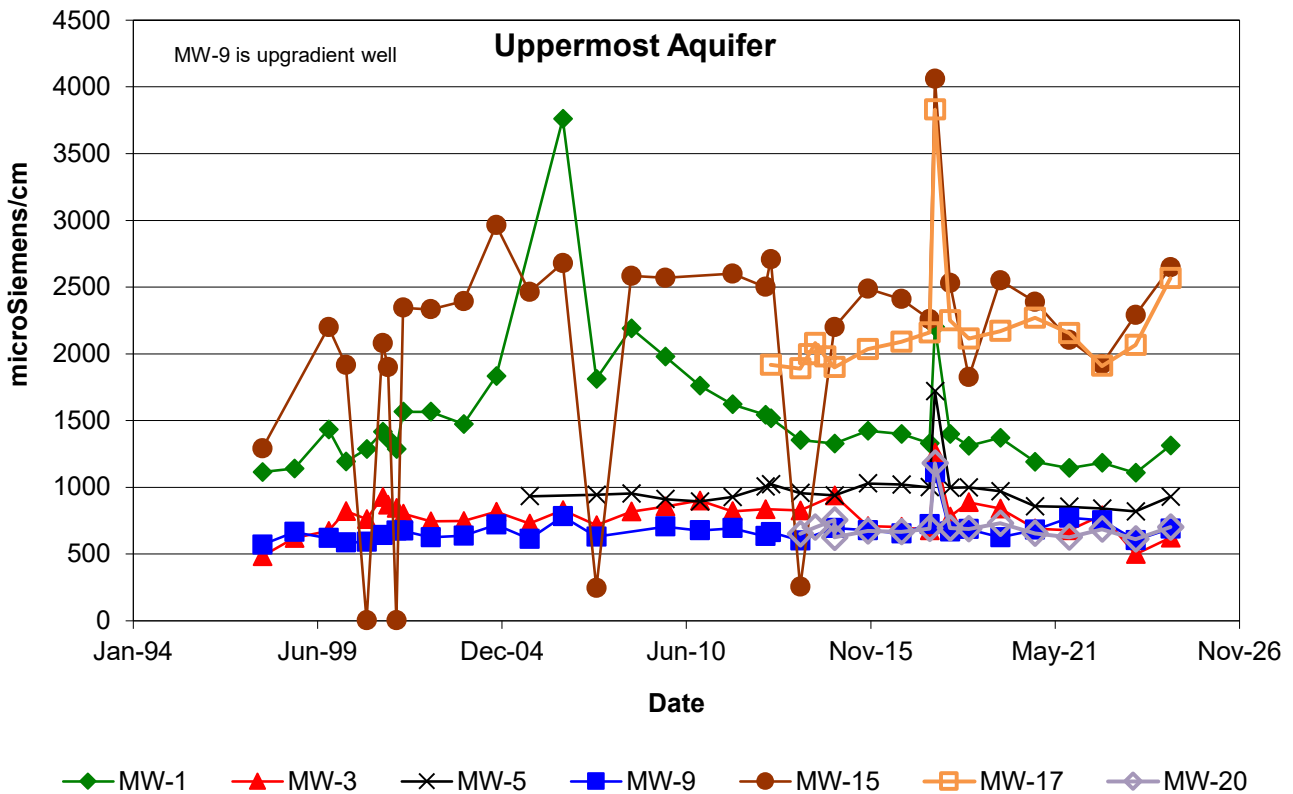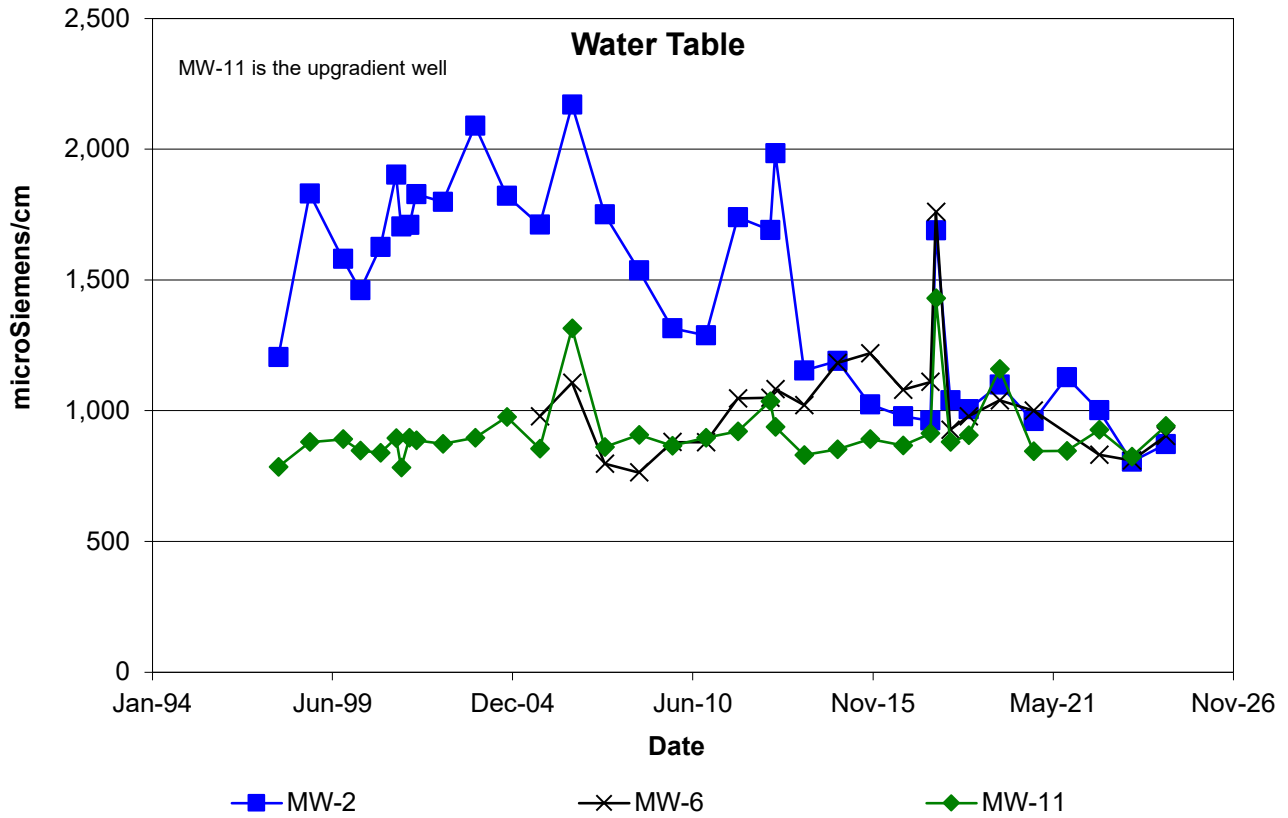

# TEMPERATURE

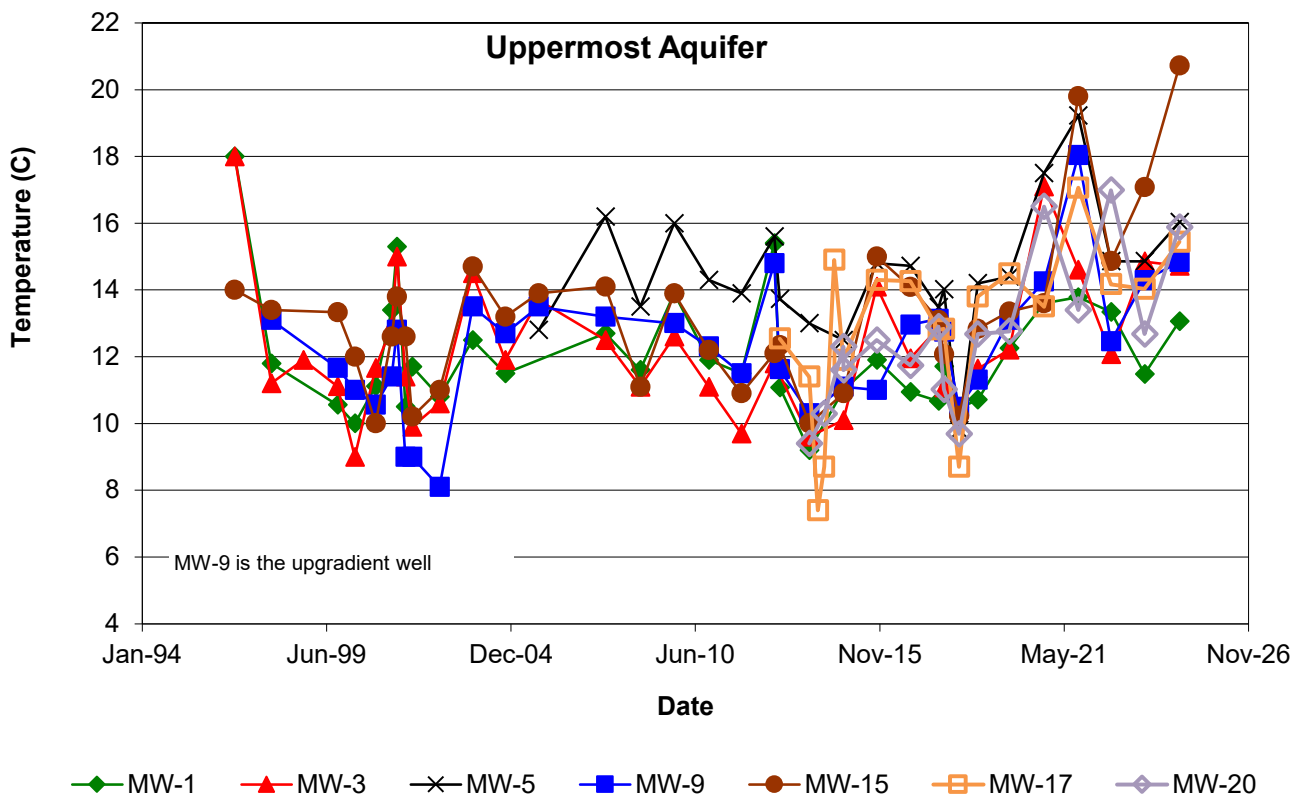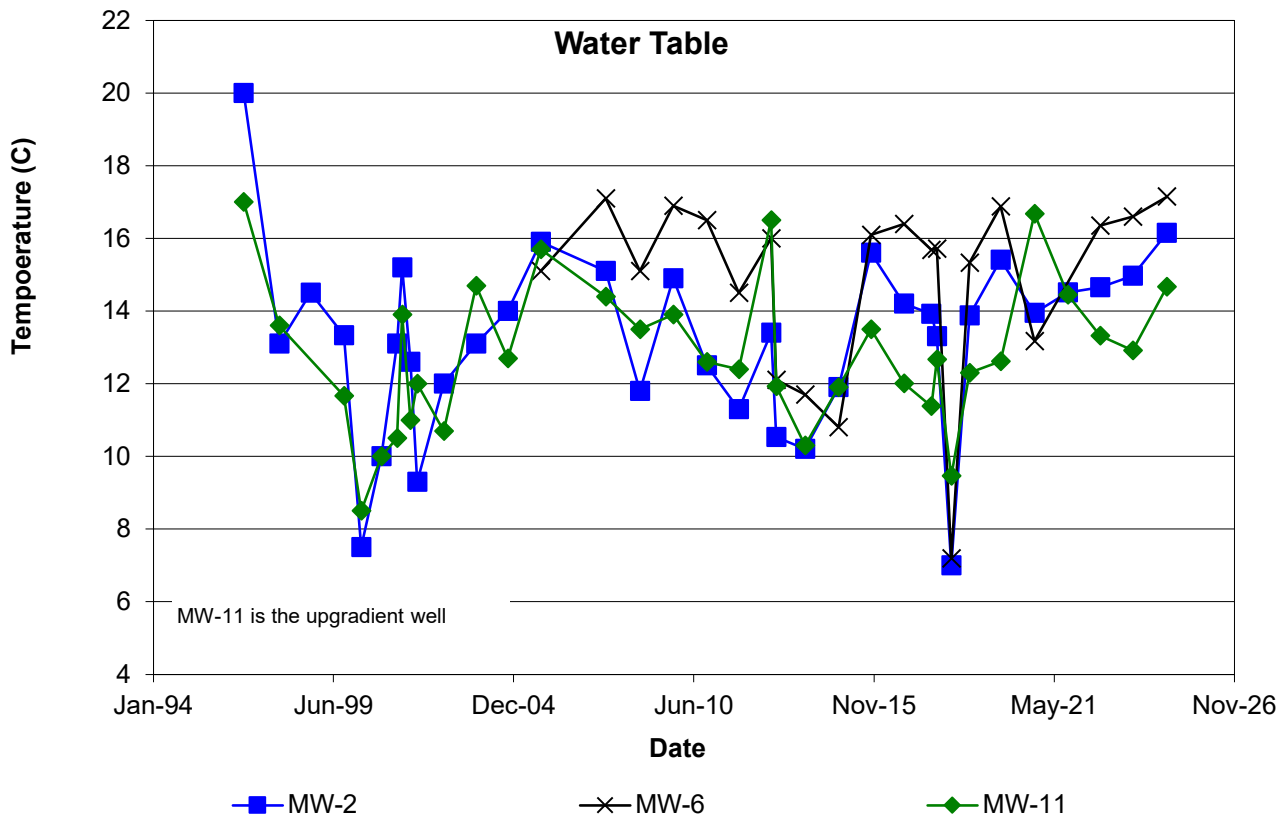

# **Appendix D**

## **Inspection Summary**



December 11, 2024

Mick Leat  
Iowa Department of Natural Resources  
Wallace State Office Building  
502 East 9<sup>th</sup> Street, 4<sup>th</sup> Floor  
Des Moines, IA 50319-0034

Dear Mick,

This letter has been prepared to provide a summary of monthly inspections completed by Central Iowa Power Cooperative (CIPCO) of the closed Fair Station Coal Combustion Residue Landfill near Muscatine, Iowa.

## BACKGROUND

2015 activities included: final capping of the ash, terrace, and rip-rap channel installation and seeding in September. Vegetation was started to be established in most areas by the end of 2015. Straw waddles were installed in areas of slow growth and areas at risk of washing out. The closure permit was issued February 1, 2016.

## 2024 Inspection Summary and Actions

The 2024 growing season had good precipitation followed by a dry fall. The vegetation remained in good shape throughout the year, mowing the site twice. Seed added in 2023 showed good growth. New seed was added to a few terrace spots that the mower scalped. These areas showed growth in the fall and will be checked again in the spring.

The main maintenance items conducted were: seeding and composting of trafficked areas, fence repair, tree removal, rip-rap channel cleaning, and general vegetation management throughout the site.

Clint Oberbroeckling of GHD conducted the annual well sampling in October.

CIPCO will continue to monitor and maintain the CCR Landfill according to the IDNR standards.

Regards,

A handwritten signature in blue ink that reads "Sam Honold".

Sam Honold, PE  
Supervisor, Generation Engineering  
Central Iowa Power Cooperative



319.366.8011  
800.373.8011  
319.366.6328 (fax)



Utility Operations  
1400 Highway 13 SE • P.O. Box 2517  
Cedar Rapids, IA 52406-2517



[www.cipco.net](http://www.cipco.net)





[ghd.com](http://ghd.com)

→ **The Power of Commitment**